




# Old Slane Road, Drogheda

*Daylight, Sunlight and Overshadowing Study*

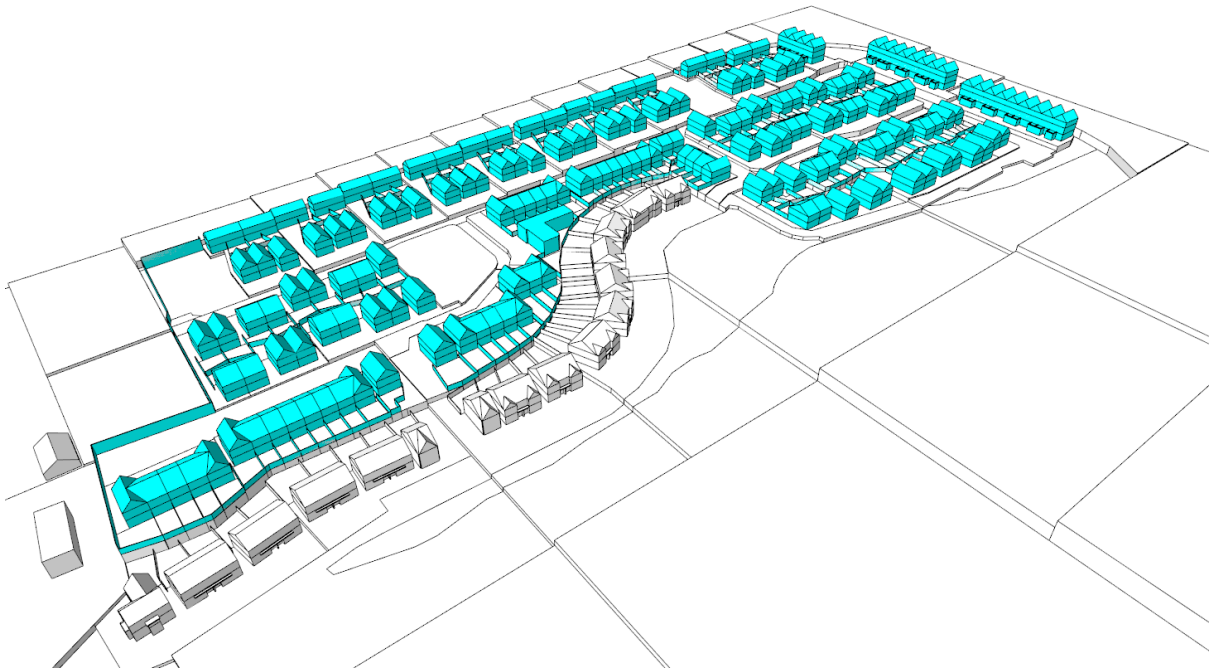

Not Marked

Report For: Lagan Homes Tullyallen

Project No: 17686



## Version History

**Document created by:**

Integrated Environmental Solutions Limited

International Sustainability Consulting Developers of the IES <Virtual Environment>

Issued For:	Prepared by:	Checked by:	
Planning Application	Hiren Patel / Sergio Malpica Project Consultants	Douglas Bell Consultancy Manager	
Version:	Date:	Revision Details:	Approved by:
1	18/12/2023	Draft for comment	Douglas Bell
1	21/12/2023	Final Report	Douglas Bell
1	16/04/2024	Draft for comment	Douglas Bell
1	30/04/2024	Draft for comment	Douglas Bell
1	09/05/2024	Final Report	Douglas Bell



## Table of Contents

1	Executive Summary.....	3
2	Introduction .....	11
3	BRE – Site Layout Planning for Daylight and Sunlight (3 <sup>rd</sup> Edition) .....	12
4	Methodology.....	13
5	Shadow Analysis.....	19
6	Sunlight to Amenity Spaces .....	33
7	Sunlight to Existing Buildings .....	51
8	Sunlight to Proposed Development.....	58
9	Daylight to Existing Buildings .....	71
10	Daylight to Proposed Development.....	74
11	Conclusion.....	96
12	Appendix A – Daylight Provision Results .....	102
13	Appendix B – Sunlight Exposure Results.....	150

## 1 Executive Summary

This report summarises the analyses undertaken to quantify the Sunlight and Daylight performance of the proposed Old Slane Road located in Drogheda. The report focuses on measuring the daylight and sunlight impact to the existing surrounding buildings as well as the daylight and sunlight performance within the proposed development.

### 1.1 Planning Authority Guidelines

The Sustainable Urban Housing: Design Standards for New Apartments 2023 states the following in Section 6.6:

*“Planning authorities should avail of appropriate expert advice where necessary and have regard to quantitative performance approaches to daylight provision outlined in guides like A New European Standard for Daylighting in Buildings IS EN17037:2018, UK National Annex BS EN17037:2018 and the associated BRE guide 209 2022 Edition (June 2022) or any relevant future standards or guidance specific to the Irish context, when undertaken by development proposers which offer the capability to satisfy minimum standards of daylight provision.”*

In addition to this, the Sustainable and Compact Settlements Guidelines states the following in Section 5.3.7-point b:

*“In cases where a technical assessment of daylight performance is considered by the planning authority to be necessary regard should be had to quantitative performance approaches to daylight provision outlined in guides like A New European Standard for Daylighting in Buildings IS EN17037:2018, UK National Annex BS EN17037:2019 and the associated BRE Guide 209 2022 Edition (June 2022), or any relevant future standards or guidance specific to the Irish context.”*

With regards to daylighting and external sunlight exposure in particular, where different methodologies are found in each of the different standards, all methodologies have been employed for completeness to ensure appropriate and reasonable regard has been taken to address all assessments under all of the different standards. For clarity these are listed below and the following Section 1.2 denotes which standard is applicable for each assessment type:

- BRE Guide –3<sup>rd</sup> Edition of BR 209 BRE Site Layout Planning for Daylight and Sunlight
- IS EN 17037-2018+A1-2021 – Daylight in Buildings
  - This is the Irish implementation of the European EN 17037-2018+A1-2021 standard
- BS EN 17037-2018+A1-2021 – Daylight in Buildings
  - This is the UK implementation of the European EN 17037-2018+A1-2021 standard. It supersedes BS 8206-2:2008 which is withdrawn in the UK. The BS EN standard includes a National Annex which addresses daylight requirements specific to dwellings which is notable as Ireland’s climate matches closely with the UK.



## 1.2 Reference Standards & Summary of Assessments Undertaken

The various daylight and sunlight assessments that were undertaken using the IES VE software are based on a number of different standards which are referenced in the individual sections of this report. For clarity, the assessments that were undertaken are summarised below as well as the reference standards that were used for each (where applicable):

- **Shadow Analysis**
  - Assessed using shadow images cast at key times throughout the year, i.e. March 21<sup>st</sup>, June 21<sup>st</sup> and December 21<sup>st</sup> to determine if any overshadowing impact occurs and to what extent to any existing residential neighbouring buildings in accordance with the BRE Guide (3<sup>rd</sup> Edition).
- **Sunlight to Amenity Spaces**
  - Assessed using annual Solar Exposure calculations to determine any impact to existing amenities and the sunlight received and also to assess the proposed developments amenity spaces to derive how much sunlight they can expect to receive in accordance with the BRE Guide (3<sup>rd</sup> Edition).
- **Sunlight to Existing Buildings**
  - Assessed using the Annual Probable Sunlight Hours (APSH) method in accordance with the BRE Guide (3<sup>rd</sup> Edition) - to determine any impact to sunlight received to the existing neighbouring building main living areas.
- **Sunlight to Proposed Buildings**
  - Assessed using Solar Exposure calculations in accordance with IS/BS EN 17037-2018+A1-2021 (BRE Guide 3<sup>rd</sup> Edition)
  - In both assessments above the aim is to derive how much sunlight proposed development can expect to receive.
- **Daylight to Existing Buildings**
  - Assessed using the Vertical Sky Component (VSC) method in accordance with the BRE Guide (3<sup>rd</sup> Edition) - to determine any impact to existing daylight received to the existing building neighbouring the site.
- **Daylight to Proposed Development**
  - Assessed in accordance with IS EN 17037-2018+A1-2021 Method 2 (BRE Guide 3<sup>rd</sup> Edition)
  - Assessed in accordance with BS EN 17037-2018+A1-2021 National Annex Method 2 (BRE Guide 3<sup>rd</sup> Edition)
  - In all assessments above the aim is to derive how much daylight will be received within each of the houses and apartments within the proposed development.
- **View Out**
  - Assessed in accordance with IS EN 17037-2018+A1-2021 (BRE Guide 3<sup>rd</sup> Edition)
- **Glare**
  - Assessed in accordance with IS EN 17037-2018+A1-2021 (BRE Guide 3<sup>rd</sup> Edition)

The following can be concluded based on the assessments undertaken:

### **1.3 Shadow Analysis**

The shadow analysis illustrates different shadows being cast at key times of the year (March 21<sup>st</sup>, June 21<sup>st</sup> and December 21<sup>st</sup>) for the Existing/Permitted Situation and the Proposed Scheme. The results from the study are summarised as follows:

#### **Properties on Slane Road - South**

No additional shading visible from the proposed development on these existing properties throughout the year.

The potential shading impact is quantified via the “Sunlight to Amenity Spaces” and “Daylight to Existing Buildings” sections of this report.

### **1.4 Sunlight to Amenity Spaces**

As outlined in Section 3.3.17 of the BRE Guide (3<sup>rd</sup> Edition), for a space to appear adequately sunlit throughout the year, at least half of the garden or amenity area should receive at least 2 hours of sunlight on March 21<sup>st</sup>. In the case of existing amenity spaces, if they are already below the 50% threshold then the BRE recommends the results kept to within 80% of the existing situation.

#### **Permitted Amenity Spaces**

On March 21<sup>st</sup> the permitted amenity spaces will receive similar levels of sunlight with the proposed development in place when compared to the permitted situation. In all cases the results comply with the recommendations in the BRE Guide outlined above.

#### **Proposed Public Open Amenity Spaces**

On March 21<sup>st</sup>, 96% of the combined proposed public open amenity area situated within the development site will receive at least 2 hours of sunlight over their total area. Thus, complying with the BRE recommendations. When considered individually, all amenity areas are also exceeding the BRE guidelines.

#### **Proposed Rear Garden Amenity Spaces**

On March 21<sup>st</sup>, 80% (132 out of 165) of the proposed rear garden amenity spaces within the development site will receive at least 2 hours of sunlight over their total area, thus complying with the BRE recommendations. When compared against the minimum area required for each dwelling the compliance rate increases to 95% (157 out of 165).

It is important to note that the rear garden amenity spaces were tested with a 2.00 meter high fence, except for numbers 93 and 94, where the boundary wall to the south is a 3.00 meter high acoustic wall. When this wall is reduced to 2.00 meters, amenity spaces number 93 and 94 receive at least 2 hours of sunlight on March 21<sup>st</sup> across their minimum area required. The overall results increase from 95% to 96%.

The majority of rear gardens receiving sunlight below recommended levels are as a result of the amenity overall site location and position in relation to neighbouring dwellings. In site layout planning this is inevitable. Not all amenities can be south facing or free from overshadowing from neighbouring dwellings within a housing development. For these reasons noted, achieving in excess of 80% of

private amenities above the recommendations of 2 hours of sunlight during March 21<sup>st</sup> is a high standard to achieve.

### **Proposed Creche Amenity Space.**

On March 21<sup>st</sup>, 48% of the proposed amenity space provided for the creche will receive at least 2 hours of sunlight over its total area. While this is just below the BRE recommendations, it is expected that this space will enjoy good levels of sunlight throughout the summer months when the climatic conditions permit its use.

## **1.5 Sunlight to Existing Buildings**

This study considers the proposed scheme and tests if the Annual Probable Sunlight Hours (APSH) results for the living room windows are greater than 25% annual and 5% winter sunlight or are greater than 0.8 times their former value with the proposed development in place or the reduction in sunlight across the year is less than 4% with the proposed development in place.

Based on the criteria outlined in Section 3.2.9 of the BRE Guide 3<sup>rd</sup> Edition, none of the existing/permitted buildings fit the requirements to be assessed and as such the APSH assessment was not conducted. The BRE guide (3<sup>rd</sup> Edition) notes that there should be no impact to sunlight for these properties “It is not always necessary to do a full calculation to check sunlight potential. The guideline above is met provided either the following is true:

- If the window wall faces within 90° of due south and no obstruction, measured in the section perpendicular to the window wall, subtends an angle of more than 25° to the horizontal. Again, obstructions within 90° of due north need not be counted.”

Given the statement above, the surrounding dwellings adjacent to the proposed development were verified noting that, in a section perpendicular to the window wall, no angle subtended more than 25° and, in some cases, they were also sitting to the south of the proposed development. The surrounding existing/permitted properties have been excluded from the assessment as noted in Section 3.2.9 of the BRE Guide 3<sup>rd</sup> Edition, that these windows need not be analysed as sunlight impact will be unnoticeable to the existing occupants.

## **1.6 Sunlight to Proposed Development**

As the sunlight exposure assessment in accordance with BRE Guide 3<sup>rd</sup> Edition / IS/BS EN 17037-2018+A1-2021 considers the orientation of the rooms the following should be noted from section 3.1.11 of the guide.

*“The BS EN 17037 criterion applies to rooms of all orientations, although if a room faces significantly north of due east or west it is unlikely to be met.”*

Of the 207 no. points tested, 100% meet the BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 sunlight exposure recommendations of greater than 1.5 hours on March 21<sup>st</sup>.

Overall, the sunlight provision results to the proposed development in accordance with IS/BS EN 17037:23018 are considered excellent. Finally, the sunlight exposure results are visually represented in Appendix B.

## 1.7 Daylight to Existing Buildings

This study considers the Proposed Scheme and tests if the VSC results are greater than 27% or not less than 0.8 times the value of the Existing Situation.

Based on the criteria outlined in Section 2.2.5 of the BRE guidance (3<sup>rd</sup> Edition), none of the neighbouring buildings need to be included within the VSC assessment as they did not meet the criterion as laid out within the BRE guide which is as follows.

It is not always necessary to do a full calculation to check daylight potential. The guideline above is met provided the following is true:

- no obstruction, measured in the section perpendicular to the window wall, subtends an angle of more than 25° to the horizontal.

Therefore, as noted above, the adjacent buildings have been excluded within the VSC assessment as the daylight impact will be unnoticeable to the occupants of the neighbouring elevations. Please refer to section 7.3 25 Degree Rule for the section images produced as evidence for each of the qualifying views.

## 1.8 Daylight to Proposed Development

For the daylight to proposed development assessment, two standards have been analysed: IS EN 17037-2018+A1-2021 and BS EN 17037-2018+A1-2021 National Annex (BRE Guide 3<sup>rd</sup> Edition). The results under each standard are summarised below.

The objective of the design team is to maximise the number of units which exceed the recommendations.

### **BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021**

It is important to note that IS EN 17037-2018+A1-2021 (BRE Guide 3<sup>rd</sup> Edition) does not provide different illuminance targets for different space types. Therefore, in the case of residential developments; bedrooms, living rooms, kitchens and combined LKDs all have the same daylight provision targets.

There are two methods to assess daylight provision to the interior which are based on target values in either Table A.1 or Table A.3 of IS EN 17037-2018+A1-2021 which are summarised as follows:

**Method 1:** This calculation method uses the daylight factor targets on the reference plane as per Table A.3 (refer to Section 10.1.2 of this report). The assessment is carried out on a representative day and time during the year, i.e. 21<sup>st</sup> September @ 12:00 under standard CIE overcast sky conditions.

**Method 2:** This calculation method uses the illuminance targets on the reference plane as per Table A.1 (refer to Section 10.1.2 of this report). The assessment is carried out for each hour over the course of the year (8,760 hours) using a local weather file which accounts for varying sky conditions and sun positions throughout the year.

As outlined in Section 5.1.4 of the standard, the verification of daylight provision can be determined using either an adequate software or on-site measurements. When using a software, *“a representative model of the space is required together with the key parameters (such as any significant nearby obstructions, the assigned surface reflectance values and glazing transmissivity) that are a reasonable representation of those for the actual, completed building. This can be determined using either Method 1 or Method 2.”*

Based on the above criteria, the daylight provision to the proposed development has been assessed using an adequate software (i.e. IES VE), using the Method 2 climate-based approach and targeting the minimum recommended values outlined in Table A.1 of IS EN 17037-2018+A1-2021.

The Method 2 climate-based approach was selected as it is a far more accurate assessment method compared to Method 1. Climate based daylight modelling (CBDM) is more accurate compared to a calculation based on a single day during the year, i.e. Method 1. The amount of daylight varies throughout the year, primarily due to the sun’s position, so it is essential the impact of daylight variance is properly considered. CBDM utilises an annual simulation linking location, shading, climate data (including solar intensity and cloud cover) together with the building properties. This provides a complete overview on how the daylight performance varies throughout the year due to changes in these factors.

Across the proposed development, 100% of the tested rooms are achieving the daylight provision targets in accordance with Table A.1 of IS EN 17037-2018+A1-2021 using Method 2.

#### **BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 National Annex**

In the UK, EN 17037-2018+A1-2021 was adopted to form “BS EN 17037-2018+A1-2021”. However, a National Annex was included which states:

*“The UK committee supports the recommendations for daylight in buildings given in BS EN 17037:2018; however, it is the opinion of the UK committee that the recommendations for daylight provision in a space (see Clause A.2) may not be achievable for some buildings, particularly dwellings. The UK committee believes this could be the case for dwellings with basement rooms or those with significant external obstructions (for example, dwellings situated in a dense urban area or with tall trees outside), or for existing buildings being refurbished or converted into dwellings. This National Annex therefore provides the UK committee’s guidance on minimum daylight provision in all UK dwellings.”*

Whereas IS EN 17037-2018+A1-2021 does not provide different illuminance targets for different space types, the BS EN 17037-2018+A1-2021 National Annex provides target illuminance values for bedrooms, living rooms and kitchens within residential developments as per Table NA.1 (refer to Section 10.1.2 of this report). It is also important to note that as the climate in Ireland is similar to the UK, the targets outlined in the BS EN National Annex could also be applied to dwellings in Ireland.

The BS National Annex also states:

*“Where one room in a UK dwelling serves more than a single purpose, the UK committee recommends that the target illuminance is that for the room type with the highest value – for example, in a space that combines a living room and a kitchen the target illuminance is recommended to be 200 lx.”*

Therefore, combined LKDs were assessed using a 200-lux target illuminance ( $E_T$ ).

Across the proposed development, 100% of the tested rooms are achieving the daylight provision targets in accordance with Table NA.1 of BS EN 17037-2018+A1-2021 using Method 2.

## 1.9 View Out

The View Out assessment is related to buildings such as offices or schools where seating layouts are typically fixed compared to domestic settings where an occupant can move around the space freely. In their own home occupants can choose to sit near to or even at a window which will inevitably provide the varying layers of a ‘View Out’ such as the ground, landscape or sky. This ability to choose their position within a domestic setting means they would always have access to a position in the house or apartment with the minimum requirements of ‘View Out’. Therefore, all the properties would meet the minimum requirement as outlined in IS EN 17037-2018+A1-2021 / BS EN 17037-2018+A1-2021 National Annex (BRE Guide 3<sup>rd</sup> Edition).

### 1.10 Glare

As outlined in IS EN 17037-2018+A1-2021 / BS EN 17037-2018+A1-2021 National Annex (BRE Guide 3<sup>rd</sup> Edition), a Glare assessment is suggested in spaces where the *“expected activities are comparable to reading, writing or using display devices and the user is not able to choose freely their position and viewing direction”*. Given that occupants within a domestic setting are free to move around, on this basis a glare assessment for the proposed development has not been carried out.

### 1.11 Observations

It is important to note that the recommendations within the BRE Guide (3<sup>rd</sup> Edition) itself states *“although it gives numerical guidelines these should be interpreted flexibly because natural lighting is only one of many factors in site layout design”*, Although this is true appropriate and reasonable regard has still been taken to the BRE guide.

Whilst the results shown relate to the criteria as laid out in the BRE Guide (3<sup>rd</sup> Edition), it is important to note that the BRE targets are guidance only and should therefore be used with flexibility and caution when dealing with different types of sites.

In addition, BRE Guide 3<sup>rd</sup> Edition also notes:

*“This report is a comprehensive revision of the 2011 edition of Site layout planning for daylight and sunlight: a guide to good practice. It is purely advisory and the numerical target values within it may be varied to meet the needs of the development and its location.”*



Taking all of the above information into account and based on the results from each of the assessments undertaken, the proposed development performs very well when compared to the recommendations in the BRE Guide 3rd Edition and IS EN 17037-2018+A1-2021 /BS EN 17037-2018+A1-2021 National Annex.

## 2 Introduction

This report summarises the analyses undertaken to quantify the Sunlight and Daylight performance of the proposed Old Slane Road located in Drogheda. The report focuses on measuring the daylight and sunlight impact to the existing surrounding buildings as well as the daylight and sunlight performance within the proposed development.

### 2.1 Development Description

The LRD planning application seeks modifications to the permitted SHD (APB-311678-21, as amended under P.A. Ref. 2360368) and the application relates to 207 of the 237 permitted dwellings and the construction of the crèche as a standalone building (crèche is permitted as integral part of one of the apartment buildings in the permitted development). The modifications proposed do not affect the 30no. permitted dwellings currently under construction (Amendment permission P.A. Ref. 2360368) other than a minor boundary adjustment to the garden boundary of No. 30. The modifications provide for amendments to the design, layout and dwelling types including the omission of two permitted apartment buildings (111no. apartments) with associated modifications to the road layout and distribution of public open space, car parking, site services and site development works including the undergrounding of ESB overhead lines and associated diversion works. The 207no. new house types and apartments proposed have a residential mix of 21no. 1-bed, 49no. 2-bed, 115no. 3-bed & 22no. 4-bed, one, two and three storey in height in detached, semi-detached and terraced formats. The overall number of dwellings as permitted under the SHD (APB-311678-21, as amended under P.A. Ref. 2360368) will remain unchanged at 237 dwellings. The overall permitted dwelling mix will change from 147no. apartments and 90no. houses, to 42no. apartments and 195no. houses. The mix of dwellings within the entire SHD site will be amended from 19no. 1-bed, 96no. 2-bed, 109no. 3-bed and 13no. 4-bed (as permitted under APB-311678-21 and amended under P.A. Ref. 2360368), to 21no. 1-bed, 49no. 2-bed, 142no. 3-bed and 25no. 4-bed. This planning application also seeks permission for 2no. ESB substations required to serve the proposed development. This planning application will be accompanied by a Natura Impact Statement (NIS).



### 3 BRE – Site Layout Planning for Daylight and Sunlight (3<sup>rd</sup> Edition)

Access to daylight and sunlight is a vital part of a healthy environment. Sensitive design should provide sufficient daylight and sunlight to new residential developments while not obstructing light to existing homes nearby.

The 3<sup>rd</sup> Edition of the BR 209 BRE Site Layout Planning for Daylight and Sunlight, advise on planning developments for good access to daylight and sunlight and is widely used by local authorities to help determine the performance of new developments.

#### 3.1 Impact Classification Discussion

BRE guidance in Appendix H (BRE Guide 3<sup>rd</sup> Edition) – Environmental Impact Assessment suggests impact classifications as minor, moderate and major adverse. It provides further classifications of these impacts with respect to criteria summarised in the table below.

Where the loss of skylight or sunlight fully meets the guidelines in the BRE guide (3<sup>rd</sup> Edition), the impact is assessed as negligible or minor adverse. Where the loss of skylight or sunlight does not meet the BRE guidelines, the impact is assessed as minor, moderate or major adverse.

Impact	Description
<i>Negligible adverse impact</i>	<ul style="list-style-type: none"> <li>• <i>Loss of light well within guidelines, or</i></li> <li>• <i>only a small number of windows losing light (within the guidelines) or limited area of open space losing light (within the guidelines)</i></li> </ul>
<i>Minor adverse impact (a)</i>	<ul style="list-style-type: none"> <li>• <i>Loss of light only just within guidelines and</i> <ul style="list-style-type: none"> <li>○ <i>a larger number of windows are affected or</i></li> <li>○ <i>larger area of open space is affected (within the guidelines)</i></li> </ul> </li> </ul>
<i>Minor adverse impact (b)</i>	<ul style="list-style-type: none"> <li>• <i>only a small number of windows or limited open space areas are affected</i></li> <li>• <i>the loss of light is only marginally outside the guidelines</i></li> <li>• <i>an affected room has other sources of skylight or sunlight</i></li> <li>• <i>the affected building or open space only has a low-level requirement for skylight or sunlight</i></li> <li>• <i>there are particular reasons why an alternative, less stringent, guideline should be applied</i></li> </ul>
<i>Major adverse impact</i>	<ul style="list-style-type: none"> <li>• <i>large number of windows or large open space areas are affected</i></li> <li>• <i>the loss of light is substantially outside the guidelines</i></li> <li>• <i>all the windows in a particular property are affected</i></li> <li>• <i>the affected indoor or outdoor spaces have a particularly strong requirement for skylight or sunlight (living rooms / playground)</i></li> </ul>

## 4 Methodology

### 4.1 Planning Authority Guidelines

The Sustainable Urban Housing: Design Standards for New Apartments 2023 states the following in Section 6.6:

*“Planning authorities should avail of appropriate expert advice where necessary and have regard to quantitative performance approaches to daylight provision outlined in guides like A New European Standard for Daylighting in Buildings IS EN17037:2018, UK National Annex BS EN17037:2018 and the associated BRE guide 209 2022 Edition (June 2022) or any relevant future standards or guidance specific to the Irish context, when undertaken by development proposers which offer the capability to satisfy minimum standards of daylight provision.”*

In addition to this, the Sustainable and Compact Settlements Guidelines states the following in Section 5.3.7-point b:

*“In cases where a technical assessment of daylight performance is considered by the planning authority to be necessary regard should be had to quantitative performance approaches to daylight provision outlined in guides like A New European Standard for Daylighting in Buildings IS EN17037:2018, UK National Annex BS EN17037:2019 and the associated BRE Guide 209 2022 Edition (June 2022), or any relevant future standards or guidance specific to the Irish context.”*

With regards to daylighting and external sunlight exposure in particular, where different methodologies are found in each of the different standards, all methodologies have been employed for completeness to ensure appropriate and reasonable regard has been taken to address all assessments under all of the different standards. For clarity these are listed below and the following Section 1.2 denotes which standard is applicable for each assessment type:

- BRE Guide –3<sup>rd</sup> Edition of BR 209 BRE Site Layout Planning for Daylight and Sunlight
- IS EN 17037-2018+A1-2021 – Daylight in Buildings
  - This is the Irish implementation of the European EN 17037-2018+A1-2021 standard
- BS EN 17037-2018+A1-2021 – Daylight in Buildings
  - This is the UK implementation of the European EN 17037-2018+A1-2021 standard. It supersedes BS 8206-2:2008 which is withdrawn in the UK. The BS EN standard includes a National Annex which addresses daylight requirements specific to dwellings which is notable as Ireland’s climate matches closely with the UK.

Furthermore, the EN 17037-2018+A1-2021 standard has already been adopted in the UK to inform the BS EN 17037-2018+A1-2021 standard which supersedes BS 8206-2:2008 which is now withdrawn. It is important to note that BS EN 17037-2018+A1-2021 includes a National Annex which specifically addresses daylight provision in residential dwellings in the UK. A similar annex is not included in the IS EN 17037-2018+A1-2021 standard.

Finally, the latest BRE guide ‘Site Layout Planning for Daylight and Sunlight’ (3<sup>rd</sup> Edition) has just been published (June 2022). This now directly links to the new daylighting standards EN 17037-2018+A1-

2021. Aside refinements to the BRE guide, the assessments are the same to what is found within the BRE guide 2<sup>nd</sup> Edition.

Therefore, with regards to interior daylighting and external sunlight exposure in particular, where different methodologies are found in each of the different standards, all have been carried out for completeness to ensure appropriate and reasonable regard has been taken to address all assessments under all of the different standards.

## 4.2 Reference Standards & Summary of Assessments Undertaken

The various daylight and sunlight assessments that were undertaken using the IES VE software are based on a number of different standards which are referenced in the individual sections of this report. For clarity, the assessments that were undertaken are summarised below as well as the reference standards that were used for each (where applicable):

- **Shadow Analysis**
  - Assessed using shadow images cast at key times throughout the year, i.e. March 21<sup>st</sup>, June 21<sup>st</sup> and December 21<sup>st</sup> to determine if any overshadowing impact occurs and to what extent to any existing residential neighbouring buildings in accordance with the BRE Guide (3<sup>rd</sup> Edition).
- **Sunlight to Amenity Spaces**
  - Assessed using annual Solar Exposure calculations to determine any impact to existing amenities and the sunlight received and also to assess the proposed developments amenity spaces to derive how much sunlight they can expect to receive in accordance with the BRE Guide (3<sup>rd</sup> Edition).
- **Sunlight to Existing Buildings**
  - Assessed using the Annual Probable Sunlight Hours (APSH) method in accordance with the BRE Guide (3<sup>rd</sup> Edition) - to determine any impact to sunlight received to the existing neighbouring building main living areas.
- **Sunlight to Proposed Buildings**
  - Assessed using Solar Exposure calculations in accordance with IS/BS EN 17037-2018+A1-2021 (BRE Guide 3<sup>rd</sup> Edition)
  - In both assessments above the aim is to derive how much sunlight proposed development can expect to receive.
- **Daylight to Existing Buildings**
  - Assessed using the Vertical Sky Component (VSC) method in accordance with the BRE Guide (3<sup>rd</sup> Edition) - to determine any impact to existing daylight received to the existing building neighbouring the site.
- **Daylight to Proposed Development**
  - Assessed in accordance with IS EN 17037-2018+A1-2021 Method 2 (BRE Guide 3<sup>rd</sup> Edition)
  - Assessed in accordance with BS EN 17037-2018+A1-2021 National Annex Method 2 (BRE Guide 3<sup>rd</sup> Edition)
  - In all assessments above the aim is to derive how much daylight will be received within each of the houses and apartments within the proposed development.
- **View Out**
  - Assessed in accordance with IS EN 17037-2018+A1-2021 (BRE Guide 3<sup>rd</sup> Edition)



- **Glare**
  - Assessed in accordance with IS EN 17037-2018+A1-2021 (BRE Guide 3<sup>rd</sup> Edition)





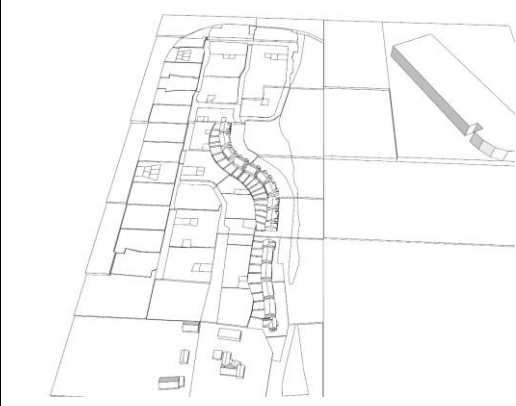

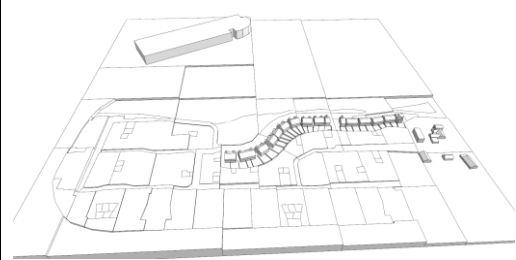
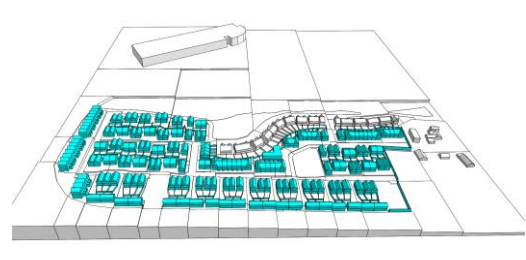
### 4.3 Orientation

The model orientation has been taken from drawings provided by the Architect with the resulting angle shown below used in the analysis.

Orientation		
		
		

#### 4.4 Proposed Model

The following images illustrate the models created from the architectural information provided and the use of Google/Bing maps where information was absent.

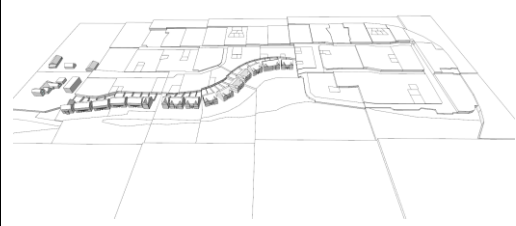	Existing / Permitted Situation	Proposed Scheme
View looking from North of Site		
View looking from East of Site		
View looking from South of Site		
View looking from West of Site		



#### 4.5 Potential Sensitive Receptors

To help understand the potential impact to surrounding buildings, potential sensitive receptors were identified as illustrated below.



## 5 Shadow Analysis

The statistics of Met Eireann, the Irish Meteorological Service, show that the sunniest months in Ireland are May and June, based on 1981-2010 averages or latest:

<https://www.met.ie/climate/30-year-averages>.

The following can also be shown:

- During December a mean daily duration of 1.7 hours of sunlight out of a potential 7.3 hours sunlight each day is received (i.e. only 23% of potential sunlight hours).
- During June a mean daily duration of 5.8 hours of sunlight out of a potential 15.9 hours sunlight each day is received (i.e. only 36% of potential sunlight hours).

Therefore, the impacts caused by overshadowing are generally most noticeable during the summer months and least noticeable during the winter months.

This section will consider the shadows cast by the proposed development on the following dates:


- March 21<sup>st</sup> / September 21<sup>st</sup> (Equinox)
- June 21<sup>st</sup> (Summer Solstice)
- December 21<sup>st</sup> (Winter Solstice)


These images illustrate shadows cast for 'perfect sunny' conditions with no clouds and assumed that the sun is shining for every hour shown. Given the discussion above it is important to remember that this is not always going to be the case.




## 5.1 Plan View


### 5.1.1 March 21<sup>st</sup>

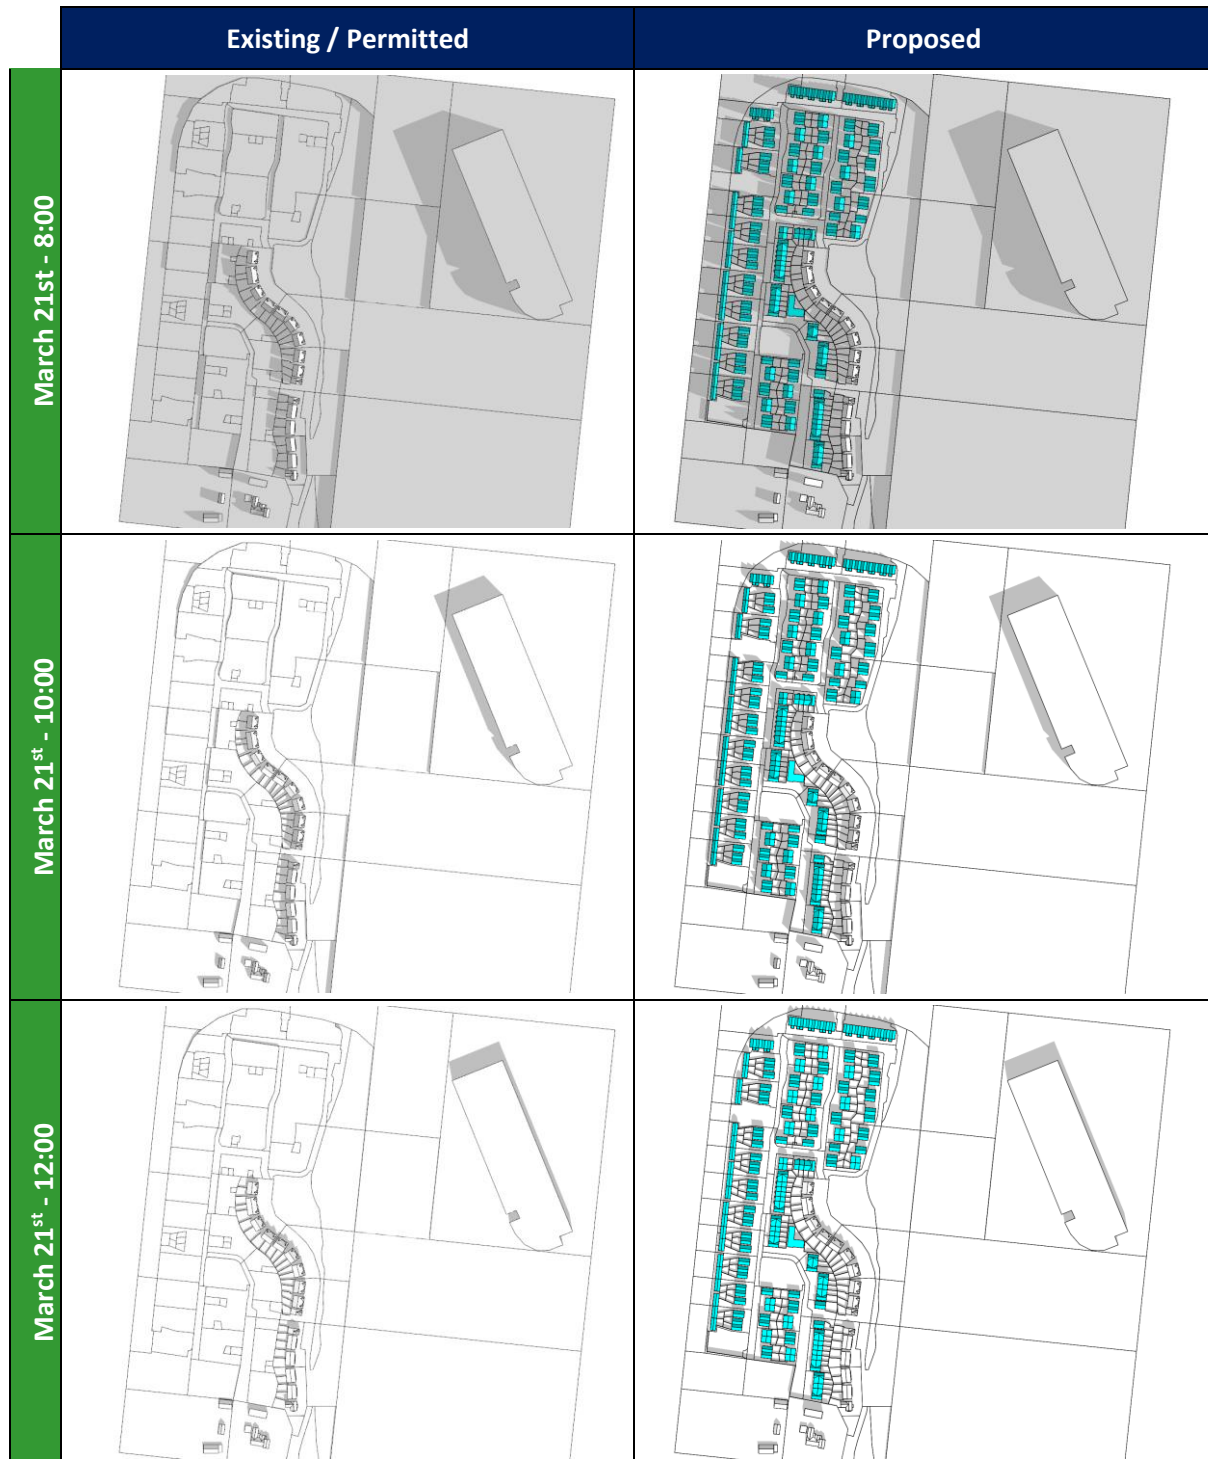

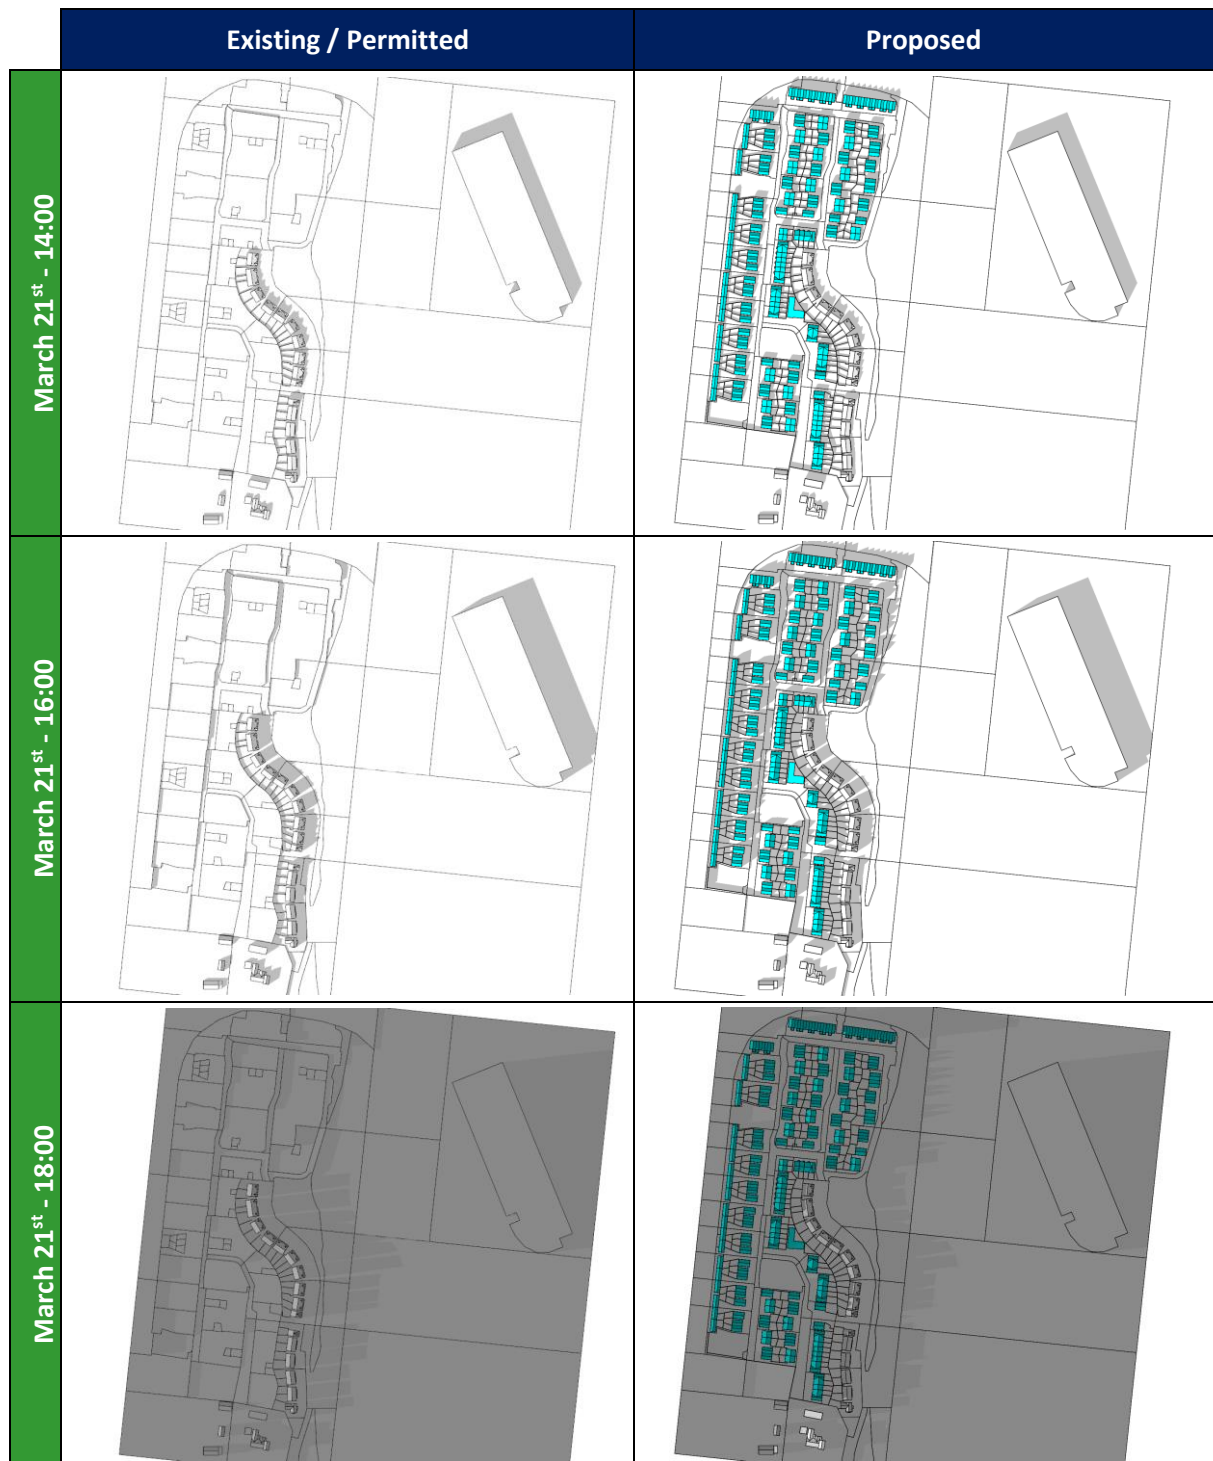

### 5.1.2 June 21<sup>st</sup>

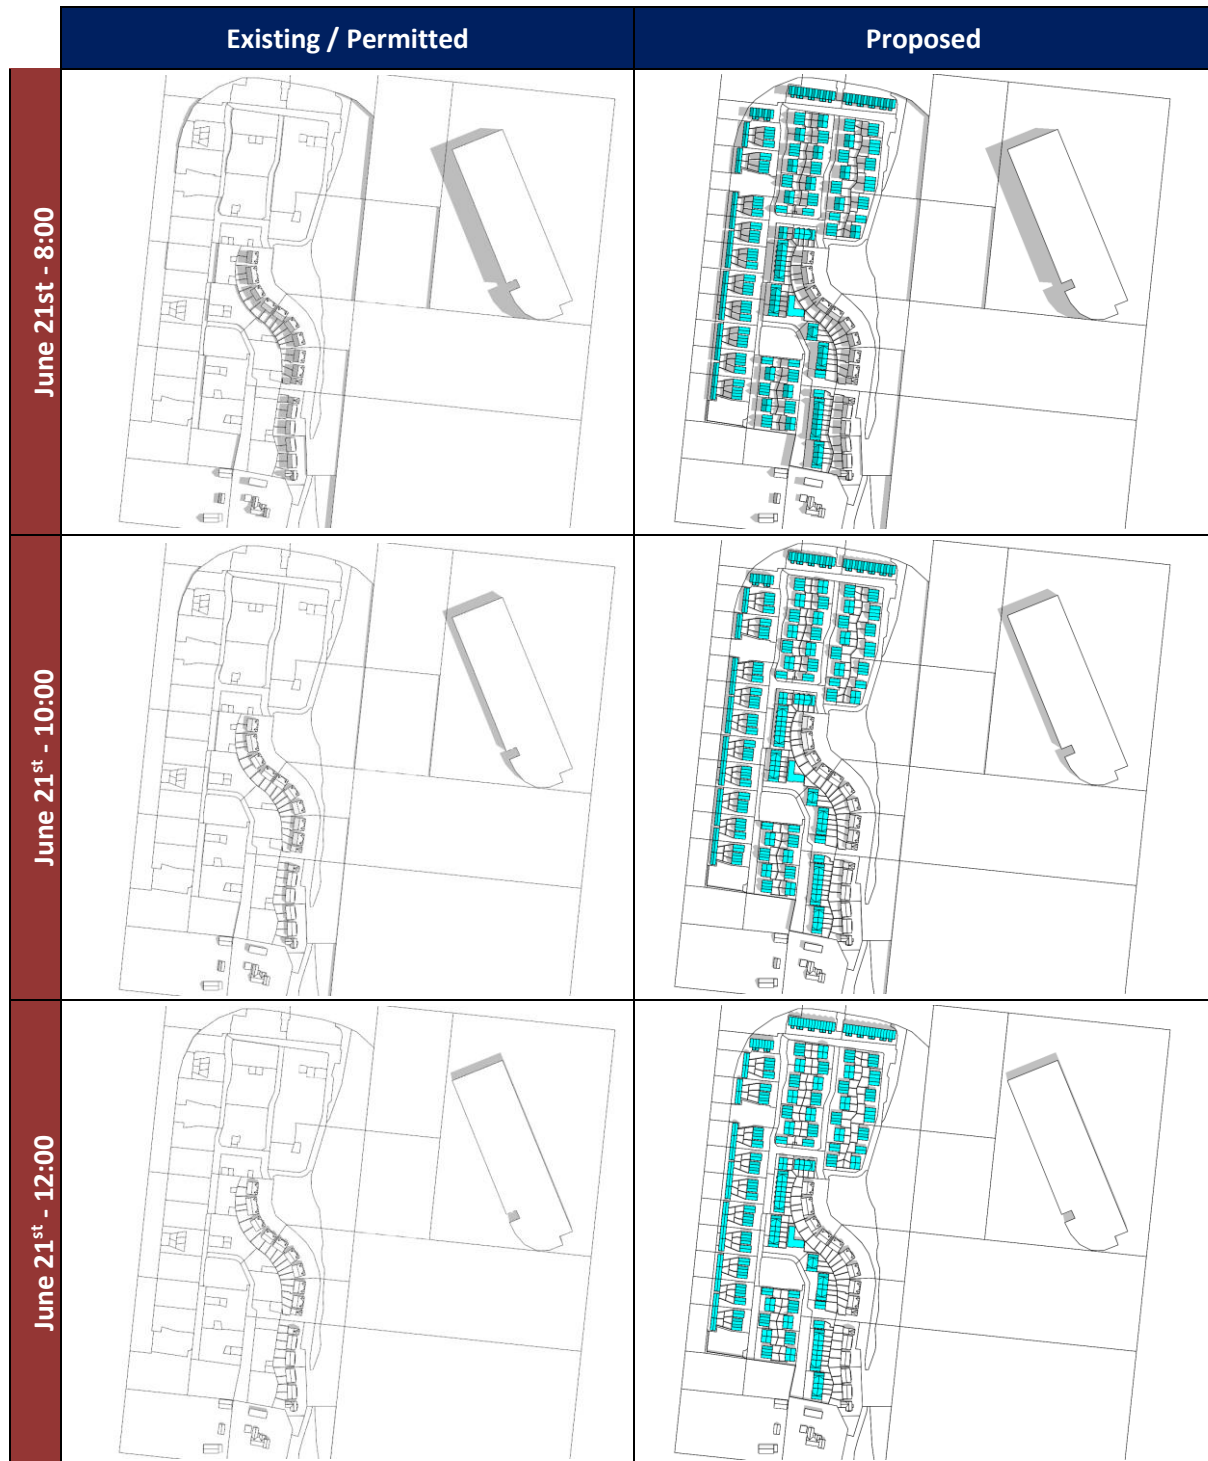


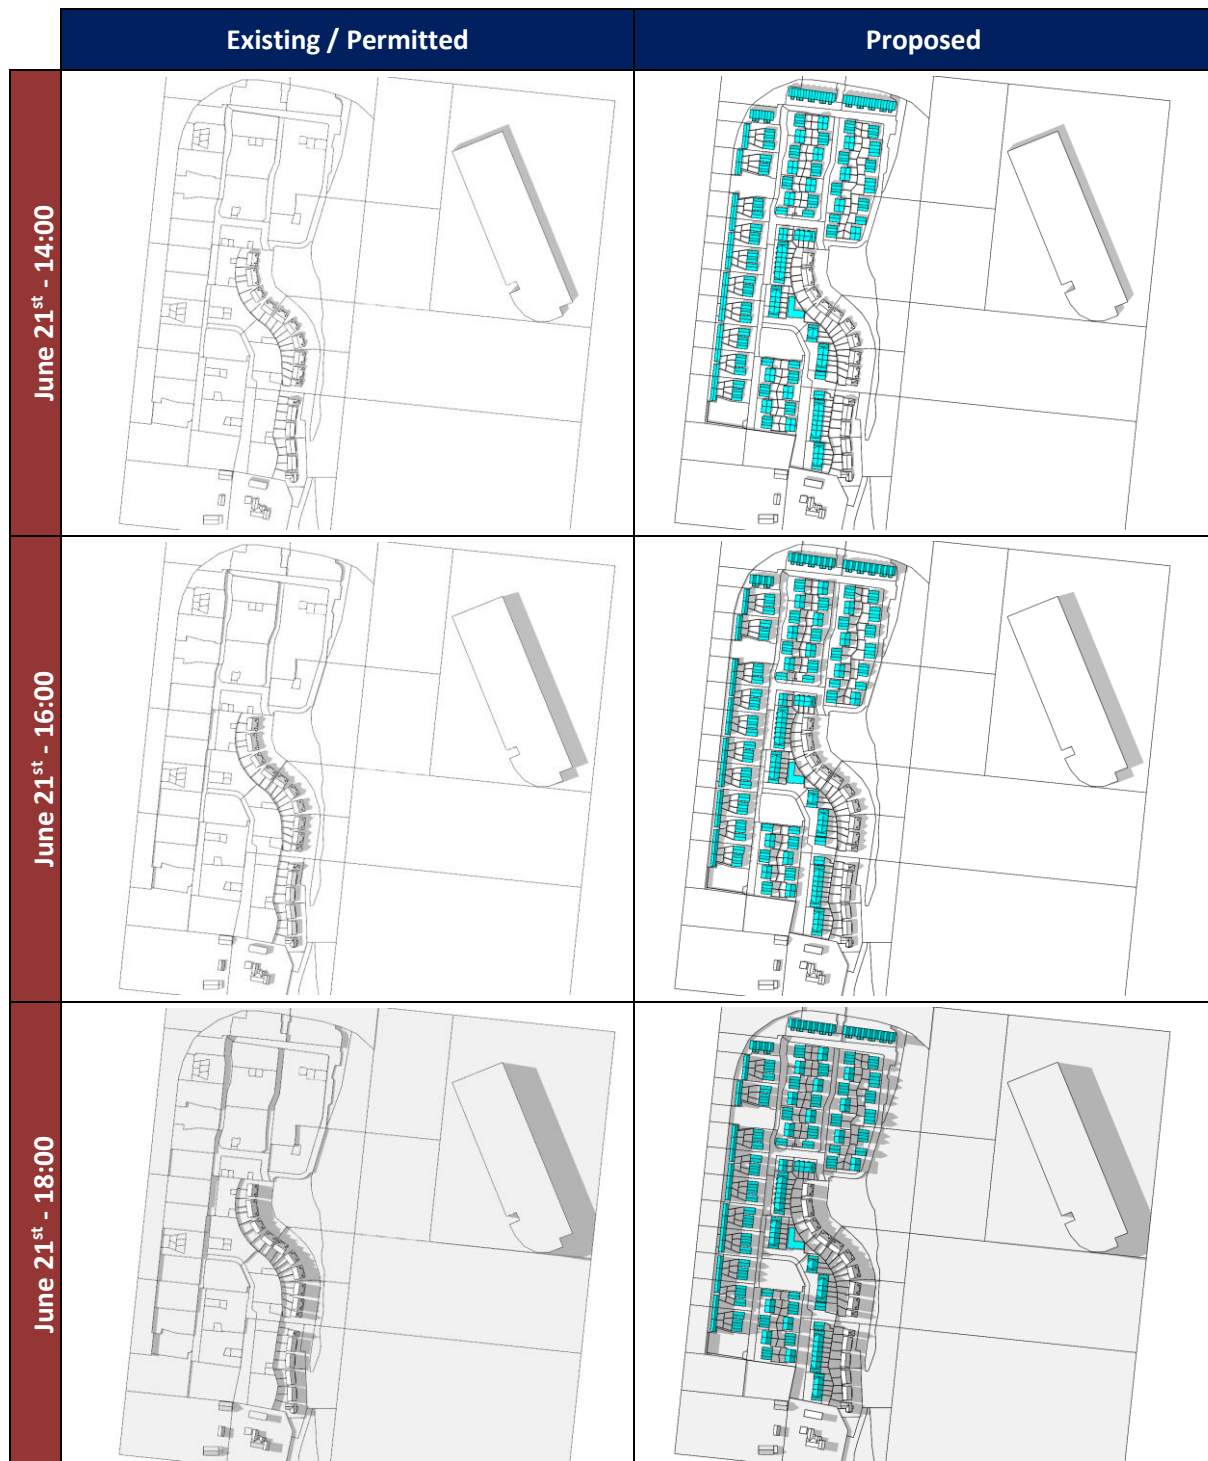






### 5.1.3 December 21<sup>st</sup>

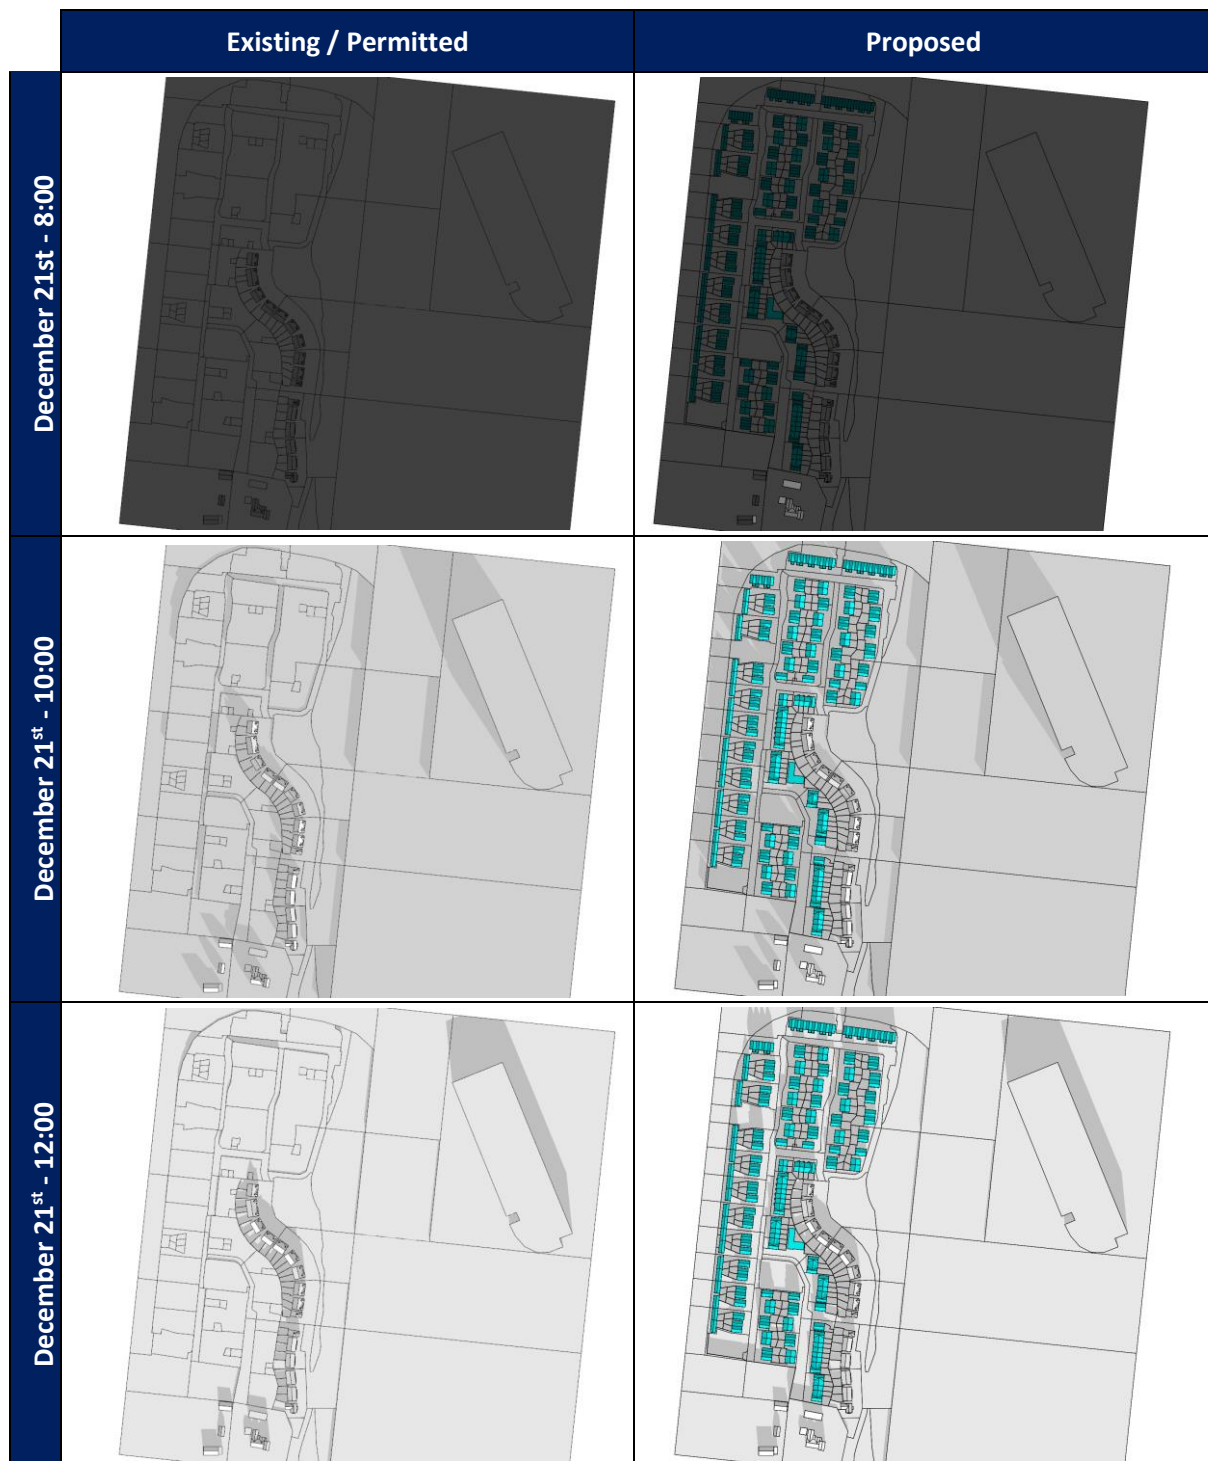

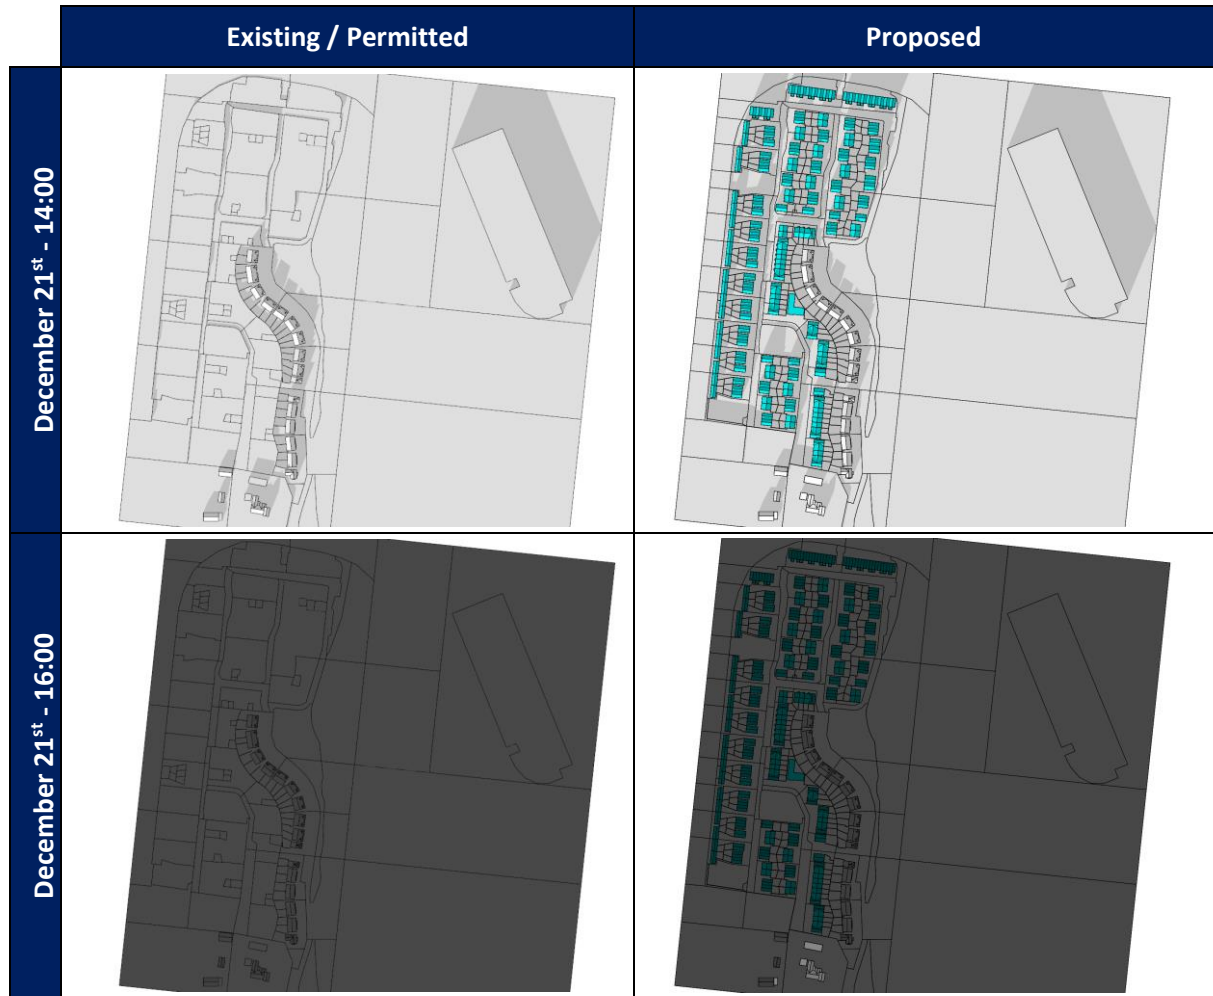



## 5.2 3D View

### 5.2.1 March 21<sup>st</sup>

	Existing / Permitted	Proposed
March 21 <sup>st</sup> - 8:00		
March 21 <sup>st</sup> - 10:00		
March 21 <sup>st</sup> - 12:00		
March 21 <sup>st</sup> - 14:00		
March 21 <sup>st</sup> - 16:00		



	Existing / Permitted	Proposed
March 21 <sup>st</sup> - 18:00		

### 5.2.2 June 21<sup>st</sup>

	Existing / Permitted	Proposed
June 21 <sup>st</sup> - 8:00		
June 21 <sup>st</sup> - 10:00		
June 21 <sup>st</sup> - 12:00		
June 21 <sup>st</sup> - 14:00		
June 21 <sup>st</sup> - 16:00		

	Existing / Permitted	Proposed
June 21 <sup>st</sup> - 18:00		
June 21 <sup>st</sup> - 20:00		

### 5.2.3 December 21<sup>st</sup>

	Existing / Permitted	Proposed
December 21 <sup>st</sup> - 8:00		
December 21 <sup>st</sup> - 10:00		
December 21 <sup>st</sup> - 12:00		
December 21 <sup>st</sup> - 14:00		
December 21 <sup>st</sup> - 16:00		

### **5.3 Discussion**

The shadow analysis illustrates different shadows being cast at key times of the year (March 21<sup>st</sup>, June 21<sup>st</sup> and December 21<sup>st</sup>) for the Existing/Permitted Situation and the Proposed Scheme. The results from the study are summarised as follows:

#### **Properties on Slane Road - South**

No additional shading visible from the proposed development on these existing properties throughout the year.

The potential shading impact is quantified via the “Sunlight to Amenity Spaces” and “Daylight to Existing Buildings” sections of this report.

## 6 Sunlight to Amenity Spaces

### 6.1 Guidance Requirements

The impact of the proposed development on the sunlight availability to the amenity spaces will be considered to determine how the amenity spaces perform when assessed against the BRE Guide (3<sup>rd</sup> Edition) which states the following in Section 3.3.17:

#### Summary

3.3.17 It is recommended that for it to appear adequately sunlit throughout the year, at least half of a garden or amenity area should receive at least two hours of sunlight on 21 March. If as a result of new development an existing garden or amenity area does not meet the above, and the area that can receive two hours of sun on 21 March is less than 0.80 times its former value, then the loss of sunlight is likely to be noticeable. If a detailed calculation cannot be carried out, it is recommended that the centre of the area should receive at least two hours of sunlight on 21 March.


The BRE Guide (3<sup>rd</sup> Edition) states that for a space to appear adequately sunlit throughout the year, at least half of a garden or amenity space should receive at least 2 hours of sunlight on March 21<sup>st</sup>. In the case of existing amenity spaces, if they are already below the 50% threshold then the BRE recommends the results kept to within 80% of the existing situation.



## 6.2 Permitted and Proposed Amenity Spaces

As outlined in Section 3.3.17 of the BRE Guide (3<sup>rd</sup> Edition), for a space to appear adequately sunlit throughout the year, at least half of the garden or amenity space should receive at least 2 hours of sunlight on March 21<sup>st</sup>. In the case of existing amenity spaces, if they are already below the 50% threshold then the BRE recommends the results kept to within 80% of the existing situation with the proposed development in place.

This analysis will be performed on the amenity spaces illustrated in the image below.

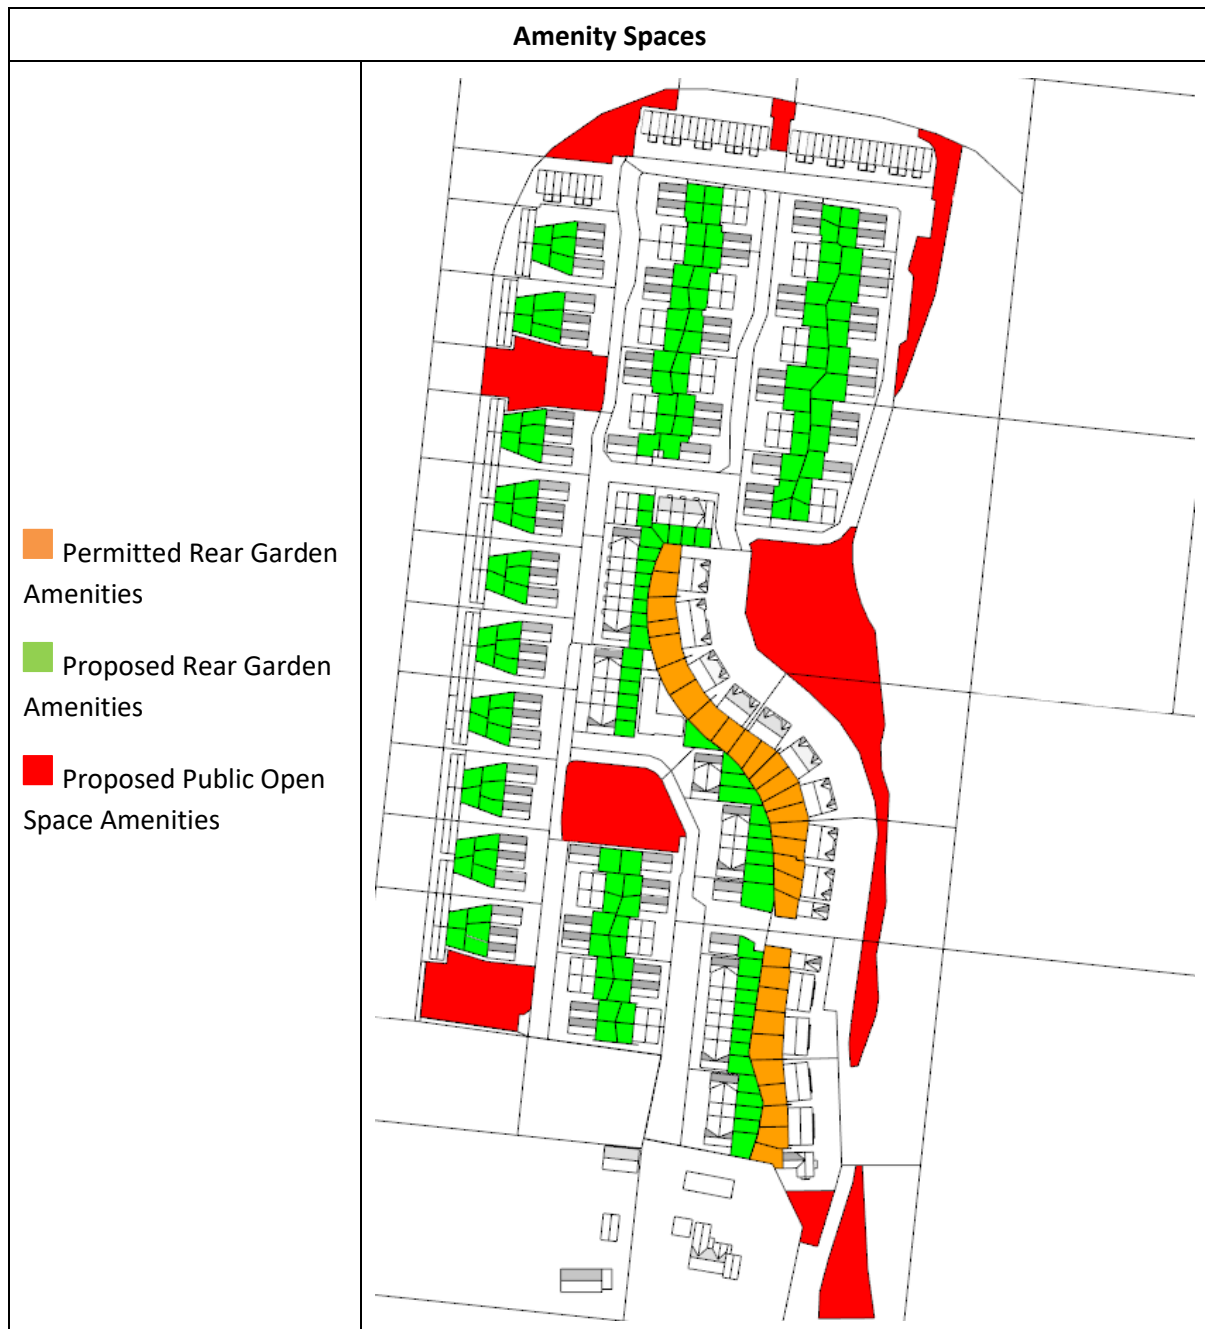

The following images illustrate the predicted results with respect to this space receiving at least 2 hours of sunlight on March 21<sup>st</sup>. Any areas that receive less than 2 hours of sunlight are colour-coded in grey.


### 6.3 Permitted Amenity Spaces

This analysis will be performed on the amenity spaces illustrated in the image below.





### 6.3.1 Permitted Amenity Space Results

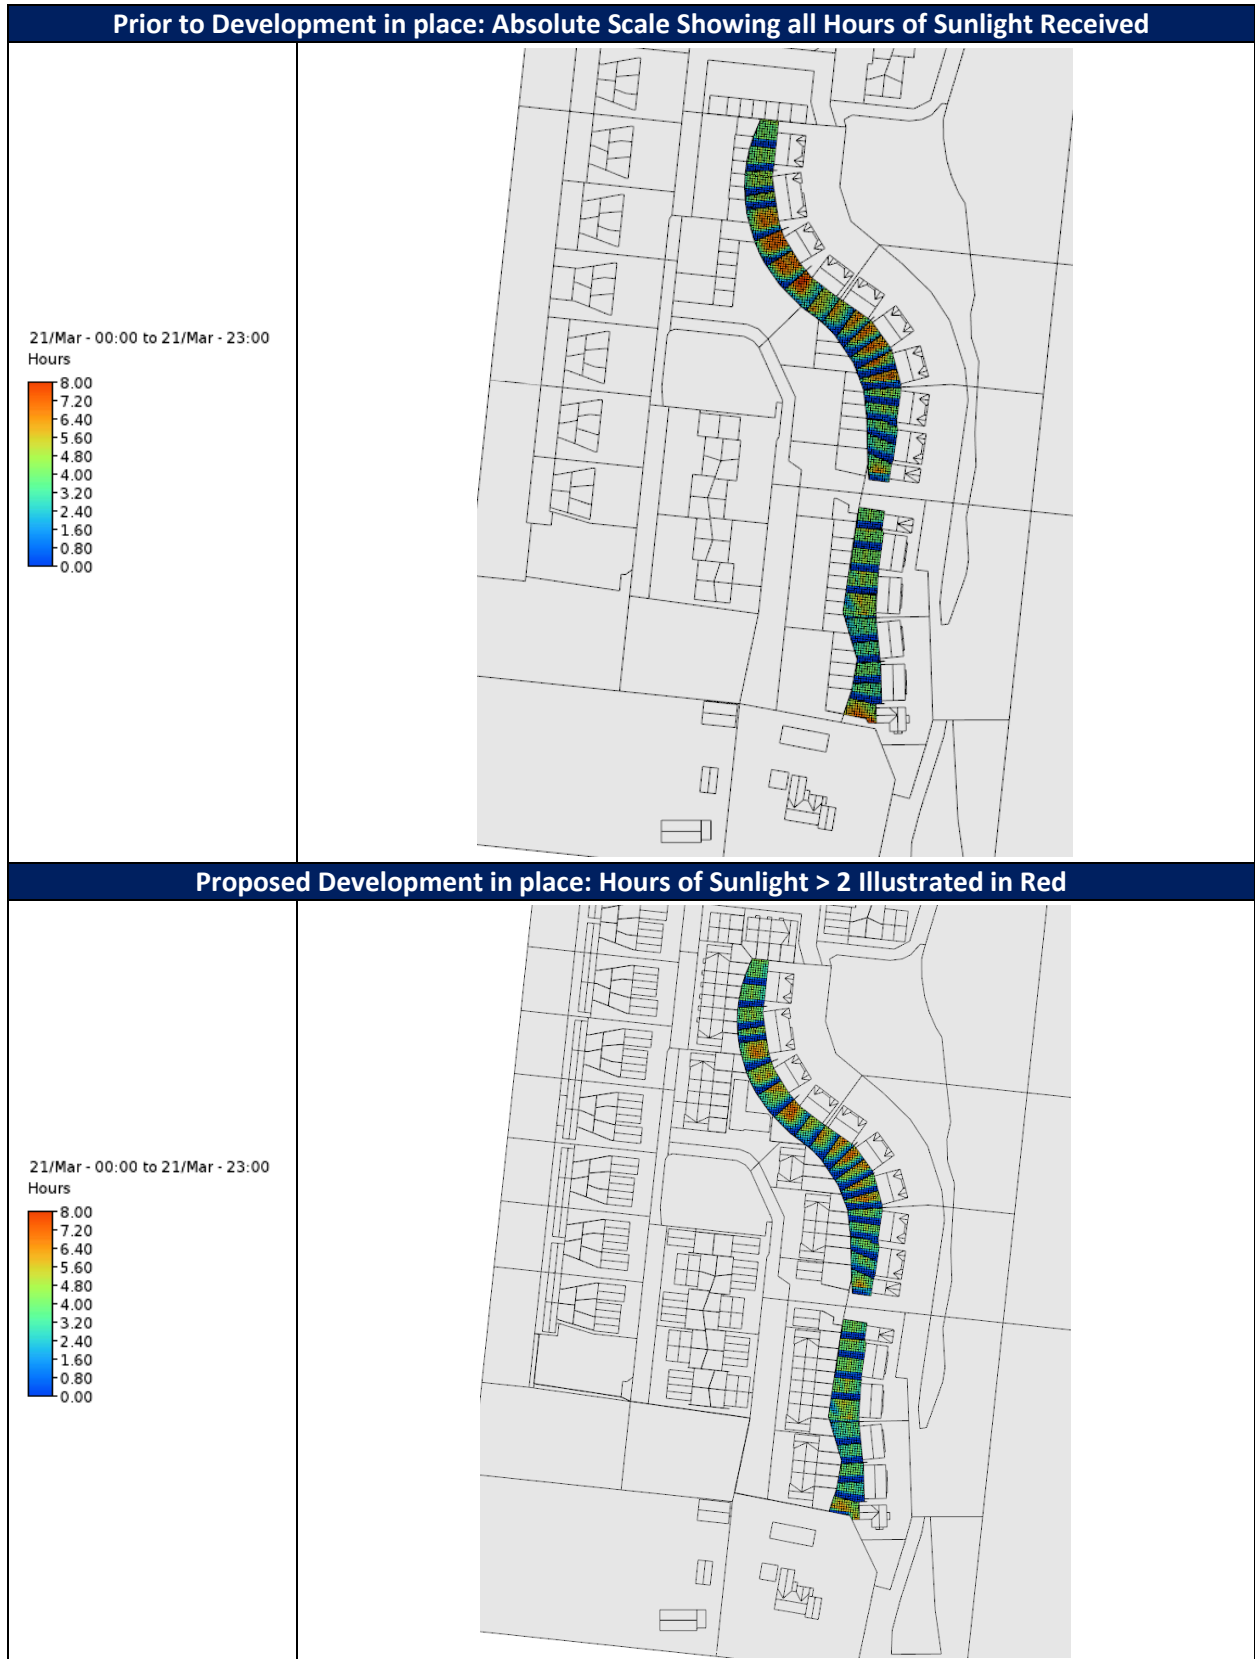

**Prior to Development in place: Absolute Scale Showing all Hours of Sunlight Received**

- Receives more than 2 hours of sunlight
- Receives less than 2 hours of sunlight




**Proposed Development in place: Hours of Sunlight > 2 Illustrated in Red**

- Receives more than 2 hours of sunlight
- Receives less than 2 hours of sunlight



### 6.3.2 Permitted Amenity Results

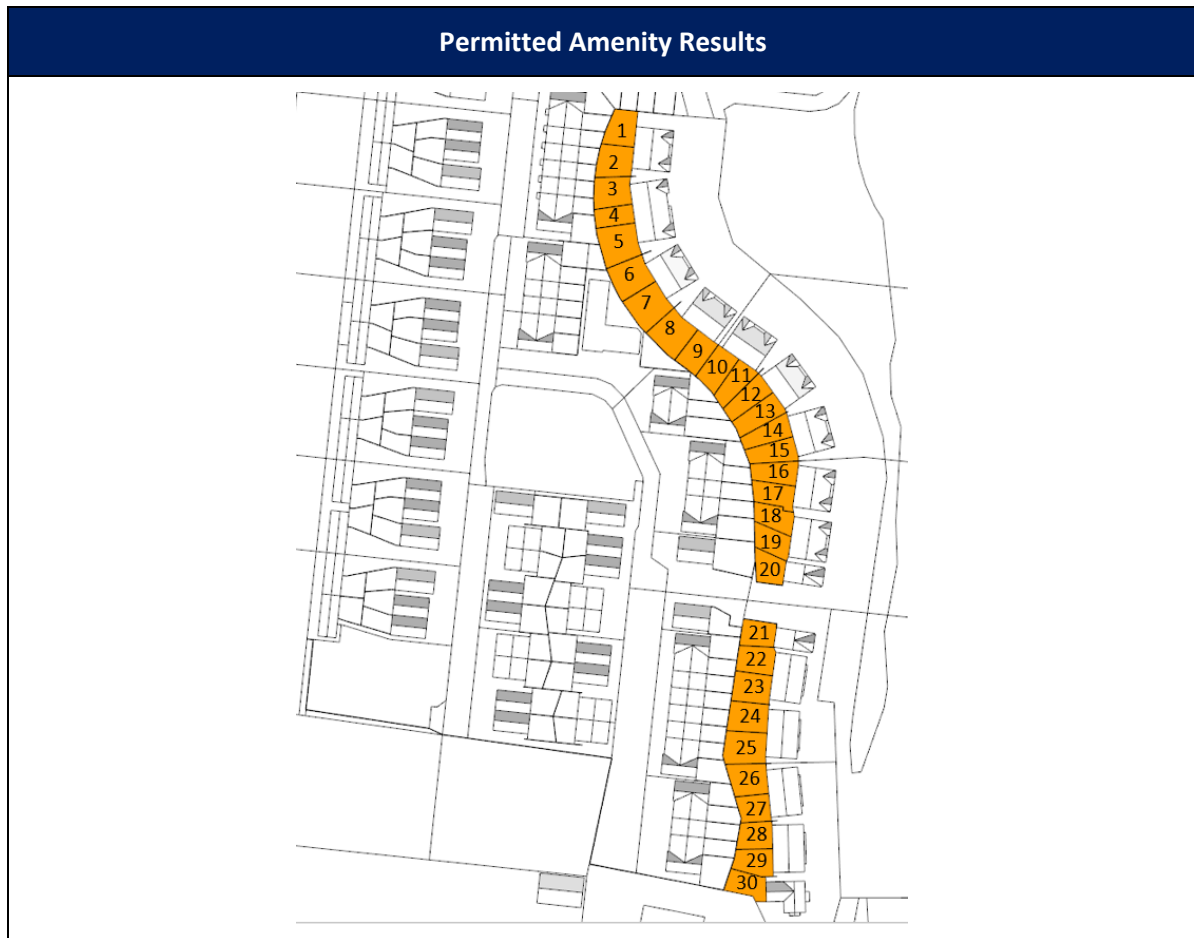


Ref	Area (m <sup>2</sup> )	Existing Area >2 hrs		Existing Area with Proposed Development in Place >2 hrs		Proposed vs Existing (%)	Comment
		(m <sup>2</sup> )	(%)	(m <sup>2</sup> )	(%)		
1	90	63	70%	63	70%	100%	✓
2	98	71	72%	71	72%	100%	✓
3	98	73	74%	73	74%	100%	✓
4	66	38	58%	38	58%	100%	✓
5	125	103	82%	103	82%	100%	✓
6	113	97	86%	90	79%	93%	✓
7	120	105	88%	88	73%	83%	✓
8	119	102	86%	98	82%	96%	✓
9	89	83	93%	69	78%	83%	✓
10	93	66	71%	66	71%	100%	✓
11	83	62	75%	62	75%	100%	✓
12	87	62	71%	62	71%	100%	✓
13	96	70	73%	70	73%	100%	✓
14	86	55	64%	55	64%	100%	✓
15	89	57	64%	57	64%	100%	✓




Ref	Area (m <sup>2</sup> )	Existing Area >2 hrs		Existing Area with Proposed Development in Place >2 hrs		Proposed vs Existing (%)	Comment
		(m <sup>2</sup> )	(%)	(m <sup>2</sup> )	(%)		
16	84	45	54%	45	54%	100%	✓
17	84	55	65%	55	65%	100%	✓
18	79	48	61%	48	61%	100%	✓
19	80	55	69%	55	69%	100%	✓
20	77	62	81%	62	81%	100%	✓
21	77	51	66%	51	66%	100%	✓
22	89	56	63%	56	63%	100%	✓
23	98	65	66%	65	66%	100%	✓
24	103	75	73%	75	73%	100%	✓
25	117	110	94%	110	94%	100%	✓
26	105	76	72%	76	72%	100%	✓
27	76	56	74%	56	74%	100%	✓
28	80	56	70%	56	70%	100%	✓
29	88	59	67%	59	67%	100%	✓
30	80	80	100%	80	100%	100%	✓

### 6.4 Proposed Amenity Spaces

This analysis will be performed on the amenity spaces illustrated in the image below.

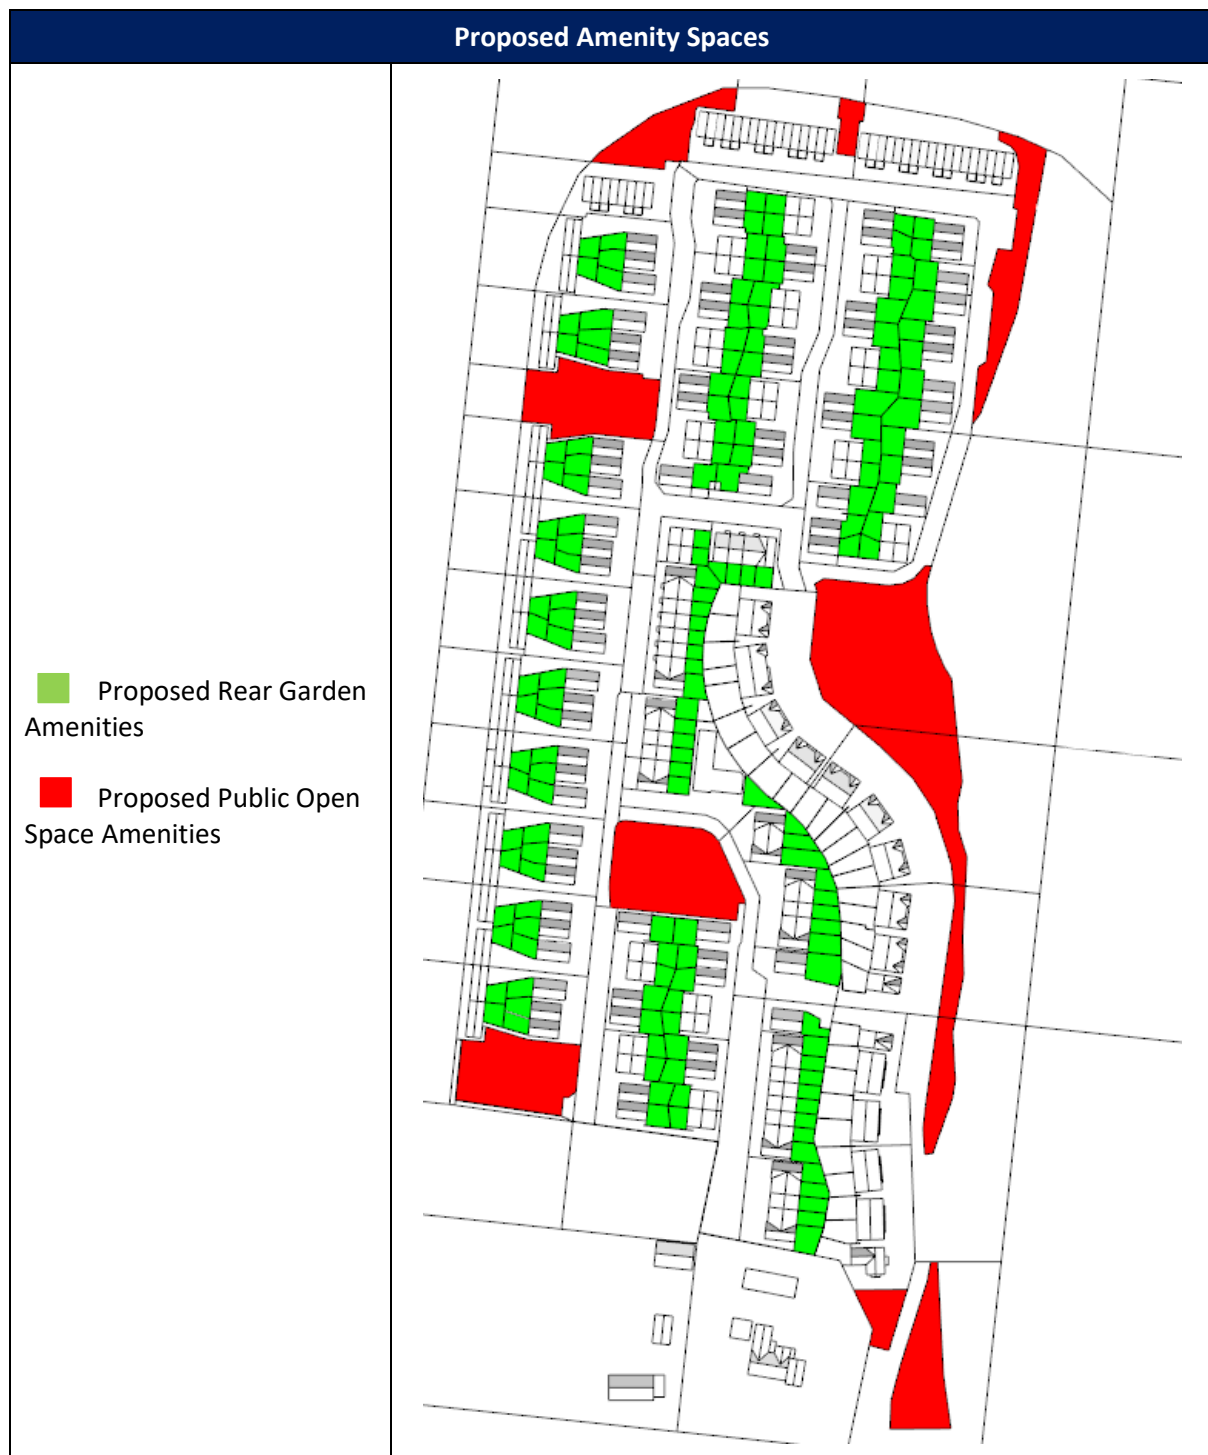


### 6.4.1 Proposed Public Open Space Amenity Space Results

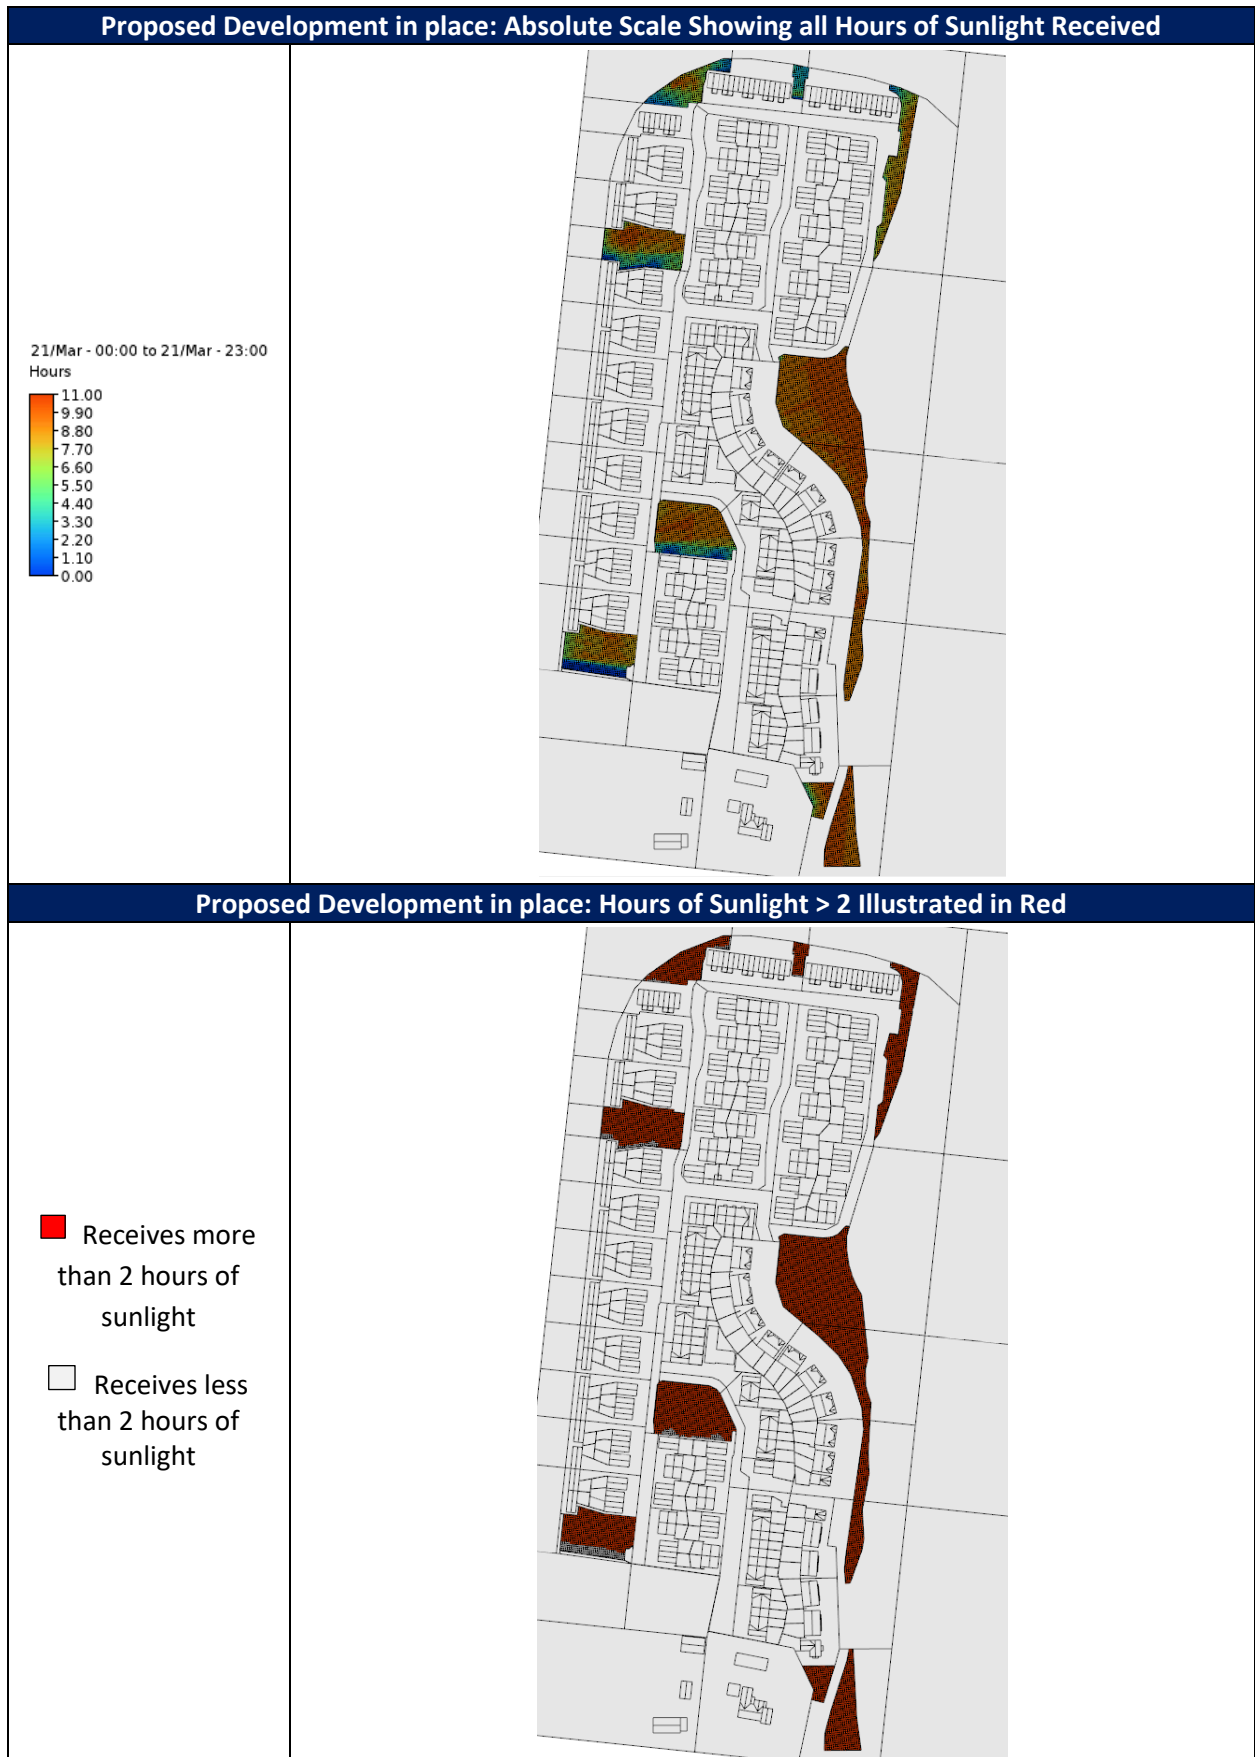




### 6.4.2 Proposed Rear Garden Space Results

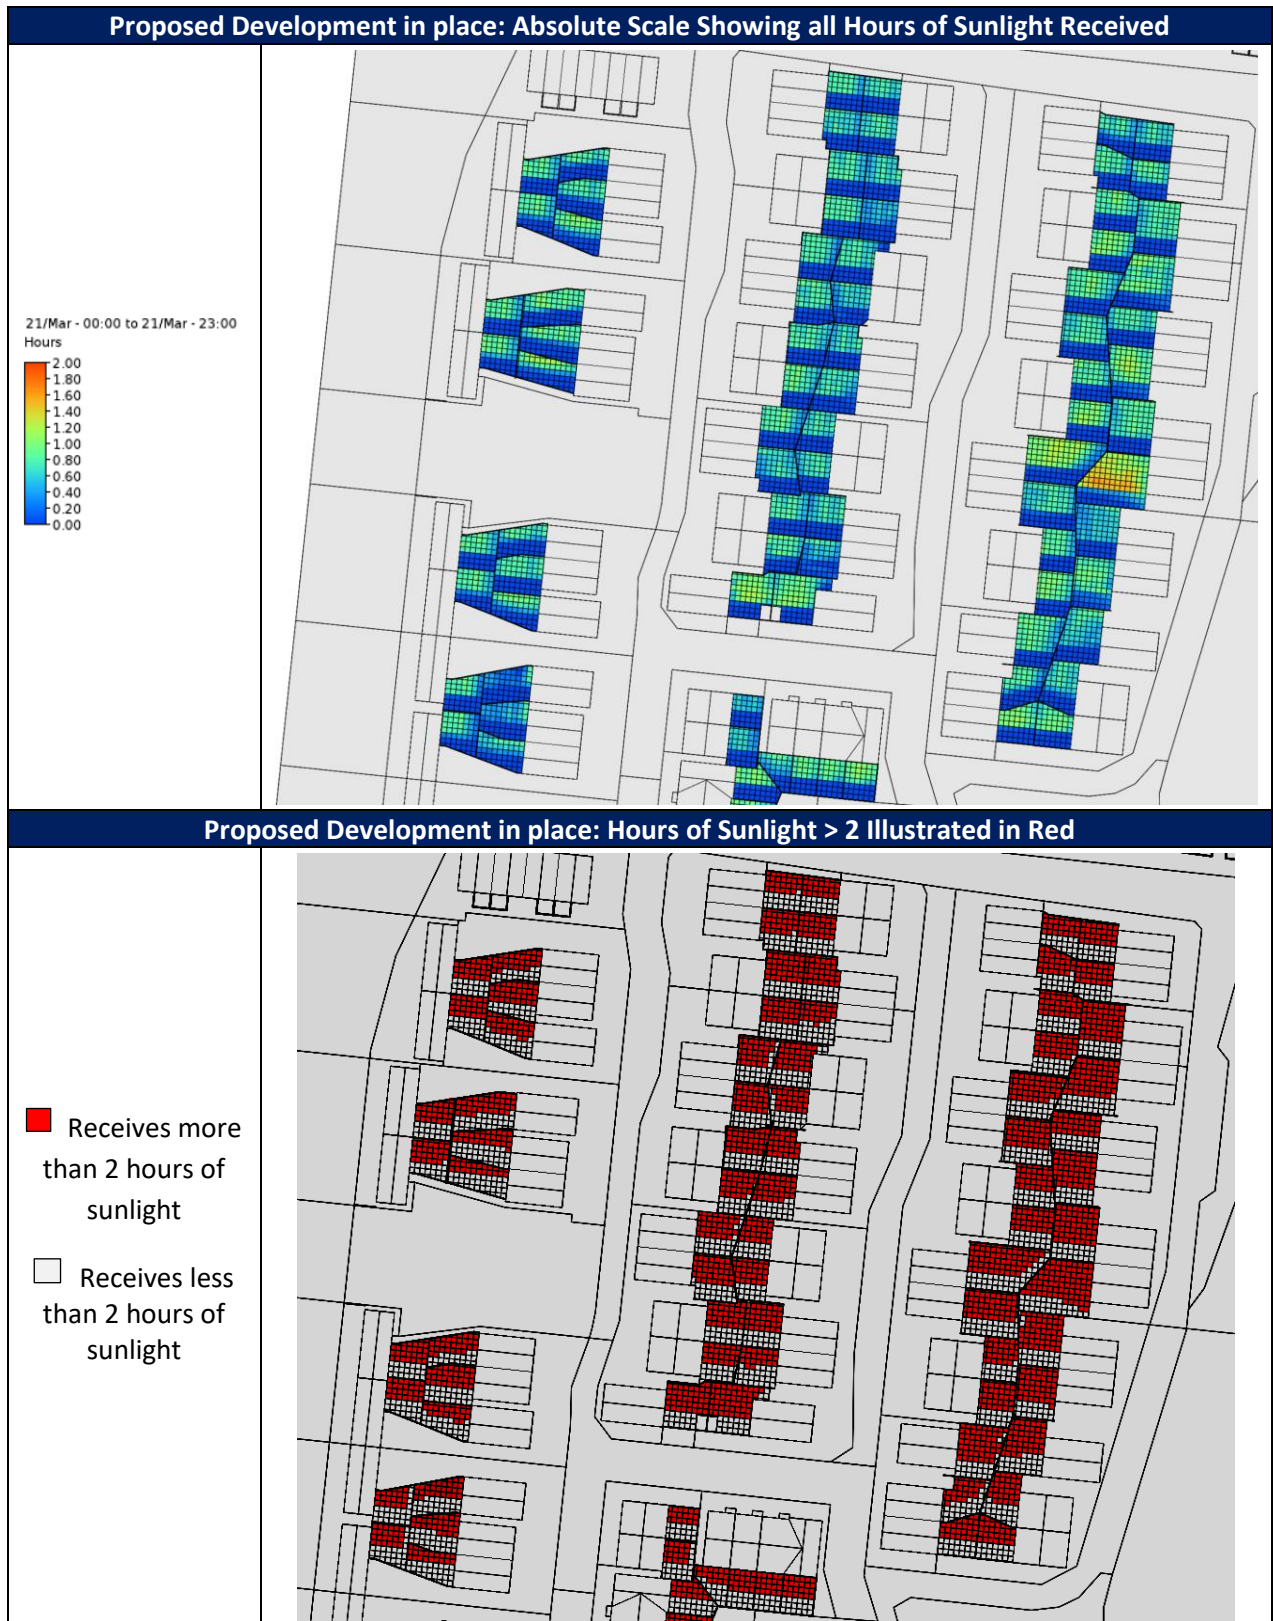



**Proposed Development in place: Absolute Scale Showing all Hours of Sunlight Received**

21/Mar - 00:00 to 21/Mar - 23:00  
Hours




**Proposed Development in place: Hours of Sunlight > 2 Illustrated in Red**

-  Receives more than 2 hours of sunlight
-  Receives less than 2 hours of sunlight





### 6.4.3 Proposed Public Amenity Results

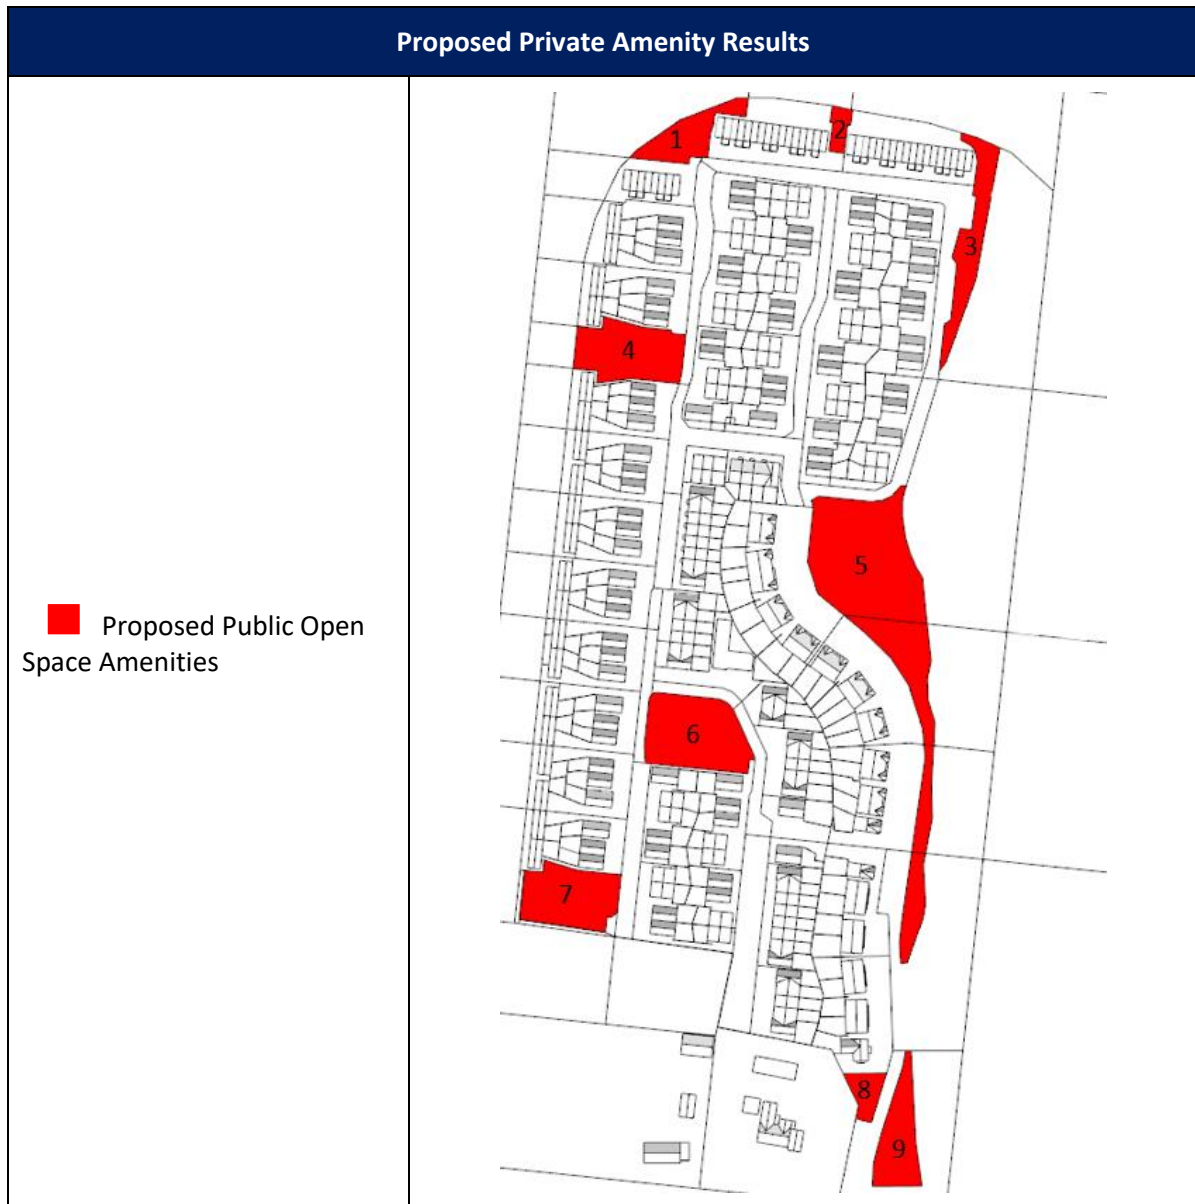

Ref	Total Area (m <sup>2</sup> )	Area Receiving >2h (m <sup>2</sup> )	Percent Receiving >2h	Comment
1	564	530	94%	✓
2	141	133	94%	✓
3	747	743	99%	✓
4	1,030	972	94%	✓
5	3,428	3,428	100%	✓
6	1,260	1,210	96%	✓
7	990	816	82%	✓
8	230	230	100%	✓
9	696	696	100%	✓
<b>Total</b>	<b>9,086</b>	<b>8,758</b>	<b>96%</b>	✓

### 6.4.4 Proposed Rear Garden Amenity Results



Ref	Total Area (m <sup>2</sup> )	Minimum Area Required (m <sup>2</sup> )	Area Receiving >2h (m <sup>2</sup> )	Percent Receiving >2h above the total area	Comment	Percent Receiving >2h above the min. area required	Comment
1	49	40	26	53%	✓	65%	✓
2	50	40	31	62%	✓	78%	✓
3	49	40	27	55%	✓	68%	✓
4	50	40	33	66%	✓	83%	✓
5	49	40	27	55%	✓	68%	✓
6	50	40	31	62%	✓	78%	✓
7	44	40	22	50%	✓	55%	✓
8	53	40	29	55%	✓	73%	✓
9	48	40	24	50%	✓	60%	✓
10	59	40	30	51%	✓	75%	✓
11	57	50	29	51%	✓	58%	✓
12	51	50	29	57%	✓	58%	✓
13	63	40	34	54%	✓	85%	✓
14	50	40	26	52%	✓	65%	✓
15	60	40	30	50%	✓	75%	✓
16	68	40	38	56%	✓	95%	✓
17	74	50	37	50%	✓	74%	✓
18	56	50	30	54%	✓	60%	✓
19	60	40	35	58%	✓	88%	✓
20	49	40	25	51%	✓	63%	✓
21	46	40	24	52%	✓	60%	✓
22	52	40	31	60%	✓	78%	✓
23	61	40	39	64%	✓	98%	✓
24	55	40	33	60%	✓	83%	✓
25	58	40	35	60%	✓	88%	✓
26	57	40	35	61%	✓	88%	✓
27	60	40	37	62%	✓	93%	✓
28	52	40	33	63%	✓	83%	✓
29	60	40	39	65%	✓	98%	✓
30	64	40	40	63%	✓	100%	✓
31	56	40	34	61%	✓	85%	✓
32	48	40	32	67%	✓	80%	✓
33	63	50	44	70%	✓	88%	✓
34	74	50	54	73%	✓	100%	✓
35	53	40	25	47%	X	63%	✓
36	57	40	34	60%	✓	85%	✓
37	47	40	29	62%	✓	73%	✓
38	48	40	28	58%	✓	70%	✓
39	66	40	40	61%	✓	100%	✓
40	51	40	31	61%	✓	78%	✓
41	54	40	32	59%	✓	80%	✓
42	65	40	41	63%	✓	100%	✓
43	52	40	26	50%	✓	65%	✓
44	55	40	33	60%	✓	83%	✓
45	53	40	30	57%	✓	75%	✓
46	45	40	24	53%	✓	60%	✓
47	45	40	23	51%	✓	58%	✓
48	50	40	28	56%	✓	70%	✓

Ref	Total Area (m <sup>2</sup> )	Minimum Area Required (m <sup>2</sup> )	Area Receiving >2h (m <sup>2</sup> )	Percent Receiving >2h above the total area	Comment	Percent Receiving >2h above the min. area required	Comment
49	60	40	35	58%	✓	88%	✓
50	60	40	39	65%	✓	98%	✓
51	78	40	52	67%	✓	100%	✓
52	75	40	49	65%	✓	100%	✓
53	55	40	32	58%	✓	80%	✓
54	60	40	35	58%	✓	88%	✓
55	109	40	66	61%	✓	100%	✓
56	86	40	57	66%	✓	100%	✓
57	52	40	32	62%	✓	80%	✓
58	56	40	37	66%	✓	93%	✓
59	78	50	56	72%	✓	100%	✓
60	52	40	29	56%	✓	73%	✓
61	50	40	29	58%	✓	73%	✓
62	52	40	31	60%	✓	78%	✓
63	56	40	35	63%	✓	88%	✓
64	78	50	50	64%	✓	100%	✓
65	72	40	52	72%	✓	100%	✓
66	78	40	53	68%	✓	100%	✓
67	118	50	84	71%	✓	100%	✓
68	85	50	60	71%	✓	100%	✓
69	76	40	55	72%	✓	100%	✓
70	66	40	40	61%	✓	100%	✓
71	98	50	66	67%	✓	100%	✓
72	82	50	56	68%	✓	100%	✓
73	51	40	29	57%	✓	73%	✓
74	51	40	29	57%	✓	73%	✓
75	44	40	25	57%	✓	63%	✓
76	36	30	20	56%	✓	67%	✓
77	36	30	20	56%	✓	67%	✓
78	34	30	17	50%	✓	57%	✓
79	43	30	18	42%	X	60%	✓
80	35	30	16	46%	X	53%	✓
81	49	40	29	59%	✓	73%	✓
82	51	40	31	61%	✓	78%	✓
83	50	40	25	50%	✓	63%	✓
84	50	40	25	50%	✓	63%	✓
85	49	40	30	61%	✓	75%	✓
86	51	40	31	61%	✓	78%	✓
87	51	40	28	55%	✓	70%	✓
88	49	40	25	51%	✓	63%	✓
89	49	40	29	59%	✓	73%	✓
90	50	40	30	60%	✓	75%	✓
91	48	40	24	50%	✓	60%	✓
92	53	40	18	34%	X	45%	X
93	51	40	11	22%	X	28%	X
94	51	40	26	51%	✓	65%	✓
95	57	50	29	51%	✓	58%	✓
96	57	50	29	51%	✓	58%	✓

Ref	Total Area (m <sup>2</sup> )	Minimum Area Required (m <sup>2</sup> )	Area Receiving >2h (m <sup>2</sup> )	Percent Receiving >2h above the total area	Comment	Percent Receiving >2h above the min. area required	Comment
97	58	40	29	50%	✓	73%	✓
98	49	40	25	51%	✓	63%	✓
99	48	40	24	50%	✓	60%	✓
100	59	40	30	51%	✓	75%	✓
101	57	50	29	51%	✓	58%	✓
102	59	50	31	53%	✓	62%	✓
103	56	40	29	52%	✓	73%	✓
104	49	40	26	53%	✓	65%	✓
105	48	40	24	50%	✓	60%	✓
106	57	40	29	51%	✓	73%	✓
107	57	50	29	51%	✓	58%	✓
108	59	50	31	53%	✓	62%	✓
109	56	40	29	52%	✓	73%	✓
110	49	40	26	53%	✓	65%	✓
111	47	40	20	43%	X	50%	✓
112	40	30	16	40%	X	53%	✓
113	33	30	12	36%	X	40%	X
114	30	30	10	33%	X	33%	X
115	31	30	10	32%	X	33%	X
116	30	30	10	33%	X	33%	X
117	31	30	15	48%	X	50%	✓
118	64	40	38	59%	✓	95%	✓
119	56	40	32	57%	✓	80%	✓
120	38	30	16	42%	X	53%	✓
121	38	30	16	42%	X	53%	✓
122	38	30	15	39%	X	50%	✓
123	38	30	16	42%	X	53%	✓
124	46	40	24	52%	✓	60%	✓
125	72	50	46	64%	✓	92%	✓
126	55	40	34	62%	✓	85%	✓
127	44	40	25	57%	✓	63%	✓
128	67	40	45	67%	✓	100%	✓
129	65	40	47	72%	✓	100%	✓
130	48	40	27	56%	✓	68%	✓
131	51	40	26	51%	✓	65%	✓
132	60	40	39	65%	✓	98%	✓
133	59	40	35	59%	✓	88%	✓
134	48	40	28	58%	✓	70%	✓
135	48	40	27	56%	✓	68%	✓
136	66	40	41	62%	✓	100%	✓
137	66	40	42	64%	✓	100%	✓
138	47	40	37	79%	✓	93%	✓
139	47	40	27	57%	✓	68%	✓
140	61	40	31	51%	✓	78%	✓
141	55	40	34	62%	✓	85%	✓
142	71	50	45	63%	✓	90%	✓
143	41	40	16	39%	X	40%	X
144	56	30	20	36%	X	67%	✓

Ref	Total Area (m <sup>2</sup> )	Minimum Area Required (m <sup>2</sup> )	Area Receiving >2h (m <sup>2</sup> )	Percent Receiving >2h above the total area	Comment	Percent Receiving >2h above the min. area required	Comment
145	93	40	42	45%	X	100%	✓
146	47	40	26	55%	✓	65%	✓
147	43	30	17	40%	X	57%	✓
148	48	30	18	38%	X	60%	✓
149	52	30	21	40%	X	70%	✓
150	77	40	53	69%	✓	100%	✓
151	121	50	94	78%	✓	100%	✓
152	56	50	28	50%	✓	56%	✓
153	59	40	35	59%	✓	88%	✓
154	42	30	16	38%	X	53%	✓
155	41	30	16	39%	X	53%	✓
156	40	30	16	40%	X	53%	✓
157	39	30	16	41%	X	53%	✓
158	37	30	14	38%	X	47%	X
159	37	30	16	43%	X	53%	✓
160	64	40	35	55%	✓	88%	✓
161	50	40	25	50%	✓	63%	✓
162	49	30	18	37%	X	60%	✓
163	50	30	20	40%	X	67%	✓
164	48	30	20	42%	X	67%	✓
165	81	40	31	38%	X	78%	✓
166	73		35	48%	X		



## **Discussion**

As outlined in Section 3.3.17 of the BRE Guide (3<sup>rd</sup> Edition), for a space to appear adequately sunlit throughout the year, at least half of the garden or amenity area should receive at least 2 hours of sunlight on March 21<sup>st</sup>. In the case of existing amenity spaces, if they are already below the 50% threshold then the BRE recommends the results kept to within 80% of the existing situation.

### **Permitted Amenity Spaces**

On March 21<sup>st</sup> the permitted amenity spaces will receive similar levels of sunlight with the proposed development in place when compared to the permitted situation. In all cases the results comply with the recommendations in the BRE Guide outlined above.

### **Proposed Public Open Amenity Spaces**

On March 21<sup>st</sup>, 96% of the combined proposed public open amenity area situated within the development site will receive at least 2 hours of sunlight over their total area. Thus, complying with the BRE recommendations. When considered individually, all amenity areas are also exceeding the BRE guidelines.

### **Proposed Rear Garden Amenity Spaces**

On March 21<sup>st</sup>, 80% (132 out of 165) of the proposed rear garden amenity spaces within the development site will receive at least 2 hours of sunlight over their total area, thus complying with the BRE recommendations. When compared against the minimum area required for each dwelling the compliance rate increases to 95% (157 out of 165).

It is important to note that the rear garden amenity spaces were tested with a 2.00 meter high fence, except for numbers 93 and 94, where the boundary wall to the south is a 3.00 meter high acoustic wall. When this wall is reduced to 2.00 meters, amenity spaces number 93 and 94 receive at least 2 hours of sunlight on March 21<sup>st</sup> across their minimum area required. The overall results increase from 95% to 96%.

The majority of rear gardens receiving sunlight below recommended levels are as a result of the amenity overall site location and position in relation to neighbouring dwellings. In site layout planning this is inevitable. Not all amenities can be south facing or free from overshadowing from neighbouring dwellings within a housing development. For these reasons noted, achieving in excess of 80% of private amenities above the recommendations of 2 hours of sunlight during March 21<sup>st</sup> is a high standard to achieve.

### **Proposed Creche Amenity Space.**

On March 21<sup>st</sup>, 48% of the proposed amenity space provided for the creche will receive at least 2 hours of sunlight over its total area. While this is just below the BRE recommendations, it is expected that this space will enjoy good levels of sunlight throughout the summer months when the climatic conditions permit its use.



## 7 Sunlight to Existing Buildings

### 7.1 Guidance – BRE Guide (3<sup>rd</sup> Edition)

The BRE Guide (3<sup>rd</sup> Edition) states that interiors where the occupants expect sunlight should receive at least one quarter (25%) of annual probable sunlight hours, including at least 5% of annual probable sunlight hours during the winter months, between 21<sup>st</sup> September and 21<sup>st</sup> March.

Here 'probable sunlight hours' means the total number of hours in the year that the sun is expected to shine on unobstructed ground, allowing for average levels of cloudiness for the location in question.

If a window reference point can receive more than 25% of annual probable sunlight hours, including at least 5% of annual probable sunlight hours during the winter months between 21<sup>st</sup> September and 21<sup>st</sup> March, then the room should still receive enough sunlight. Any reduction in sunlight access below this level should be kept to a minimum.

If the available sunlight hours are both less than the amount given and less than 0.8 times their former value, either over the whole year or just during the winter months (21<sup>st</sup> September to 21<sup>st</sup> March) and reduction in sunlight across the year has a greater reduction than 4%, then the occupants of the existing building will notice the loss of sunlight.

#### Summary

3.2.13 If a living room of an existing dwelling has a main window facing within 90° of due south, and any part of a new development subtends an angle of more than 25° to the horizontal measured from the centre of the window in a vertical section perpendicular to the window, then the sunlighting of the existing dwelling may be adversely affected. This will be the case if the centre of the window:

- receives less than 25% of annual probable sunlight hours and less than 0.80 times its former annual value; or less than 5% of annual probable sunlight hours between 21 September and 21 March and less than 0.80 times its former value during that period;
- and also has a reduction in sunlight received over the whole year greater than 4% of annual probable sunlight hours.

BRE 3<sup>rd</sup> Edition guidance document Site Layout Planning for Daylight and Sunlight


As such this study will compare the Existing/Permitted Scheme and Proposed Scheme and consider if the values on the existing buildings meet the requirements outlined above when compared to their former value (that of the Existing/Permitted scheme).

## 7.2 AP SH Exclusions

The BRE recommendations note that if a new development sits within 90° of due south of any main living room window of an existing dwelling, then these should be assessed for AP SH. However, there are several exceptional cases in which AP SH is not required to be calculated, as indicated below:

3.2.9 It is not always necessary to do a full calculation to check sunlight potential. The guideline above is met provided either of the following is true:

- If the distance of each part of the new development from the existing window is three or more times its height above the centre of the existing window (note: obstructions within 90° of due north of the existing window need not count here).
- The window wall faces within 90° of due south and no obstruction, measured in the section perpendicular to the window wall, subtends an angle of more than 25° to the horizontal (Figure 14 in section 2.2). Again, obstructions within 90° of due north of the existing window need not be counted.
- The window wall faces within 20° of due south and the reference point has a VSC (section 2.1) of 27% or more.

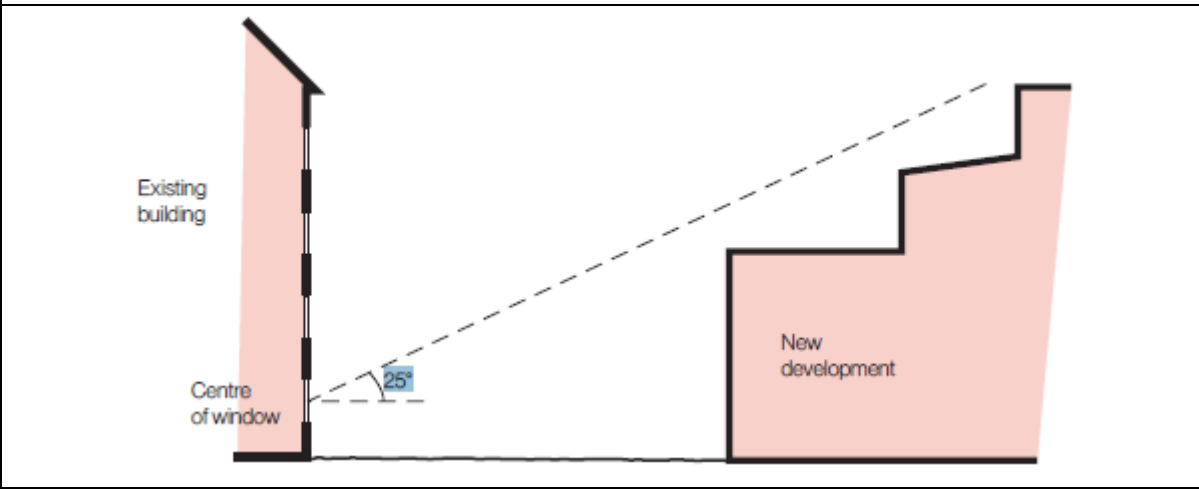

BRE 3<sup>rd</sup> Edition guidance document Site Layout Planning for Daylight and Sunlight

Consequently, AP SH will only be calculated for adjacent windows which meet the following conditions:

1. The height distance rule is not met and the existing building has a living room with a main window which faces within 90 degrees of due south with the 25° rule not being met either.
2. Existing building is located to the North, East, or West of the Proposed Development.
3. The existing main living room window lies within 20 degrees of due south and has a VSC of less than 27%.

Taking the above into consideration, the existing properties north facing the proposed development have been excluded from this analysis. The existing dwellings which have living area windows that face within 90 degrees of South have been included in this assessment.


### 7.3 25-Degree Rule

Given the statement above the surrounding elevations adjacent to the proposed development were verified noting that, in a section perpendicular to the window wall, no angle subtended more than 25° in some cases as noted below.


- South East – Permitted Unit Types
- Old Slane Road

The following images show the 25-degree test sections or property locations to the South East of the proposed development.

#### South East – Permitted Unit Types

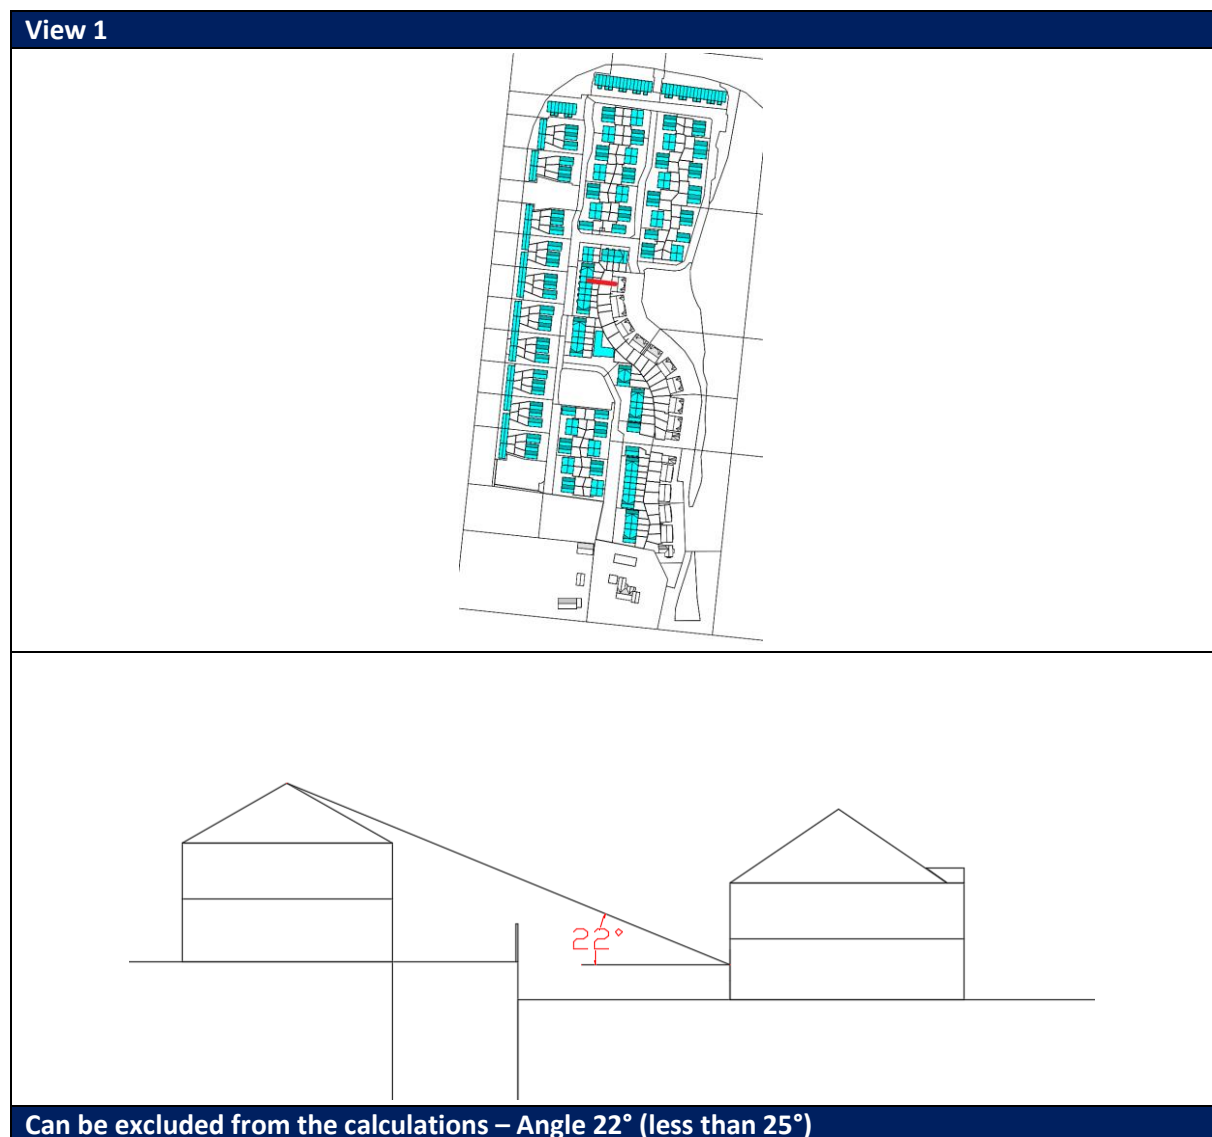


**View 2**

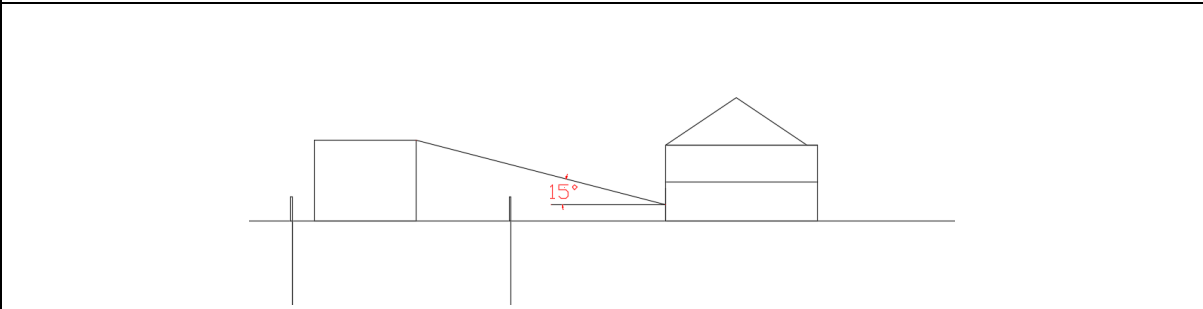


**Can be excluded from the calculations – Angle 15° (less than 25°)**

**View 3**

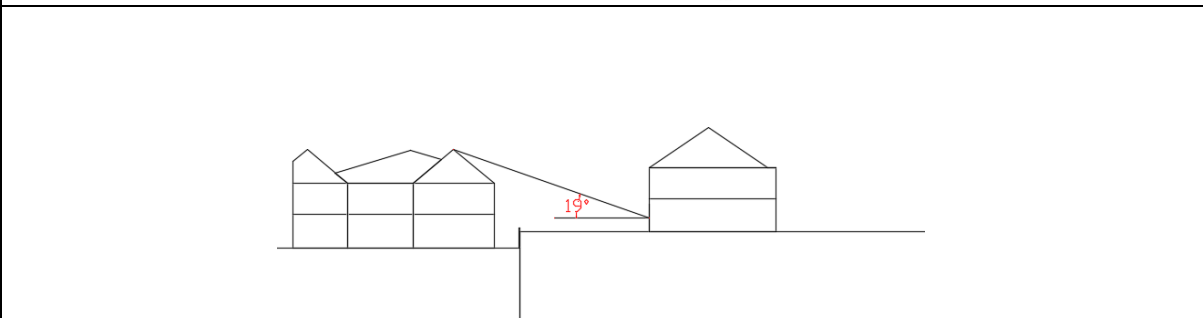


**Can be excluded from the calculations – Angle 19° (less than 25°)**

**View 4**

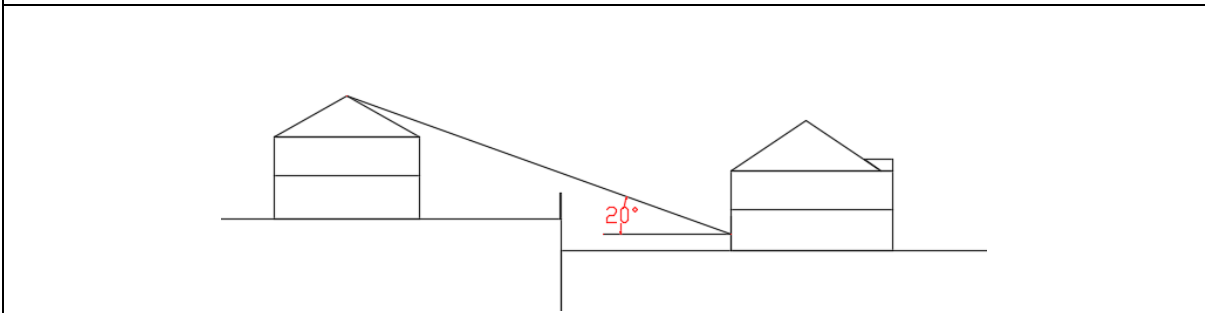


Can be excluded from the calculations – Angle  $20^\circ$  (less than  $25^\circ$ )

**View 5**

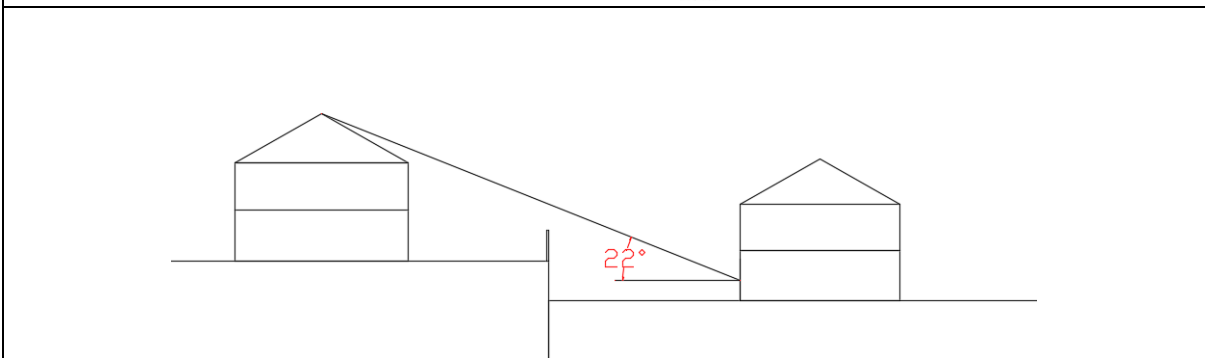

Can be excluded from the calculations – Angle  $22^\circ$  (less than  $25^\circ$ )


**View 6**

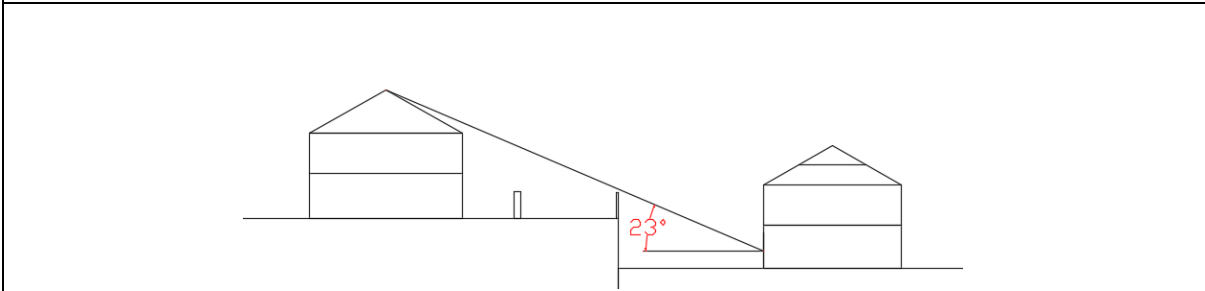

**Can be excluded from the calculations – Angle 23° (less than 25°)**

Old Slane Road

**View 7**

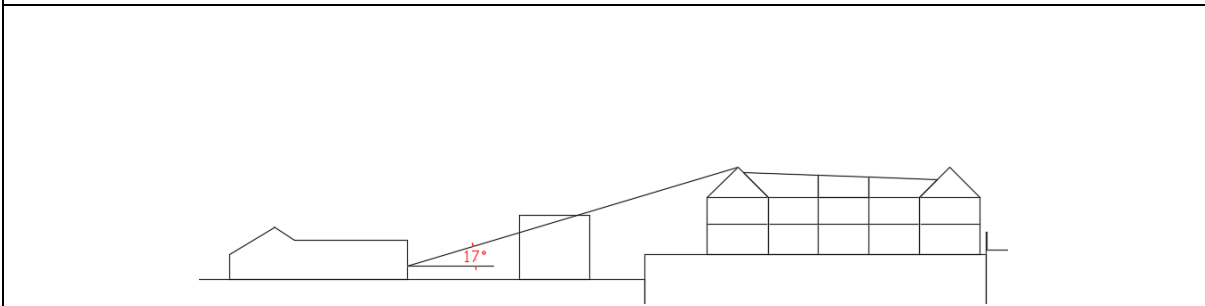

**Can be excluded from the calculations – Angle 17° (less than 25°)**

## 7.4 Discussion

This study considers the proposed scheme and tests if the Annual Probable Sunlight Hours (APSH) results for the living room windows are greater than 25% annual and 5% winter sunlight or are greater than 0.8 times their former value with the proposed development in place or the reduction in sunlight across the year is less than 4% with the proposed development in place.

Based on the criteria outlined in Section 3.2.9 of the BRE Guide 3<sup>rd</sup> Edition, none of the existing/permitted buildings fit the requirements to be assessed and as such the APSH assessment was not conducted. The BRE guide (3<sup>rd</sup> Edition) notes that there should be no impact to sunlight for these properties “It is not always necessary to do a full calculation to check sunlight potential. The guideline above is met provided either the following is true:

- If the window wall faces within 90° of due south and no obstruction, measured in the section perpendicular to the window wall, subtends an angle of more than 25° to the horizontal. Again, obstructions within 90° of due north need not be counted.”

Given the statement above, the surrounding dwellings adjacent to the proposed development were verified noting that, in a section perpendicular to the window wall, no angle subtended more than 25° and, in some cases, they were also sitting to the south of the proposed development. The surrounding existing/permitted properties have been excluded from the assessment as noted in Section 3.2.9 of the BRE Guide 3<sup>rd</sup> Edition, that these windows need not be analysed as sunlight impact will be unnoticeable to the existing occupants.



## 8 Sunlight to Proposed Development

### 8.1 Guidance – BRE Guide 3<sup>rd</sup> Edition / IS/BS EN 17037-2018+A1-2021

Section 5.3.1 of IS/BS EN 17037-2018+A1-2021 states that “*exposure to sunlight is an important quality criterion of an interior space and can contribute to human well-being.*” Table A.6 from IS/BS EN 17037-2018+A1-2021 summarises the recommendation for daily sunlight exposure.

**Table A.6 — Recommendation for daily sunlight exposure**

Level of recommendation for exposure to sunlight	Sunlight exposure
Minimum	1,5 h
Medium	3,0 h
High	4,0 h

Within the context of a domestic property, BRE Guide 3<sup>rd</sup> Edition/IS EN 17037:2018 states that at least one habitable space within a dwelling should receive the recommended minimum value of 1.5 hours of sunlight on the 21<sup>st</sup> of March. The test is carried out on a clear, cloud free day.

### 8.2 Sunlight Exposure Assessment


Based on the above criteria for BRE Guide 3<sup>rd</sup> Edition/IS/BS EN 17037-2018+A1-2021, all main living room windows within the proposed development have been assessed with the results included in the following sections.

Please note, the “Comment” symbol in each of the tables represents the following:

#### BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021

- ✓ These rooms achieve the minimum 1.5 hours of recommended sunlight exposure on March 21<sup>st</sup>.
- x These rooms do not achieve the minimum 1.5 hours of recommended sunlight exposure on March 21<sup>st</sup>.

### 8.2.1 View 01

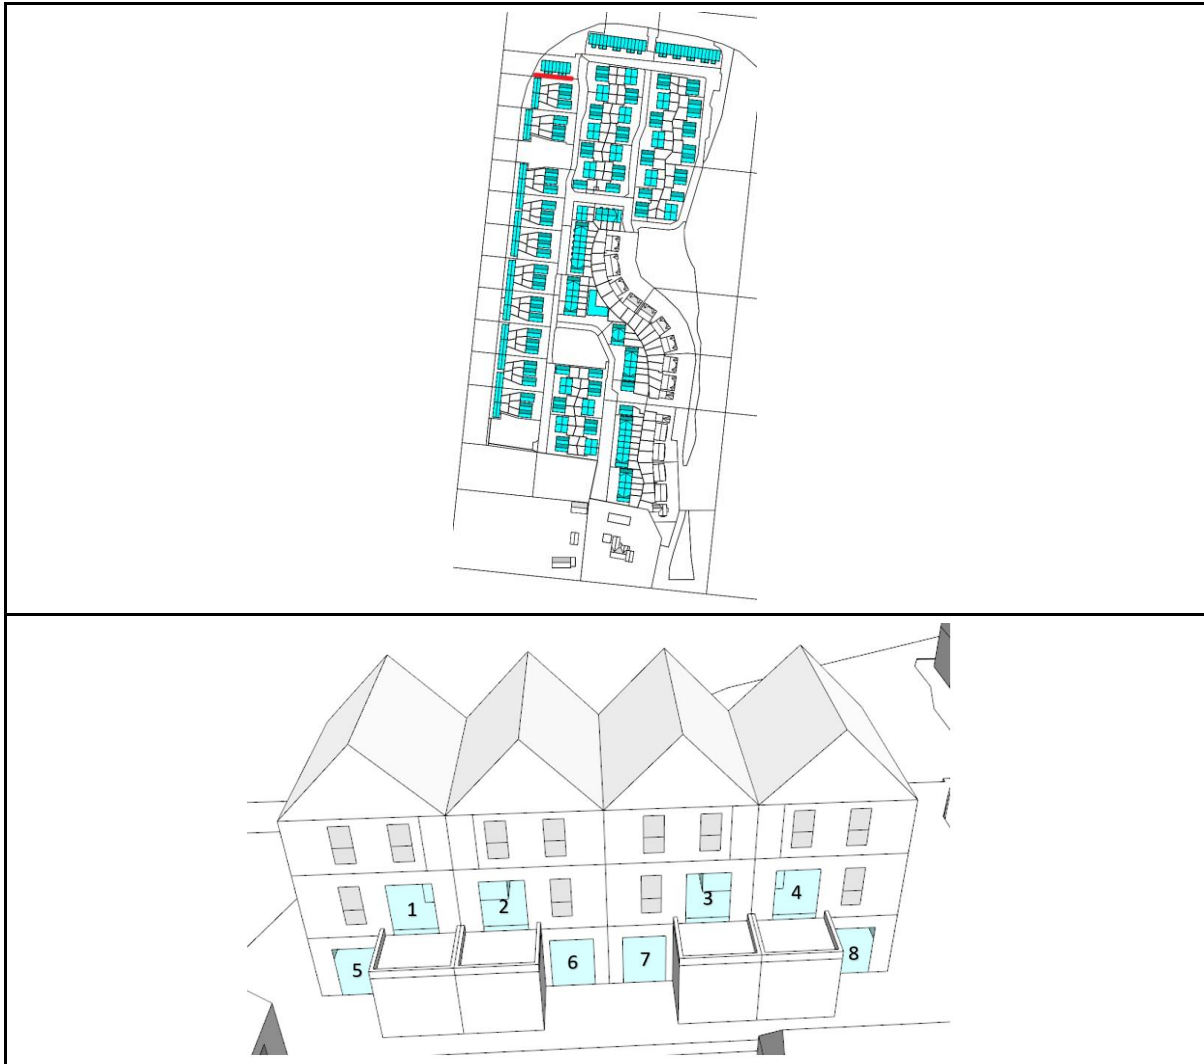

Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
1	✓
2	✓
3	✓
4	✓
5	✓
6	✓
7	✓
8	✓

### 8.2.2 View 02



Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs Comment
1	✓
2	✓
3	✓
4	✓
5	✓
6	✓
7	✓
8	✓

Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs Comment
9	✓
10	✓
11	✓
12	✓
13	✓
14	✓
15	✓
16	✓

### 8.2.3 View 03



Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs Comment
1	✓
2	✓
3	✓
4	✓
5	✓
6	✓
7	✓
8	✓
9	✓

Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs Comment
10	✓
11	✓
12	✓
13	✓
14	✓
15	✓
16	✓
17	✓
18	✓

### 8.2.4 View 04



Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
1	✓
2	✓
3	✓
4	✓
5	✓
6	✓
7	✓
8	✓
9	✓
10	✓
11	✓
12	✓
13	✓
14	✓

Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
15	✓
16	✓
17	✓
18	✓
19	✓
20	✓
21	✓
22	✓
23	✓
24	✓
25	✓
26	✓
27	✓
28	✓

### 8.2.5 View 05



Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
1	✓
2	✓
3	✓
4	✓
5	✓
6	✓
7	✓
8	✓
9	✓
10	✓

Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
11	✓
12	✓
13	✓
14	✓
15	✓
16	✓
17	✓
18	✓
19	✓



### 8.2.6 View 06



Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
1	✓
2	✓
3	✓
4	✓
5	✓
6	✓
7	✓
8	✓
9	✓
10	✓
11	✓
12	✓
13	✓
14	✓
15	✓

Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
16	✓
17	✓
18	✓
19	✓
20	✓
21	✓
22	✓
23	✓
24	✓
25	✓
26	✓
27	✓
28	✓
29	✓

### 8.2.7 View 07



Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
1	✓
2	✓
3	✓
4	✓
5	✓
6	✓
7	✓
8	✓
9	✓
10	✓
11	✓
12	✓

Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
13	✓
14	✓
15	✓
16	✓
17	✓
18	✓
19	✓
20	✓
21	✓
22	✓
23	✓
24	✓

### 8.2.8 View 08



Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
1	✓
2	✓
3	✓
4	✓
5	✓
6	✓
7	✓
8	✓
9	✓
10	✓
11	✓
12	✓
13	✓

Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
14	✓
15	✓
16	✓
17	✓
18	✓
19	✓
20	✓
21	✓
22	✓
23	✓
24	✓
25	✓

### 8.2.9 View 09



Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
1	✓
2	✓
3	✓
4	✓
5	✓
6	✓
7	✓
8	✓
9	✓
10	✓
11	✓
12	✓

Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
13	✓
14	✓
15	✓
16	✓
17	✓
18	✓
19	✓
20	✓
21	✓
22	✓
23	✓

### 8.2.10 View 10




Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs Comment
1	✓
2	✓
3	✓
4	✓
5	✓
6	✓
7	✓

Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs Comment
8	✓
9	✓
10	✓
11	✓
12	✓
13	✓



### 8.2.11 View 11

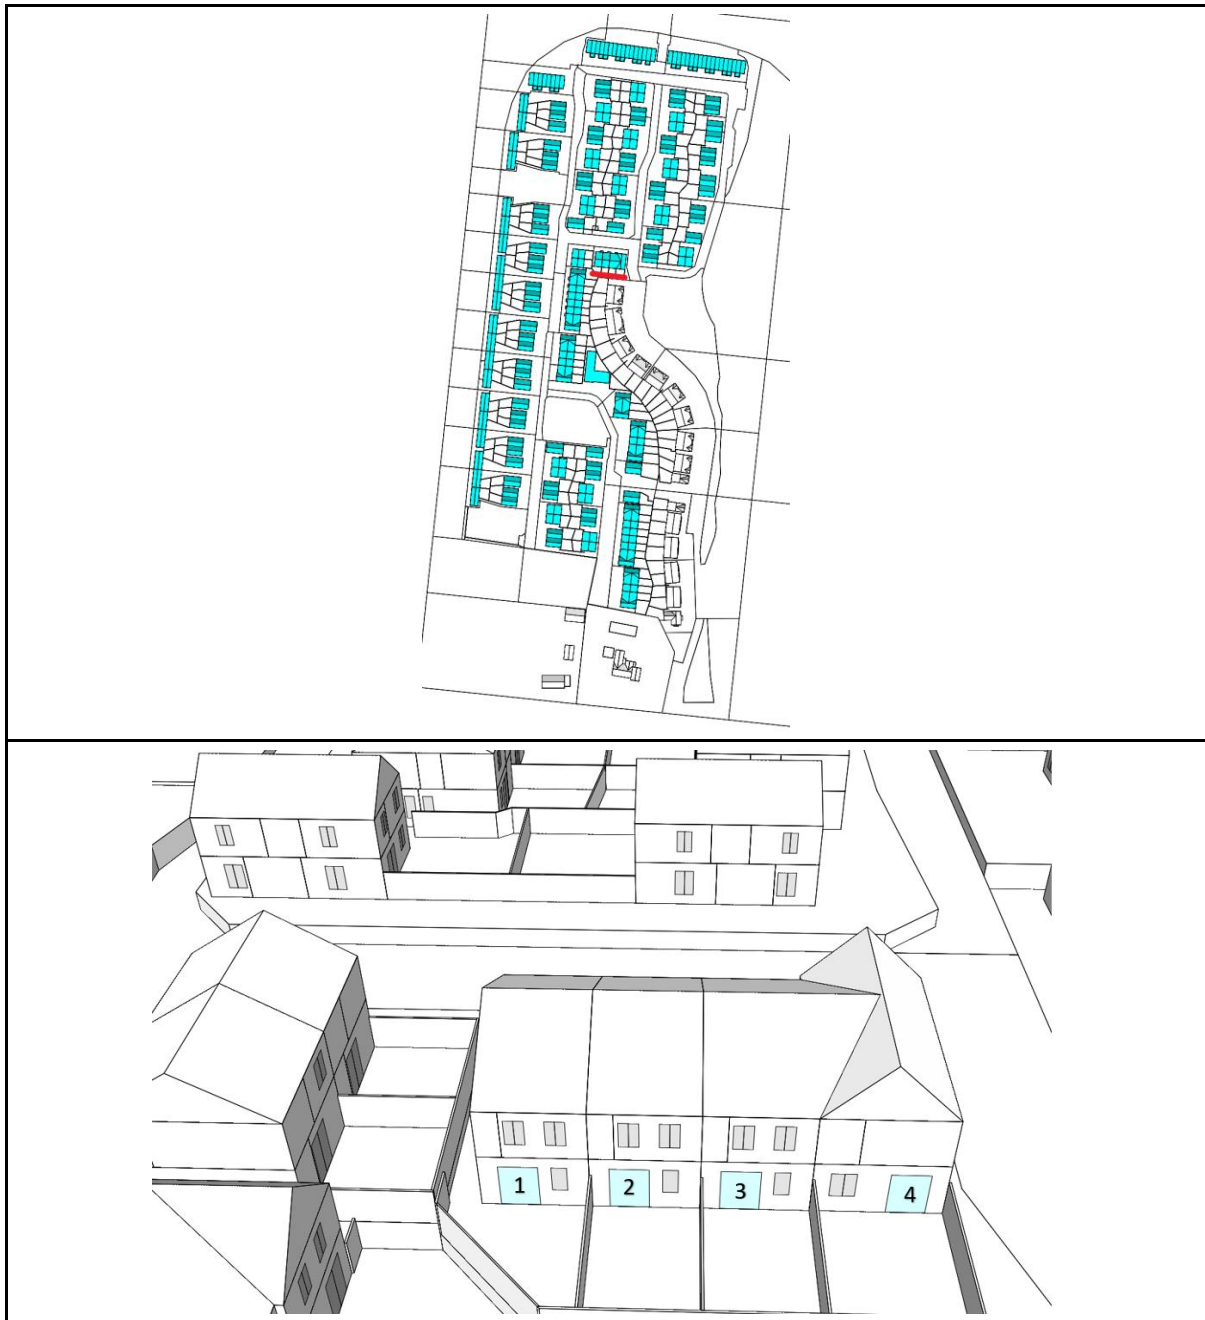

Ref.	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Sunlight Exposure > 1.5 hrs
	Comment
1	✓
2	✓
3	✓
4	✓



### 8.3 Discussion

#### **BRE Guide 3<sup>rd</sup> Edition / IS/BS EN 17037-2018+A1-2021**

As the sunlight exposure assessment in accordance with BRE Guide 3<sup>rd</sup> Edition / IS/BS EN 17037-2018+A1-2021 considers the orientation of the rooms the following should be noted from section 3.1.11 of the guide.

*“The BS EN 17037 criterion applies to rooms of all orientations, although if a room faces significantly north of due east or west it is unlikely to be met.”*

Of the 207 no. points tested, 100% meet the BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 sunlight exposure recommendations of greater than 1.5 hours on March 21<sup>st</sup>.

Overall, the sunlight provision results to the proposed development in accordance with IS/BS EN 17037:23018 are considered excellent.

Finally, the sunlight exposure results are visually represented in Appendix B.

## 9 Daylight to Existing Buildings

### 9.1 Guidance – BRE Guide (3<sup>rd</sup> Edition) / IS/BS EN 17037-2018+A1-2021

When designing a new development, it is important to safeguard the daylight to nearby buildings. The BRE Guide provides numerical values that are purely advisory. Different criteria may be used based on the requirements for daylighting in an area viewed against other site layout constraints. Another issue is whether the existing building is itself a good neighbour, standing a reasonable distance from the boundary and taking no more than its fair share of light. Any reduction in the total amount of skylight can be calculated by determining the vertical sky component at the centre of key reference points. The vertical sky component definition from the BRE Guide (3<sup>rd</sup> Edition) is described below:

<b>Vertical sky component (VSC)</b>	This is a measure of the amount of light reaching a window. It is the ratio of that part of illuminance, at a point on a given vertical plane, that is received directly from a CIE standard overcast sky, to illuminance on a horizontal plane due to an unobstructed hemisphere of this sky. Usually the 'given vertical plane' is the outside of a window wall. The VSC does not include reflected light, either from the ground or from other buildings.
-------------------------------------	--

The maximum possible VSC value for an opening in a vertical wall, assuming no obstructions, is 40%. This VSC at any given point can be tested in RadianceIES, a module of IES VE.

For typical residential schemes the BRE Guide (3<sup>rd</sup> Edition) states the following in Section 2.2.7:

2.2.7 If this VSC is greater than 27% then enough skylight should still be reaching the window of the existing building. Any reduction below this level should be kept to a minimum. If the VSC, with the new development in place, is both less than 27% and less than 0.8 times its former value, occupants of the existing building will notice the reduction in the amount of skylight. The area lit by the window is likely to appear more gloomy, and electric lighting will be needed more of the time.
--

As such this study will compare the Existing/Permitted scheme and Proposed scheme, and consider if the values on the existing buildings are above 27% or not less than 0.8 times their former value (that of the Existing scheme).


It is also important to note that Section 2.1.6 of the BRE Guide states that if the VSC is between 15% and 27%, special measures such as larger windows can provide adequate daylight (refer to extract below).

2.1.6 The amount of daylight a room needs depends on what it is being used for. But roughly speaking, if  $\theta$  is:

- greater than  $65^\circ$  (obstruction angle less than  $25^\circ$  or VSC at least 27%) conventional window design will usually give reasonable results.
- between  $45^\circ$  and  $65^\circ$  (obstruction angle between  $25^\circ$  and  $45^\circ$ , VSC between 15% and 27%) special measures (larger windows, changes to room layout) are usually needed to provide adequate daylight.
- between  $25^\circ$  and  $45^\circ$  (obstruction angle between  $45^\circ$  and  $65^\circ$ , VSC between 5% and 15%) it is very difficult to provide adequate daylight unless very large windows are used.
- less than  $25^\circ$  (obstruction angle greater than  $65^\circ$ , VSC less than 5%) it is often impossible to achieve reasonable daylight, even if the whole window wall is glazed.

## 9.2 25 Degree Rule

Section 2.2.5 of the BRE Guide states that if in a section perpendicular to the window wall, no angle subtended more than 25 degrees, as shown in the image below, it is not necessary to do a full calculation as the daylight impact will be unnoticeable to the occupants. Please refer to section 7.3 25 Degree Rule for the section images produced as evidence for each of the qualifying views.

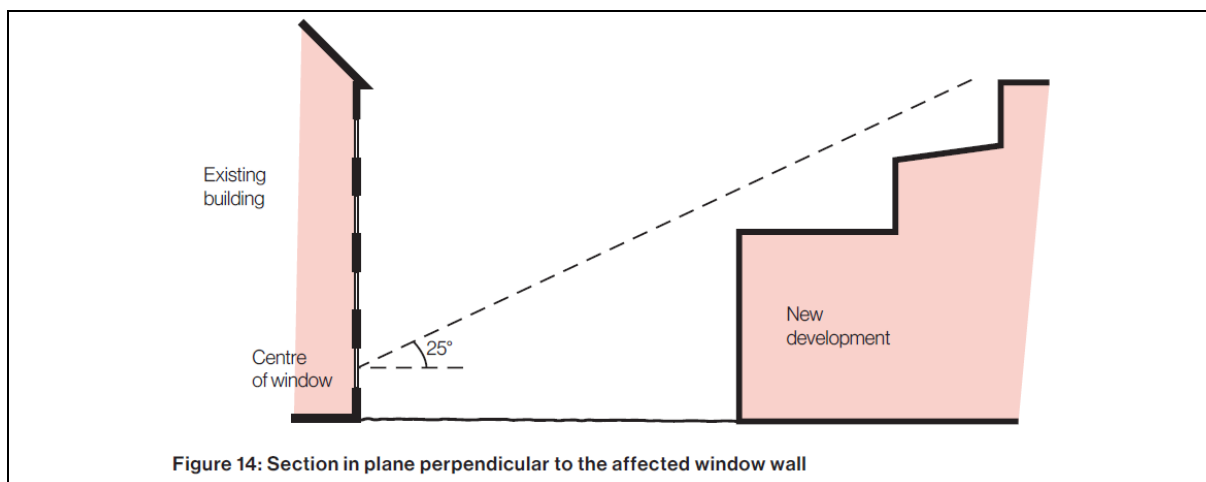

### 9.3 Discussion

This study considers the Proposed Scheme and tests if the VSC results are greater than 27% or not less than 0.8 times the value of the Existing Situation.

Based on the criteria outlined in Section 2.2.5 of the BRE guidance (3<sup>rd</sup> Edition), none of the neighbouring buildings need to be included within the VSC assessment as they did not meet the criterion as laid out within the BRE guide which is as follows.

It is not always necessary to do a full calculation to check daylight potential. The guideline above is met provided the following is true:

- no obstruction, measured in the section perpendicular to the window wall, subtends an angle of more than 25° to the horizontal.

Therefore, as noted above, the adjacent buildings have been excluded within the VSC assessment as the daylight impact will be unnoticeable to the occupants of the neighbouring elevations. Please refer to section 7.3 25 Degree Rule for the section images produced as evidence for each of the qualifying views.

## 10 Daylight to Proposed Development

Our proposed methodology was to model a sample of the dwellings to gain an understanding of the daylight performance for the development at this stage. The objective of the design team is to maximise the number of units which exceed the recommendations.

### 10.1 Reference Standards

The daylight provision to the proposed development was assessed against the following standards for completeness:

- BRE Guide (3<sup>rd</sup> Edition) / IS EN 17037-2018+A1-2021
- BRE Guide (3<sup>rd</sup> Edition) / BS EN 17037-2018+A1-2021

The following sections summarise the various requirements of each standard.

#### 10.1.1 BRE Guide (3<sup>rd</sup> Edition) / IS EN 17037-2018+A1-2021

As outlined in Section 5.1.2 of the IS EN 17037-2018+A1-2021 standard:

*“A space is considered to provide adequate daylight if a target illuminance level is achieved across a fraction of the reference plane within a space for at least half of the daylight hours. In addition, for spaces with vertical or inclined daylight openings, a minimum target illuminance level is also to be achieved across the reference plane”.*

Annex A of IS EN 17037-2018+A1-2021 gives three levels of recommendation for the assessment of daylight provision in interior spaces which are summarised as follows:

*“The three levels are: minimum, medium and high, and the minimum recommendation should be provided.”*

It is important to note that IS EN 17037-2018+A1-2021 does not provide different illuminance targets for different space types. Therefore, in the case of residential developments; bedrooms, living rooms, kitchens and combined LKDs all have the same daylight provision targets.

Table A.1 of IS EN 17037-2018+A1-2021 (included below) provides recommendations for daylight provision by daylight openings in vertical and inclined surfaces. Note, Table A.2 provides similar recommendations for daylight openings in horizontal surfaces, e.g. rooflights. As there are no rooflights in the proposed development, the recommendations in Table A.2 are not followed.

To achieve the minimum level of daylight provision for vertical and inclined openings as per Table A.1, the following must be achieved:

- A target illuminance ( $E_T$ ) of 300 lux must be achieved on over 50% of the floor area for over 50% of the available daylight hours, and
- A minimum target illuminance ( $E_{TM}$ ) of 100 lux must be achieved on over 95% of the floor area for over 50% of the available daylight hours.
- Both targets above must be satisfied for a space to be deemed compliant with the requirements.

**Table A.1 — Recommendations of daylight provision by daylight openings in vertical and inclined surface**

Level of recommendation for vertical and inclined daylight opening	Target illuminance $E_T$ lx	Fraction of space for target level $F_{plane,\%}$	Minimum target illuminance $E_{TM}$ lx	Fraction of space for minimum target level $F_{plane,\%}$	Fraction of daylight hours $F_{time,\%}$
Minimum	300	50 %	100	95 %	50 %
Medium	500	50 %	300	95 %	50 %
High	750	50 %	500	95 %	50 %

NOTE Table A.3 gives target daylight factor ( $D_T$ ) and minimum target daylight factor ( $D_{TM}$ ) corresponding to target illuminance level and minimum target illuminance, respectively, for the CEN capital cities.

The recommendations in Table A.1 can also be expressed in terms of a daylight factor “D”. Table A.3 provides the corresponding daylight factor (D) relative to a recommended target illuminance  $E_T$  (lx) and target minimum illuminance  $E_{TM}$  (lx) depending on the location for daylight openings in vertical and inclined surfaces. Note, Table A.4 provides similar target values for openings in horizontal surfaces, e.g. rooflights. As there are no rooflights in the proposed development, the recommendations in Table A.4 are not followed.

The extract from Table A.3 below is for Dublin with the daylight factor targets highlighted, i.e. to achieve the target illuminance ( $E_T$ ) of 300 lux outlined in Table A.1, an equivalent target daylight factor is 2.0%. Furthermore, to achieve the minimum target illuminance ( $E_{TM}$ ) of 100 lux outlined in Table A.1, an equivalent target daylight factor is 0.7%.

**Table A.3 — Values of D for daylight openings to exceed an illuminance level of 100, 300, 500 or 750 lx for a fraction of daylight hours  $F_{time,\%} = 50\%$  for 33 capitals of CEN national members**

Nation	Capital <sup>a</sup>	Geographical latitude $\varphi$ [°]	Median External Diffuse Illuminance $E_{v,d,med}$	D to exceed 100 lx	D to exceed 300 lx	D to exceed 500 lx	D to exceed 750 lx
Ireland	Dublin	53,43	14 900	0,7 %	2,0 %	3,4 %	5,0 %

Therefore, to achieve the minimum level of daylight provision for vertical and inclined openings as per Table A.3, the following must be achieved:

- A target daylight factor ( $D_T$ ) of 2.0% must be achieved on over 50% of the floor area for over 50% of the available daylight hours, and
- A minimum target daylight factor ( $D_{TM}$ ) of 0.7% must be achieved on over 95% of the floor area for over 50% of the available daylight hours.
- Both targets above must be satisfied for a space to be deemed compliant with the requirements.

There are two methods to assess daylight provision to the interior which are based on target values in either Table A.1 or Table A.3 which are summarised as follows:



Method 1: This calculation method uses the daylight factor targets on the reference plane as per Table A.3. The assessment is carried out on a representative day and time during the year, i.e. 21<sup>st</sup> September @ 12:00 under standard CIE overcast sky conditions.

Method 2: This calculation method uses the illuminance targets on the reference plane as per Table A.1. The assessment is carried out for each hour over the course of the year (8,760 hours) using a local weather file which accounts for varying sky conditions and sun positions throughout the year.

As outlined in Section 5.1.4, the verification of daylight provision can be determined using either an adequate software or on-site measurements. When using a software, *“a representative model of the space is required together with the key parameters (such as any significant nearby obstructions, the assigned surface reflectance values and glazing transmissivity) that are a reasonable representation of those for the actual, completed building. This can be determined using either Method 1 or Method 2.”*

Based on the above criteria, the daylight provision to the proposed development has been assessed using an adequate software (i.e. IES VE), using the Method 2 climate-based approach and targeting the minimum recommended values outlined in Table A.1 of IS EN 17037-2018+A1-2021.

The Method 2 climate-based approach was selected as it is a far more accurate assessment method compared to Method 1. Climate based daylight modelling (CBDM) is more accurate compared to a calculation based on a single day during the year, i.e. Method 1. The amount of daylight varies throughout the year, primarily due to the sun’s position, so it is essential the impact of daylight variance is properly considered. CBDM utilises an annual simulation linking location, shading, climate data (including solar intensity and cloud cover) together with the building properties. This provides a complete overview on how the daylight performance varies throughout the year due to changes in these factors.

### **10.1.2 BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 National Annex**

In the UK, EN17037-2018+A1-2021 was adopted to form “BS EN 17037-2018+A1-2021”. However, a “National Annex NA” was included which states:

*“The UK committee supports the recommendations for daylight in buildings given in BS EN 17037:2018; however, it is the opinion of the UK committee that the recommendations for daylight provision in a space (see Clause A.2) may not be achievable for some buildings, particularly dwellings. The UK committee believes this could be the case for dwellings with basement rooms or those with significant external obstructions (for example, dwellings situated in a dense urban area or with tall trees outside), or for existing buildings being refurbished or converted into dwellings. This National Annex therefore provides the UK committee’s guidance on minimum daylight provision in all UK dwellings.”*

Whereas IS EN 17037-2018+A1-2021 does not provide different illuminance targets for different space types, the BS EN 17037:2018 National Annex provides target illuminance values for bedrooms, living rooms and kitchens within residential developments as per Table NA.1 below. It is also important to note that as the climate in Ireland is similar to the UK, the targets outlined in the BS EN National Annex could also be applied to dwellings in Ireland.

**Table NA.1 — Values of target illuminance for room types in UK dwellings**

Room type	Target illuminance $E_T$ (lx)
Bedroom	100
Living room	150
Kitchen	200

The BS National Annex also states:

*“Where one room in a UK dwelling serves more than a single purpose, the UK committee recommends that the target illuminance is that for the room type with the highest value – for example, in a space that combines a living room and a kitchen the target illuminance is recommended to be 200 lx.”*

Therefore, combined LKDs are to be assessed using a 200 lux target illuminance ( $E_T$ ).

Finally, the BS National Annex also states that:

*“It is the opinion of the UK committee that the recommendation in Clause A.2 – that a target illuminance level should be achieved across the entire (i.e. 95 %) fraction of the reference plane within a space – need not be applied to rooms in dwellings.”*

Therefore, when assessing the daylight provisions in residential dwellings in accordance with BS EN 17037-2018+A1-2021, only the target illuminance ( $E_T$ ) or target daylight factor ( $D_T$ ) will be assessed for Bedrooms, Living Rooms, Kitchens (or combined LKDs) on over 50% of the floor area over 50% of the available daylight hours. The minimum target illuminance ( $E_{TM}$ ) or minimum target daylight factor ( $D_{TM}$ ) will not be assessed.

Based on the above criteria, the daylight provision to the proposed development has been assessed using an adequate software (i.e. IES VE), using the Method 2 climate-based approach and targeting the minimum recommended values outlined in Table NA.1 of BS EN 17037-2018+A1-2021.

## 10.2 Daylight Model Inputs

The following inputs were used in the study:

BRE Guide (3<sup>rd</sup> Edition) / IS EN / BS EN 17037-2018+A1-2021

- Weather File: Dublin.epw (15-year average)

Common Inputs to all Standards

- Working Plane Height: 0.85m
- Glazing Light Transmittance: 70%
- Window Frame thickness: 50 mm

The following surface reflectance values are used in the study:

Material Surface	Reflectance
External Wall	0.20/0.60
Internal Partition – White	0.80
Roof – Default	0.20
Ground – Default	0.20
Floor – Light Veneers	0.40
Ceiling – White	0.80

### 10.3 Daylight Results

The following tables summarise the daylight provision results for the housing unit types assessed against the various standards. Individual room results can be viewed in Appendix A. The objective of the design team is to maximise the number of units which exceed the recommendations.

The results are summarised in the following tables:

#### House Type K

The daylight provision results for house Types K in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	84
Total No. KDs Tested	28
Total No. Living Rooms Tested	28
<b>Total No. Spaces Tested</b>	<b>140</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	84	100%	0	0%
No. KDs	28	100%	0	0%
No. Living Rooms	28	100%	0	0%
<b>Total No.</b>	<b>140</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	84	100%	0	0%
No. KDs	28	100%	0	0%
No. Living Rooms	28	100%	0	0%
<b>Total No.</b>	<b>140</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type L1

The daylight provision results for house Types L1 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	123
Total No. KDs Tested	41
Total No. Living Rooms Tested	41
<b>Total No. Spaces Tested</b>	<b>205</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	123	100%	0	0%
No. KDs	41	100%	0	0%
No. Living Rooms	41	100%	0	0%
<b>Total No.</b>	<b>205</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	123	100%	0	0%
No. KDs	41	100%	0	0%
No. Living Rooms	41	100%	0	0%
<b>Total No.</b>	<b>205</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type L2

The daylight provision results for house Types L2 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	18
Total No. KDs Tested	6
Total No. Living Rooms Tested	6
<b>Total No. Spaces Tested</b>	<b>30</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	18	100%	0	0%
No. KDs	6	100%	0	0%
No. Living Rooms	6	100%	0	0%
<b>Total No.</b>	<b>30</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	18	100%	0	0%
No. KDs	6	100%	0	0%
No. Living Rooms	6	100%	0	0%
<b>Total No.</b>	<b>30</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type M1

The daylight provision results for house types M1 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	8
Total No. KDs Tested	2
Total No. Living Rooms Tested	2
<b>Total No. Spaces Tested</b>	<b>12</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	8	100%	0	0%
No. KDs	2	100%	0	0%
No. Living Rooms	2	100%	0	0%
<b>Total No.</b>	<b>12</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	8	100%	0	0%
No. KDs	2	100%	0	0%
No. Living Rooms	2	100%	0	0%
<b>Total No.</b>	<b>12</b>	<b>100%</b>	<b>0</b>	<b>0%</b>



## House Type M2

The daylight provision results for house types M2 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	8
Total No. KDs Tested	2
Total No. Living Rooms Tested	2
<b>Total No. Spaces Tested</b>	<b>12</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	8	100%	0	0%
No. KDs	2	100%	0	0%
No. Living Rooms	2	100%	0	0%
<b>Total No.</b>	<b>12</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	8	100%	0	0%
No. KDs	2	100%	0	0%
No. Living Rooms	2	100%	0	0%
<b>Total No.</b>	<b>12</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type M3

The daylight provision results for house types M3 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	16
Total No. KDs Tested	4
Total No. Living Rooms Tested	4
<b>Total No. Spaces Tested</b>	<b>24</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	16	100%	0	0%
No. KDs	4	100%	0	0%
No. Living Rooms	4	100%	0	0%
<b>Total No.</b>	<b>24</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	16	100%	0	0%
No. KDs	4	100%	0	0%
No. Living Rooms	4	100%	0	0%
<b>Total No.</b>	<b>24</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type N1

The daylight provision results for house types N1 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	30
Total No. KDs Tested	10
Total No. Living Rooms Tested	10
<b>Total No. Spaces Tested</b>	<b>50</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	30	100%	0	0%
No. KDs	10	100%	0	0%
No. Living Rooms	10	100%	0	0%
<b>Total No.</b>	<b>50</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	30	100%	0	0%
No. KDs	10	100%	0	0%
No. Living Rooms	10	100%	0	0%
<b>Total No.</b>	<b>50</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type N2

The daylight provision results for house types N2 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	30
Total No. KDs Tested	10
Total No. Living Rooms Tested	10
<b>Total No. Spaces Tested</b>	<b>50</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	30	100%	0	0%
No. KDs	10	100%	0	0%
No. Living Rooms	10	100%	0	0%
<b>Total No.</b>	<b>50</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	30	100%	0	0%
No. KDs	10	100%	0	0%
No. Living Rooms	10	100%	0	0%
<b>Total No.</b>	<b>50</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type O1

The daylight provision results for house types O1 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	12
Total No. KDs Tested	4
Total No. Living Rooms Tested	4
<b>Total No. Spaces Tested</b>	<b>20</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	12	100%	0	0%
No. KDs	4	100%	0	0%
No. Living Rooms	4	100%	0	0%
<b>Total No.</b>	<b>20</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	12	100%	0	0%
No. KDs	4	100%	0	0%
No. Living Rooms	4	100%	0	0%
<b>Total No.</b>	<b>20</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type O2

The daylight provision results for house types O2 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	30
Total No. KDs Tested	10
Total No. Living Rooms Tested	10
<b>Total No. Spaces Tested</b>	<b>50</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	30	100%	0	0%
No. KDs	10	100%	0	0%
No. Living Rooms	10	100%	0	0%
<b>Total No.</b>	<b>50</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	30	100%	0	0%
No. KDs	10	100%	0	0%
No. Living Rooms	10	100%	0	0%
<b>Total No.</b>	<b>50</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type O3

The daylight provision results for house types O3 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	18
Total No. KDs Tested	6
Total No. Living Rooms Tested	6
<b>Total No. Spaces Tested</b>	<b>30</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	18	100%	0	0%
No. KDs	6	100%	0	0%
No. Living Rooms	6	100%	0	0%
<b>Total No.</b>	<b>30</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	18	100%	0	0%
No. KDs	6	100%	0	0%
No. Living Rooms	6	100%	0	0%
<b>Total No.</b>	<b>30</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type P1

The daylight provision results for house types P1 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	34
Total No. KDs Tested	17
Total No. Living Rooms Tested	17
<b>Total No. Spaces Tested</b>	<b>68</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	34	100%	0	0%
No. KDs	17	100%	0	0%
No. Living Rooms	17	100%	0	0%
<b>Total No.</b>	<b>68</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	34	100%	0	0%
No. KDs	17	100%	0	0%
No. Living Rooms	17	100%	0	0%
<b>Total No.</b>	<b>68</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type P2

The daylight provision results for house types P2 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	18
Total No. KDs Tested	9
Total No. Living Rooms Tested	9
<b>Total No. Spaces Tested</b>	<b>36</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	18	100%	0	0%
No. KDs	9	100%	0	0%
No. Living Rooms	9	100%	0	0%
<b>Total No.</b>	<b>36</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	18	100%	0	0%
No. KDs	9	100%	0	0%
No. Living Rooms	9	100%	0	0%
<b>Total No.</b>	<b>36</b>	<b>100%</b>	<b>0</b>	<b>0%</b>



## House Type R1

The daylight provision results for house types R1 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	16
Total No. KDs Tested	4
Total No. Living Rooms Tested	4
<b>Total No. Spaces Tested</b>	<b>24</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	16	100%	0	0%
No. KDs	4	100%	0	0%
No. Living Rooms	4	100%	0	0%
<b>Total No.</b>	<b>24</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	16	100%	0	0%
No. KDs	4	100%	0	0%
No. Living Rooms	4	100%	0	0%
<b>Total No.</b>	<b>24</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type R2

The daylight provision results for house types R2 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	40
Total No. KDs Tested	10
Total No. Living Rooms Tested	10
<b>Total No. Spaces Tested</b>	<b>60</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	40	100%	0	0%
No. KDs	10	100%	0	0%
No. Living Rooms	10	100%	0	0%
<b>Total No.</b>	<b>60</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	40	100%	0	0%
No. KDs	10	100%	0	0%
No. Living Rooms	10	100%	0	0%
<b>Total No.</b>	<b>60</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type T1

The daylight provision results for house types T1 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	2
Total No. LKDs Tested	1
<b>Total No. Spaces Tested</b>	<b>3</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	2	100%	0	0%
No. LKDs	1	100%	0	0%
<b>Total No.</b>	<b>3</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	2	100%	0	0%
No. LKDs	1	100%	0	0%
<b>Total No.</b>	<b>3</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## House Type T2

The daylight provision results for house types T2 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	2
Total No. LKDs Tested	1
Total No. Spaces Tested	3

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	2	100%	0	0%
No. LKDs	1	100%	0	0%
Total No.	3	100%	0	0%

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	2	100%	0	0%
No. LKDs	1	100%	0	0%
Total No.	3	100%	0	0%

## Duplex House Type Q

The daylight provision results for house types Q in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	51
Total No. LKDs Tested	34
Total No. Spaces Tested	85

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	51	100%	0	0%
No. LKDs	34	100%	0	0%
Total No.	85	100%	0	0%

<b>BRE Guide 3<sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex</b>				
<b>Room Type</b>	<b>Pass (No.)</b>	<b>Pass (%)</b>	<b>Fail (No.)</b>	<b>Fail (%)</b>
<b>No. Bedrooms</b>	51	100%	0	0%
<b>No. LKDs</b>	34	100%	0	0%
<b>Total No.</b>	<b>85</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

### Duplex House Type Q3

The daylight provision results for house types Q3 in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

<b>Rooms Tested</b>	<b>Total No. Rooms</b>
<b>Total No. Bedrooms Tested</b>	12
<b>Total No. LKDs Tested</b>	8
<b>Total No. Spaces Tested</b>	<b>20</b>

<b>BRE Guide 3<sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment</b>				
<b>Room Type</b>	<b>Pass (No.)</b>	<b>Pass (%)</b>	<b>Fail (No.)</b>	<b>Fail (%)</b>
<b>No. Bedrooms</b>	12	100%	0	0%
<b>No. LKDs</b>	8	100%	0	0%
<b>Total No.</b>	<b>20</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

<b>BRE Guide 3<sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex</b>				
<b>Room Type</b>	<b>Pass (No.)</b>	<b>Pass (%)</b>	<b>Fail (No.)</b>	<b>Fail (%)</b>
<b>No. Bedrooms</b>	12	100%	0	0%
<b>No. LKDs</b>	8	100%	0	0%
<b>Total No.</b>	<b>20</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## Total for the Houses

The daylight provision results for all Houses in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	489
Total No. KDs Tested	163
Total No. Livings Tested	163
Total No. LKDs Tested	2
Total No. Spaces Tested	<b>817</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	489	100%	0	0%
No. KDs	163	100%	0	0%
No. Livings	163	100%	0	0%
No. LKDs	2	100%	0	0%
Total No.	<b>817</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	489	100%	0	0%
No. KDs	163	100%	0	0%
No. Livings	163	100%	0	0%
No. LKDs	2	100%	0	0%
Total No.	<b>817</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

### Total for Duplex Houses – Q and Q3

The daylight provision results for Duplex Houses in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	63
Total No. LKDs Tested	42
Total No. Spaces Tested	105

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	63	100%	0	0%
No. LKDs	42	100%	0	0%
Total No.	105	100%	0	0%

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	63	100%	0	0%
No. LKDs	42	100%	0	0%
Total No.	105	100%	0	0%



## Total for the Development

The daylight provision results for all the Houses and Duplex Houses in the development under the various standards are summarised below. Under BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 Method 2, a compliance rate of 100% is achieved which remain 100% under BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 Method 2 National Annex.

Rooms Tested	Total No. Rooms
Total No. Bedrooms Tested	552
Total No. LKDs Tested	44
Total No. KDs Tested	163
Total No. Livings Tested	163
Total No. Spaces Tested	<b>922</b>

BRE Guide 3 <sup>rd</sup> Edition / IS EN 17037:2018 Method 2 Assessment				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	552	100%	0	0%
No. LKDs	44	100%	0	0%
No. KDs	163	100%	0	0%
No. Livings	163	100%	0	0%
Total No.	<b>922</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

BRE Guide 3 <sup>rd</sup> Edition / BS EN 17037:2018 Method 2 Assessment - National Annex				
Room Type	Pass (No.)	Pass (%)	Fail (No.)	Fail (%)
No. Bedrooms	552	100%	0	0%
No. LKDs	44	100%	0	0%
No. KDs	163	100%	0	0%
No. Livings	163	100%	0	0%
Total No.	<b>922</b>	<b>100%</b>	<b>0</b>	<b>0%</b>

## 10.4 Discussion

For the daylight to proposed development assessment, two standards have been analysed: IS EN 17037-2018+A1-2021 and BS EN 17037-2018+A1-2021 National Annex (BRE Guide 3<sup>rd</sup> Edition). The results under each standard are summarised below.

### **BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021**

It is important to note that IS EN 17037-2018+A1-2021 (BRE Guide 3<sup>rd</sup> Edition) does not provide different illuminance targets for different space types. Therefore, in the case of residential developments; bedrooms, living rooms, kitchens and combined LKDs all have the same daylight provision targets.

Across the proposed development, 100% of the tested rooms are achieving the daylight provision targets in accordance with Table A.1 of IS EN 17037-2018+A1-2021 using Method 2.

### **BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 National Annex**

In the UK, EN 17037-2018+A1-2021 was adopted to form “BS EN 17037-2018+A1-2021”. However, a National Annex was included which states:

*“The UK committee supports the recommendations for daylight in buildings given in BS EN 17037:2018; however, it is the opinion of the UK committee that the recommendations for daylight provision in a space (see Clause A.2) may not be achievable for some buildings, particularly dwellings. The UK committee believes this could be the case for dwellings with basement rooms or those with significant external obstructions (for example, dwellings situated in a dense urban area or with tall trees outside), or for existing buildings being refurbished or converted into dwellings. This National Annex therefore provides the UK committee’s guidance on minimum daylight provision in all UK dwellings.”*

Whereas IS EN 17037-2018+A1-2021 does not provide different illuminance targets for different space types, the BS EN 17037-2018+A1-2021 National Annex provides target illuminance values for bedrooms, living rooms and kitchens within residential developments as per Table NA.1 (refer to Section 10.1.2 of this report). It is also important to note that as the climate in Ireland is similar to the UK, the targets outlined in the BS EN National Annex could also be applied to dwellings in Ireland.

The BS National Annex also states:

*“Where one room in a UK dwelling serves more than a single purpose, the UK committee recommends that the target illuminance is that for the room type with the highest value – for example, in a space that combines a living room and a kitchen the target illuminance is recommended to be 200 lx.”*

Therefore, combined LKDs were assessed using a 200-lux target illuminance ( $E_T$ ).

Across the proposed development, 100% of the tested rooms are achieving the daylight provision targets in accordance with Table NA.1 of BS EN 17037-2018+A1-2021 using Method 2.

## 11 Conclusion

The following can be concluded based on the assessments undertaken:

### 11.1 Shadow Analysis

The shadow analysis illustrates different shadows being cast at key times of the year (March 21<sup>st</sup>, June 21<sup>st</sup> and December 21<sup>st</sup>) for the Existing/Permitted Situation and the Proposed Scheme. The results from the study are summarised as follows:

#### Properties on Slane Road - South

No additional shading visible from the proposed development on these existing properties throughout the year.

The potential shading impact is quantified via the “Sunlight to Amenity Spaces” and “Daylight to Existing Buildings” sections of this report.

### 11.2 Sunlight to Amenity Spaces

As outlined in Section 3.3.17 of the BRE Guide (3<sup>rd</sup> Edition), for a space to appear adequately sunlit throughout the year, at least half of the garden or amenity area should receive at least 2 hours of sunlight on March 21<sup>st</sup>. In the case of existing amenity spaces, if they are already below the 50% threshold then the BRE recommends the results kept to within 80% of the existing situation.

#### Permitted Amenity Spaces

On March 21<sup>st</sup> the permitted amenity spaces will receive similar levels of sunlight with the proposed development in place when compared to the permitted situation. In all cases the results comply with the recommendations in the BRE Guide outlined above.

#### Proposed Public Open Amenity Spaces

On March 21<sup>st</sup>, 96% of the combined proposed public open amenity area situated within the development site will receive at least 2 hours of sunlight over their total area. Thus, complying with the BRE recommendations. When considered individually, all amenity areas are also exceeding the BRE guidelines.

#### Proposed Rear Garden Amenity Spaces

On March 21<sup>st</sup>, 80% (132 out of 165) of the proposed rear garden amenity spaces within the development site will receive at least 2 hours of sunlight over their total area, thus complying with the BRE recommendations. When compared against the minimum area required for each dwelling the compliance rate increases to 95% (157 out of 165).

It is important to note that the rear garden amenity spaces were tested with a 2.00 meter high fence, except for numbers 93 and 94, where the boundary wall to the south is a 3.00 meter high acoustic wall. When this wall is reduced to 2.00 meters, amenity spaces number 93 and 94 receive at least 2 hours of sunlight on March 21<sup>st</sup> across their minimum area required. The overall results increase from 95% to 96%.

The majority of rear gardens receiving sunlight below recommended levels are as a result of the amenity overall site location and position in relation to neighbouring dwellings. In site layout planning this is inevitable. Not all amenities can be south facing or free from overshadowing from neighbouring dwellings within a housing development. For these reasons noted, achieving in excess of 80% of private amenities above the recommendations of 2 hours of sunlight during March 21<sup>st</sup> is a high standard to achieve.

#### **Proposed Creche Amenity Space.**

On March 21<sup>st</sup>, 48% of the proposed amenity space provided for the creche will receive at least 2 hours of sunlight over its total area. While this is just below the BRE recommendations, it is expected that this space will enjoy good levels of sunlight throughout the summer months when the climatic conditions permit its use.

### **11.3 Sunlight to Existing Buildings**

This study considers the proposed scheme and tests if the Annual Probable Sunlight Hours (APSH) results for the living room windows are greater than 25% annual and 5% winter sunlight or are greater than 0.8 times their former value with the proposed development in place or the reduction in sunlight across the year is less than 4% with the proposed development in place.

Based on the criteria outlined in Section 3.2.9 of the BRE Guide 3<sup>rd</sup> Edition, none of the existing/permitted buildings fit the requirements to be assessed and as such the APSH assessment was not conducted. The BRE guide (3<sup>rd</sup> Edition) notes that there should be no impact to sunlight for these properties “It is not always necessary to do a full calculation to check sunlight potential. The guideline above is met provided either the following is true:

- If the window wall faces within 90° of due south and no obstruction, measured in the section perpendicular to the window wall, subtends an angle of more than 25° to the horizontal. Again, obstructions within 90° of due north need not be counted.”

Given the statement above, the surrounding dwellings adjacent to the proposed development were verified noting that, in a section perpendicular to the window wall, no angle subtended more than 25° and, in some cases, they were also sitting to the south of the proposed development. The surrounding existing/permitted properties have been excluded from the assessment as noted in Section 3.2.9 of the BRE Guide 3<sup>rd</sup> Edition, that these windows need not be analysed as sunlight impact will be unnoticeable to the existing occupants.

### **11.4 Sunlight to Proposed Development**

As the sunlight exposure assessment in accordance with BRE Guide 3<sup>rd</sup> Edition / IS/BS EN 17037-2018+A1-2021 considers the orientation of the rooms the following should be noted from section 3.1.11 of the guide.

*“The BS EN 17037 criterion applies to rooms of all orientations, although if a room faces significantly north of due east or west it is unlikely to be met.”*

Of the 207 no. points tested, 100% meet the BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021 sunlight exposure recommendations of greater than 1.5 hours on March 21<sup>st</sup>.

Overall, the sunlight provision results to the proposed development in accordance with IS/BS EN 17037:23018 are considered excellent.

Finally, the sunlight exposure results are visually represented in Appendix B.

### **11.5 Daylight to Existing Buildings**

This study considers the Proposed Scheme and tests if the VSC results are greater than 27% or not less than 0.8 times the value of the Existing Situation.

Based on the criteria outlined in Section 2.2.5 of the BRE guidance (3<sup>rd</sup> Edition), none of the neighbouring buildings need to be included within the VSC assessment as they did not meet the criterion as laid out within the BRE guide which is as follows.

It is not always necessary to do a full calculation to check daylight potential. The guideline above is met provided the following is true:

- no obstruction, measured in the section perpendicular to the window wall, subtends an angle of more than 25° to the horizontal.

Therefore, as noted above, the adjacent buildings have been excluded within the VSC assessment as the daylight impact will be unnoticeable to the occupants of the neighbouring elevations. Please refer to section 7.3 25 Degree Rule for the section images produced as evidence for each of the qualifying views.

### **11.6 Daylight to Proposed Development**

For the daylight to proposed development assessment, two standards have been analysed: IS EN 17037-2018+A1-2021 and BS EN 17037-2018+A1-2021 National Annex (BRE Guide 3<sup>rd</sup> Edition). The results under each standard are summarised below.

Our proposed methodology was to model a sample of housing unit types within the proposed development to gain an understanding of the daylight performance for the development at this stage. The objective of the design team is to maximise the number of units which exceed the recommendations.

#### **BRE Guide 3<sup>rd</sup> Edition / IS EN 17037-2018+A1-2021**

It is important to note that IS EN 17037-2018+A1-2021 (BRE Guide 3<sup>rd</sup> Edition) does not provide different illuminance targets for different space types. Therefore, in the case of residential developments; bedrooms, living rooms, kitchens and combined LKDs all have the same daylight provision targets.

There are two methods to assess daylight provision to the interior which are based on target values in either Table A.1 or Table A.3 of IS EN 17037-2018+A1-2021 which are summarised as follows:

Method 1: This calculation method uses the daylight factor targets on the reference plane as per Table A.3 (refer to Section 10.1.2 of this report). The assessment is carried out on a representative day and time during the year, i.e. 21<sup>st</sup> September @ 12:00 under standard CIE overcast sky conditions.

Method 2: This calculation method uses the illuminance targets on the reference plane as per Table A.1 (refer to Section 10.1.2 of this report). The assessment is carried out for each hour over the course of the year (8,760 hours) using a local weather file which accounts for varying sky conditions and sun positions throughout the year.

As outlined in Section 5.1.4 of the standard, the verification of daylight provision can be determined using either an adequate software or on-site measurements. When using a software, *“a representative model of the space is required together with the key parameters (such as any significant nearby obstructions, the assigned surface reflectance values and glazing transmissivity) that are a reasonable representation of those for the actual, completed building. This can be determined using either Method 1 or Method 2.”*

Based on the above criteria, the daylight provision to the proposed development has been assessed using an adequate software (i.e. IES VE), using the Method 2 climate-based approach and targeting the minimum recommended values outlined in Table A.1 of IS EN 17037-2018+A1-2021.

The Method 2 climate-based approach was selected as it is a far more accurate assessment method compared to Method 1. Climate based daylight modelling (CBDM) is more accurate compared to a calculation based on a single day during the year, i.e. Method 1. The amount of daylight varies throughout the year, primarily due to the sun’s position, so it is essential the impact of daylight variance is properly considered. CBDM utilises an annual simulation linking location, shading, climate data (including solar intensity and cloud cover) together with the building properties. This provides a complete overview on how the daylight performance varies throughout the year due to changes in these factors.

Across the proposed development, 100% of the tested rooms are achieving the daylight provision targets in accordance with Table A.1 of IS EN 17037-2018+A1-2021 using Method 2.

### **BRE Guide 3<sup>rd</sup> Edition / BS EN 17037-2018+A1-2021 National Annex**

In the UK, EN 17037-2018+A1-2021 was adopted to form “BS EN 17037-2018+A1-2021”. However, a National Annex was included which states:

*“The UK committee supports the recommendations for daylight in buildings given in BS EN 17037:2018; however, it is the opinion of the UK committee that the recommendations for daylight provision in a space (see Clause A.2) may not be achievable for some buildings, particularly dwellings. The UK committee believes this could be the case for dwellings with basement rooms or those with significant external obstructions (for example, dwellings situated in a dense urban area or with tall trees outside), or for existing buildings being refurbished or converted into dwellings. This National Annex therefore provides the UK committee’s guidance on minimum daylight provision in all UK dwellings.”*

Whereas IS EN 17037-2018+A1-2021 does not provide different illuminance targets for different space types, the BS EN 17037-2018+A1-2021 National Annex provides target illuminance values for



bedrooms, living rooms and kitchens within residential developments as per Table NA.1 (refer to Section 10.1.2 of this report). It is also important to note that as the climate in Ireland is similar to the UK, the targets outlined in the BS EN National Annex could also be applied to dwellings in Ireland.

The BS National Annex also states:

*“Where one room in a UK dwelling serves more than a single purpose, the UK committee recommends that the target illuminance is that for the room type with the highest value – for example, in a space that combines a living room and a kitchen the target illuminance is recommended to be 200 lx.”*

Therefore, combined LKDs were assessed using a 200-lux target illuminance ( $E_T$ ).

Across the proposed development, 100% of the tested rooms are achieving the daylight provision targets in accordance with Table NA.1 of BS EN 17037-2018+A1-2021 using Method 2.

### **11.7 View Out**

The View Out assessment is related to buildings such as offices or schools where seating layouts are typically fixed compared to domestic settings where an occupant can move around the space freely. In their own home occupants can choose to sit near to or even at a window which will inevitably provide the varying layers of a ‘View Out’ such as the ground, landscape or sky. This ability to choose their position within a domestic setting means they would always have access to a position in the house or apartment with the minimum requirements of ‘View Out’. Therefore, all the properties would meet the minimum requirement as outlined in IS EN 17037-2018+A1-2021 / BS EN 17037-2018+A1-2021 National Annex (BRE Guide 3<sup>rd</sup> Edition).

### **11.8 Glare**

As outlined in IS EN 17037-2018+A1-2021 / BS EN 17037-2018+A1-2021 National Annex (BRE Guide 3<sup>rd</sup> Edition), a Glare assessment is suggested in spaces where the *“expected activities are comparable to reading, writing or using display devices and the user is not able to choose freely their position and viewing direction”*. Given that occupants within a domestic setting are free to move around, on this basis a glare assessment for the proposed development has not been carried out.

### **11.9 Observations**

It is important to note that the recommendations within the BRE Guide (3<sup>rd</sup> Edition) itself states *“although it gives numerical guidelines these should be interpreted flexibly because natural lighting is only one of many factors in site layout design”*, Although this is true appropriate and reasonable regard has still been taken to the BRE guide.

Whilst the results shown relate to the criteria as laid out in the BRE Guide (3<sup>rd</sup> Edition), it is important to note that the BRE targets are guidance only and should therefore be used with flexibility and caution when dealing with different types of sites.

In addition, BRE Guide 3<sup>rd</sup> Edition also notes:



“This report is a comprehensive revision of the 2011 edition of Site layout planning for daylight and sunlight: a guide to good practice. It is purely advisory and the numerical target values within it may be varied to meet the needs of the development and its location.”

Taking all of the above information into account and based on the results from each of the assessments undertaken, the proposed development performs very well when compared to the recommendations in the BRE Guide 3rd Edition and IS EN 17037-2018+A1-2021 /BS EN 17037-2018+A1-2021 National Annex.

## 12 Appendix A – Daylight Provision Results

The tables in the following sections summarise the daylight provision results for the rooms that were assessed in the proposed development. Note, within the tables the code “LKD” equates to combined Living, Kitchen, Dining area.

The results for the following daylight standards are included in each table:

- BRE Guide (3<sup>rd</sup> Edition) / IS EN 17037-2018+A1-2021
- BRE Guide (3<sup>rd</sup> Edition) / BS EN 17037-2018+A1-2021 National Annex

Please note, the “Comment” symbol in each of the tables represents the following:

### BRE Guide (3<sup>rd</sup> Edition) / IS EN 17037-2018+A1-2021

- ✓ These rooms achieve both the target illuminance ( $E_T$ ) and minimum target illuminance ( $E_{TM}$ ) over the minimum floor area requirements, i.e. 300 lux for over 50% of their floor area ( $E_T$ ) and 100 lux for over 95% of their floor area ( $E_{TM}$ ).
- x These rooms do not achieve both the target illuminance ( $E_T$ ) and minimum target illuminance ( $E_{TM}$ ) over the minimum floor area requirements.

### BRE Guide (3<sup>rd</sup> Edition) / BS EN 17037-2018+A1-2021 National Annex

- ✓ These rooms achieve the target illuminance ( $E_T$ ) over the minimum floor area requirements, i.e. 100 lux for over 50% of bedroom floor areas, and 200 lux for over 50% of LKD floor areas.
- x These rooms do not achieve the target illuminance ( $E_T$ ) over the minimum floor area requirements.

## 12.1 Daylight Results

### 12.1.1 Type K



Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
K-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	73	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	98	100	✓	100	✓
K-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	62	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	82	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-05	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-06	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	68	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-07	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-08	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	98	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-09	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	98	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-10	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓

Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
K-11	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	54	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-12	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	94	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-13	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-14	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	65	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-15	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	65	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-16	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	64	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-17	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-18	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	60	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-19	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-20	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓

Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
K-21	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	67	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-22	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	67	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-23	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-24	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-25	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	94	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-26	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	98	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-27	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
K-28	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	92	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓



### 12.1.2 Type L1





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
L1-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	54	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	93	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	93	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-05	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	51	100	✓	100	✓
		3	Bedroom	98	100	✓	100	✓
L1-06	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	91	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-07	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-08	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	72	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-09	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-10	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓

Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
L1-11	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	96	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-12	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-13	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	90	100	✓	100	✓
		2	Bedroom	61	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-14	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-15	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	90	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-16	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-17	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-18	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-19	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	64	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-20	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓

Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
L1-21	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	94	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-22	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	78	100	✓	100	✓
		2	Bedroom	65	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-23	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	54	100	✓	100	✓
		2	Bedroom	56	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-24	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	53	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-25	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	99	100	✓	100	✓
		2	Bedroom	50	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-26	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	91	100	✓	100	✓
		2	Bedroom	53	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-27	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	50	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-28	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	59	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-29	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	93	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-30	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	91	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓

Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
L1-31	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	55	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-32	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-33	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-34	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-35	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-36	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	93	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-37	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-38	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	97	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-39	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	94	100	✓	100	✓
		2	Bedroom	50	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L1-40	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	91	100	✓	100	✓
		2	Bedroom	50	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓



Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
L1-41	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	54	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓

### 12.1.3 Type L2







Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
L2-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L2-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L2-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L2-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L2-05	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	67	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
L2-06	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓

### 12.1.4 Type M1





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
M1-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
M1-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	100	100	✓	100	✓

### 12.1.5 Type M2





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
M2-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
M2-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	100	100	✓	100	✓

### 12.1.6 Type M3





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
M3-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	52	100	✓	100	✓
4	Bedroom	100	100	✓	100	✓		
M3-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	52	100	✓	100	✓
4	Bedroom	100	100	✓	100	✓		
M3-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	50	100	✓	100	✓
4	Bedroom	100	100	✓	100	✓		
M3-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	56	100	✓	100	✓
4	Bedroom	100	100	✓	100	✓		



### 12.1.7 Type N1





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
N1-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N1-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N1-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N1-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N1-05	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N1-06	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N1-07	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N1-08	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	55	100	✓	100	✓
		3	Bedroom	59	100	✓	100	✓
N1-09	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	97	100	✓	100	✓
		3	Bedroom	80	100	✓	100	✓
N1-10	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	95	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓

### 12.1.8 Type N2





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
N2-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N2-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	94	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N2-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	98	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N2-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N2-05	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N2-06	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	97	100	✓	100	✓
		3	Bedroom	88	100	✓	100	✓
N2-07	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	83	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N2-08	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N2-09	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
N2-10	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	52	100	✓	100	✓
		3	Bedroom	52	100	✓	100	✓

### 12.1.9 Type O1





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
O1-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O1-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	90	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O1-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	95	100	✓	100	✓
		3	Bedroom	97	100	✓	100	✓
O1-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓

**12.1.10 Type O2**





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
O2-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	99	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O2-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O2-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	99	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O2-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	69	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O2-05	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O2-06	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	99	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O2-07	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	83	100	✓	100	✓
		3	Bedroom	97	100	✓	100	✓
O2-08	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O2-09	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	92	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O2-10	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	98	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓

**12.1.11 Type O3**





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
O3-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O3-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	88	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O3-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	67	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O3-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	55	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O3-05	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	99	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
O3-06	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	68	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓

**12.1.12 Type P1**





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
P1-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	96	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	99	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-05	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-06	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	99	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-07	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-08	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-09	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-10	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-11	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-12	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-13	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-14	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓



Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
P1-15	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-16	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	90	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P1-17	L00	1	Living	99	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓

**12.1.13 Type P2**







Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
P2-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P2-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P2-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P2-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P2-05	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	96	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P2-06	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P2-07	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P2-08	L00	1	Living	77	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
P2-09	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	91	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓

**12.1.14 Type R1**





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
R1-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	100	100	✓	100	✓
R1-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	100	100	✓	100	✓
R1-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	100	100	✓	100	✓
R1-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	100	100	✓	100	✓

**12.1.15 Type R2**






Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
R2-01	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	87	100	✓	100	✓
R2-02	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	100	100	✓	100	✓
R2-03	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	100	100	✓	100	✓
R2-04	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	96	100	✓	100	✓
R2-05	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	99	100	✓	100	✓
R2-06	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	100	100	✓	100	✓
R2-07	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	100	100	✓	100	✓
R2-08	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	86	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	79	100	✓	100	✓
R2-09	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	94	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	100	100	✓	100	✓



Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
R2-10	L00	1	Living	100	100	✓	100	✓
		2	KD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓
		3	Bedroom	100	100	✓	100	✓
		4	Bedroom	92	100	✓	100	✓

**12.1.16 Type T1**

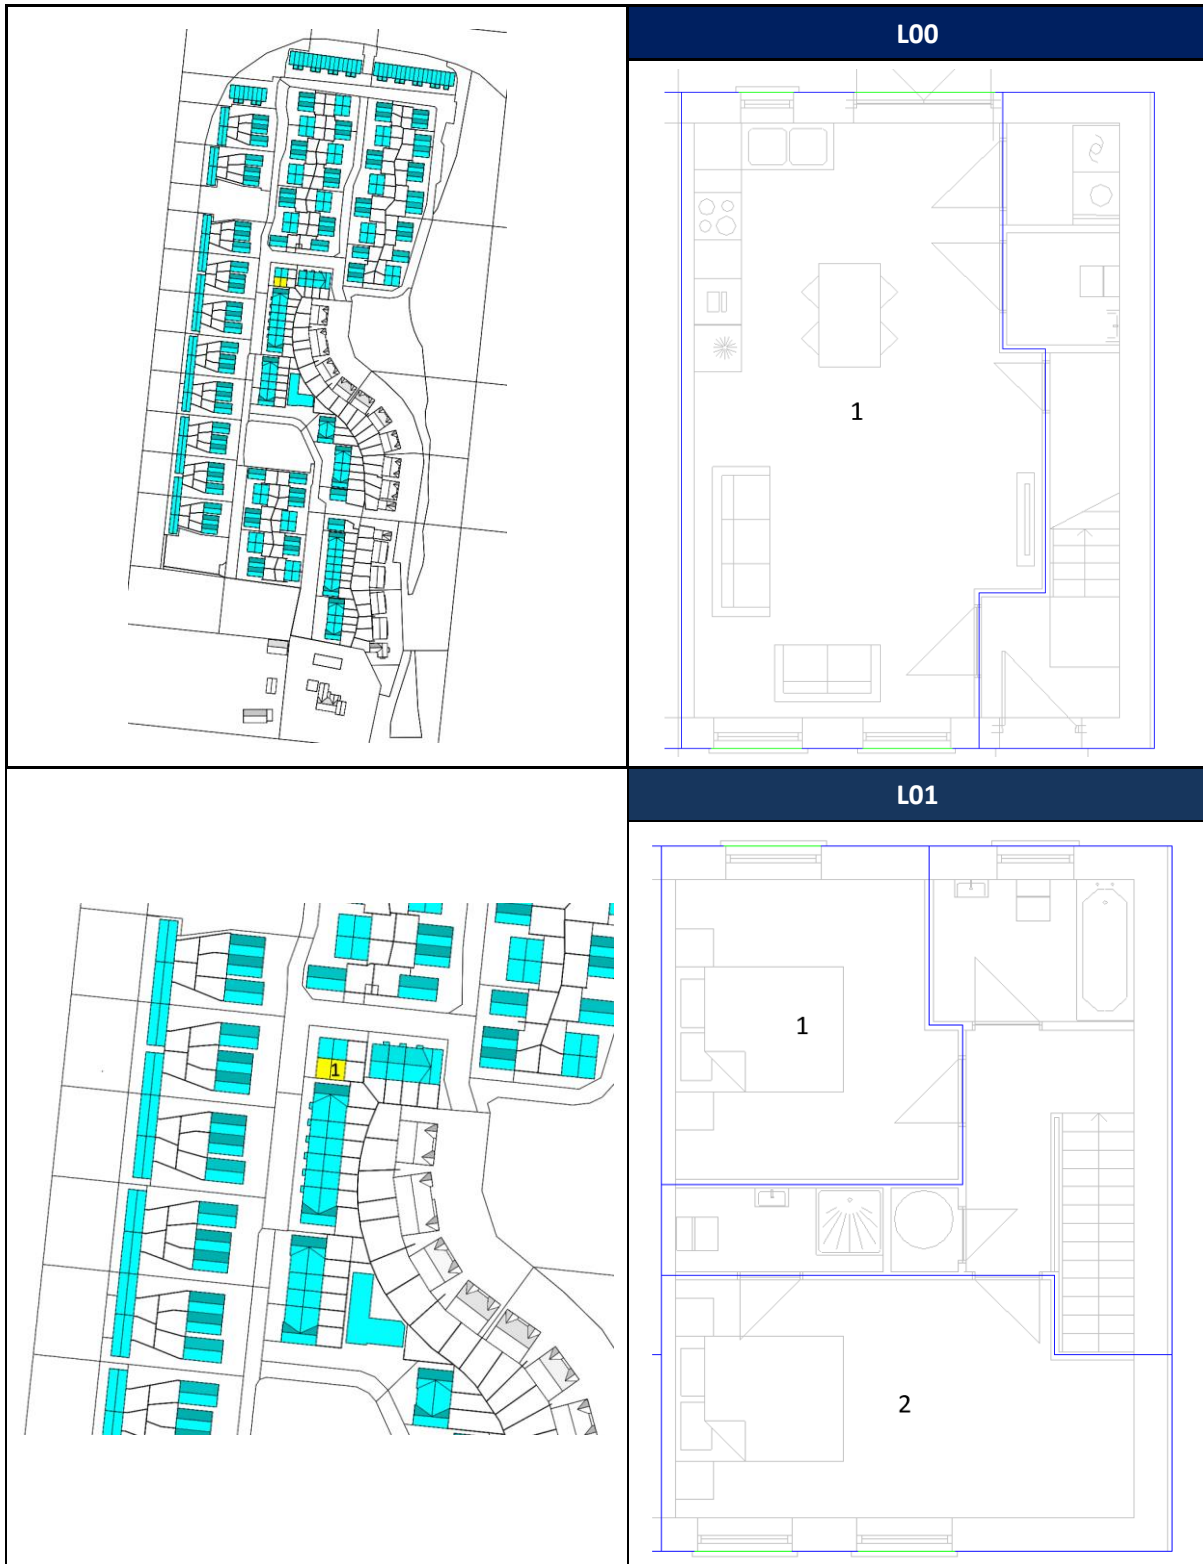





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
T1-01	L00	1	LKD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓

**12.1.17**      **Type T2**





Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
T2-01	L00	1	LKD	100	100	✓	100	✓
	L01	1	Bedroom	100	100	✓	100	✓
		2	Bedroom	100	100	✓	100	✓

### 12.1.18 Duplex Q



Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
Q-01	L00	1	LKD	74	100	✓	100	✓
		2	Bedroom	68	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
Q-02	L00		1	LKD	99	100	✓	100
		2	Bedroom	66	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
Q-03	L00		1	LKD	100	100	✓	100
		2	Bedroom	53	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
Q-04	L00		1	LKD	100	100	✓	100
		2	Bedroom	54	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
Q-05	L00		1	LKD	100	100	✓	100
		2	Bedroom	54	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
Q-06	L00		1	LKD	100	100	✓	100
		2	Bedroom	53	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
Q-07	L00		1	LKD	99	100	✓	100
		2	Bedroom	57	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
Q-08	L00		1	LKD	100	100	✓	100
		2	Bedroom	57	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
Q-09	L00		1	LKD	100	100	✓	100
		2	Bedroom	58	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
Q-10	L00		1	LKD	100	100	✓	100
		2	Bedroom	57	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
Q-11	L00		1	LKD	100	100	✓	100
		2	Bedroom	50	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
L02	2		Bedroom	99	100	✓	100	✓



Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex	
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment
Q-12	L00	1	LKD	100	100	✓	100	✓
		2	Bedroom	58	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
			2	Bedroom	99	100	✓	100
Q-13	L00	1	LKD	100	100	✓	100	✓
		2	Bedroom	56	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
			2	Bedroom	98	100	✓	100
Q-14	L00	1	LKD	100	100	✓	100	✓
		2	Bedroom	51	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
			2	Bedroom	93	100	✓	100
Q-15	L00	1	LKD	99	100	✓	100	✓
		2	Bedroom	64	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
			2	Bedroom	96	100	✓	100
Q-16	L00	1	LKD	100	100	✓	100	✓
		2	Bedroom	57	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
			2	Bedroom	96	100	✓	100
Q-17	L00	1	LKD	66	100	✓	100	✓
		2	Bedroom	52	100	✓	100	✓
	L01	1	LKD	100	100	✓	100	✓
		L02	1	Bedroom	100	100	✓	100
			2	Bedroom	100	100	✓	100

**12.1.19 Duplex Q3**








Unit	Floor	Ref.	Room Activity	BRE Guide 3 <sup>rd</sup> Edition IS EN 17037:2018 Method 2			BRE Guide 3 <sup>rd</sup> Edition BS EN 17037:2018 Method 2 National Annex		
				Floor Area > E <sub>T</sub> (%)	Floor Area > E <sub>TM</sub> (%)	Comment	Floor Area > E <sub>T</sub> (%)	Comment	
Q3-01	L00	1	LKD	100	100	✓	100	✓	
		2	Bedroom	52	100	✓	100	✓	
	L01	1	LKD	100	100	✓	100	✓	
		L02	1	Bedroom	100	100	✓	100	✓
			2	Bedroom	100	100	✓	100	✓
Q3-02	L00	1	LKD	100	100	✓	100	✓	
		2	Bedroom	52	100	✓	100	✓	
	L01	1	LKD	100	100	✓	100	✓	
		L02	1	Bedroom	100	100	✓	100	✓
			2	Bedroom	100	100	✓	100	✓
		Q3-03	L00	1	LKD	100	100	✓	100
2	Bedroom			84	100	✓	100	✓	
L01	1		LKD	100	100	✓	100	✓	
	L02		1	Bedroom	100	100	✓	100	✓
			2	Bedroom	100	100	✓	100	✓
Q3-04	L00	1	LKD	100	100	✓	100	✓	
		2	Bedroom	53	100	✓	100	✓	
	L01	1	LKD	100	100	✓	100	✓	
		L02	1	Bedroom	100	100	✓	100	✓
			2	Bedroom	100	100	✓	100	✓

## 13 Appendix B – Sunlight Exposure Results


### 13.1 Sunlight Exposure Results

The IS EN 17037-2018+A1-2021 (BRE Guide 3<sup>rd</sup> Edition) sunlight exposure results tabulated in Section 8.2 for the proposed development are visually represented in the following images. The windows highlighted in “red” achieve the minimum 1.5 hours of recommended sunlight on March 21<sup>st</sup>, while the windows highlighted in “blue” do not achieve the recommended value.


#### 13.1.1 View 01

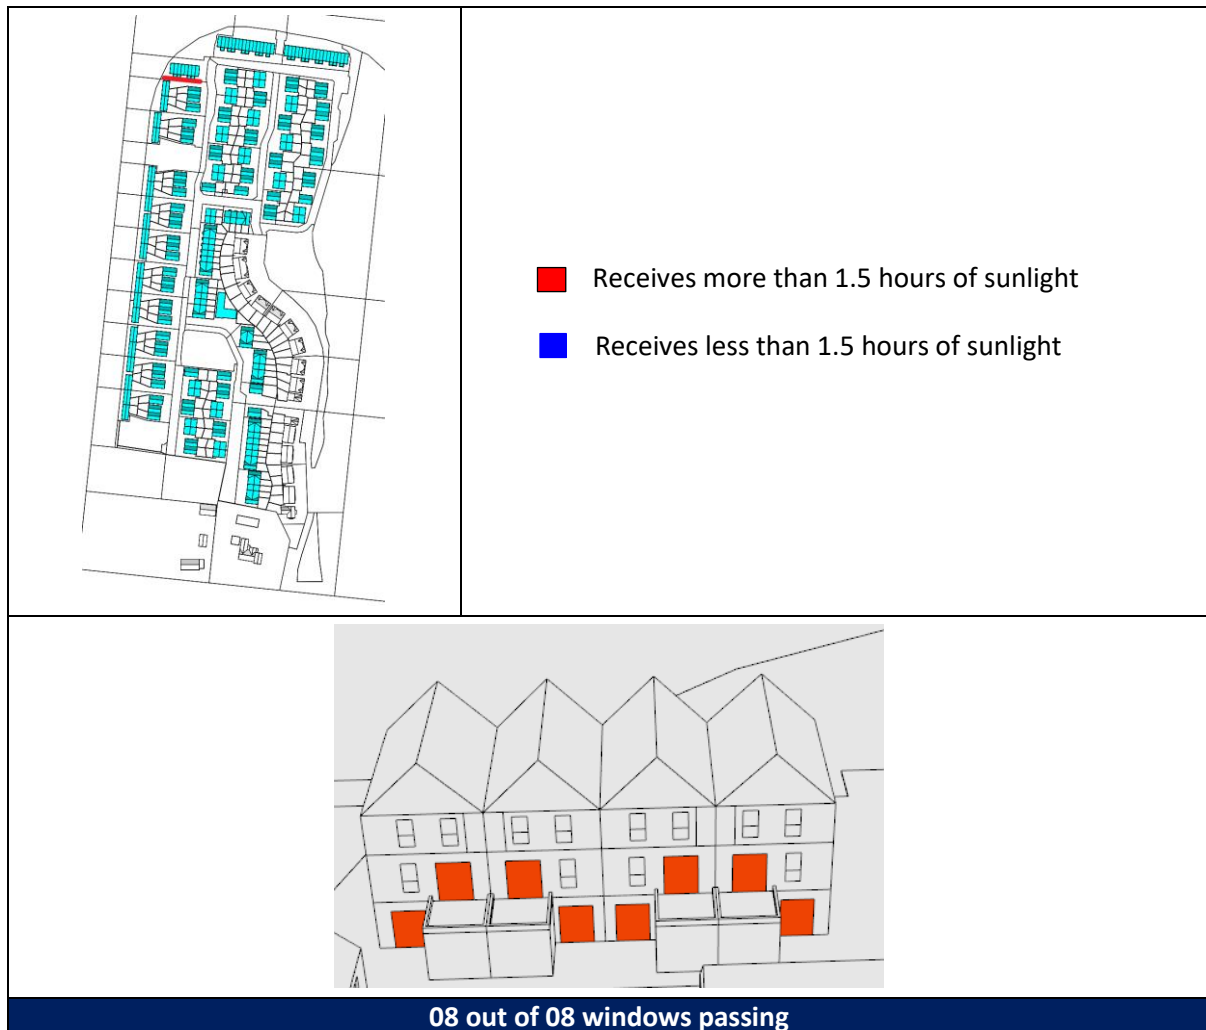

### 13.1.2 View 02

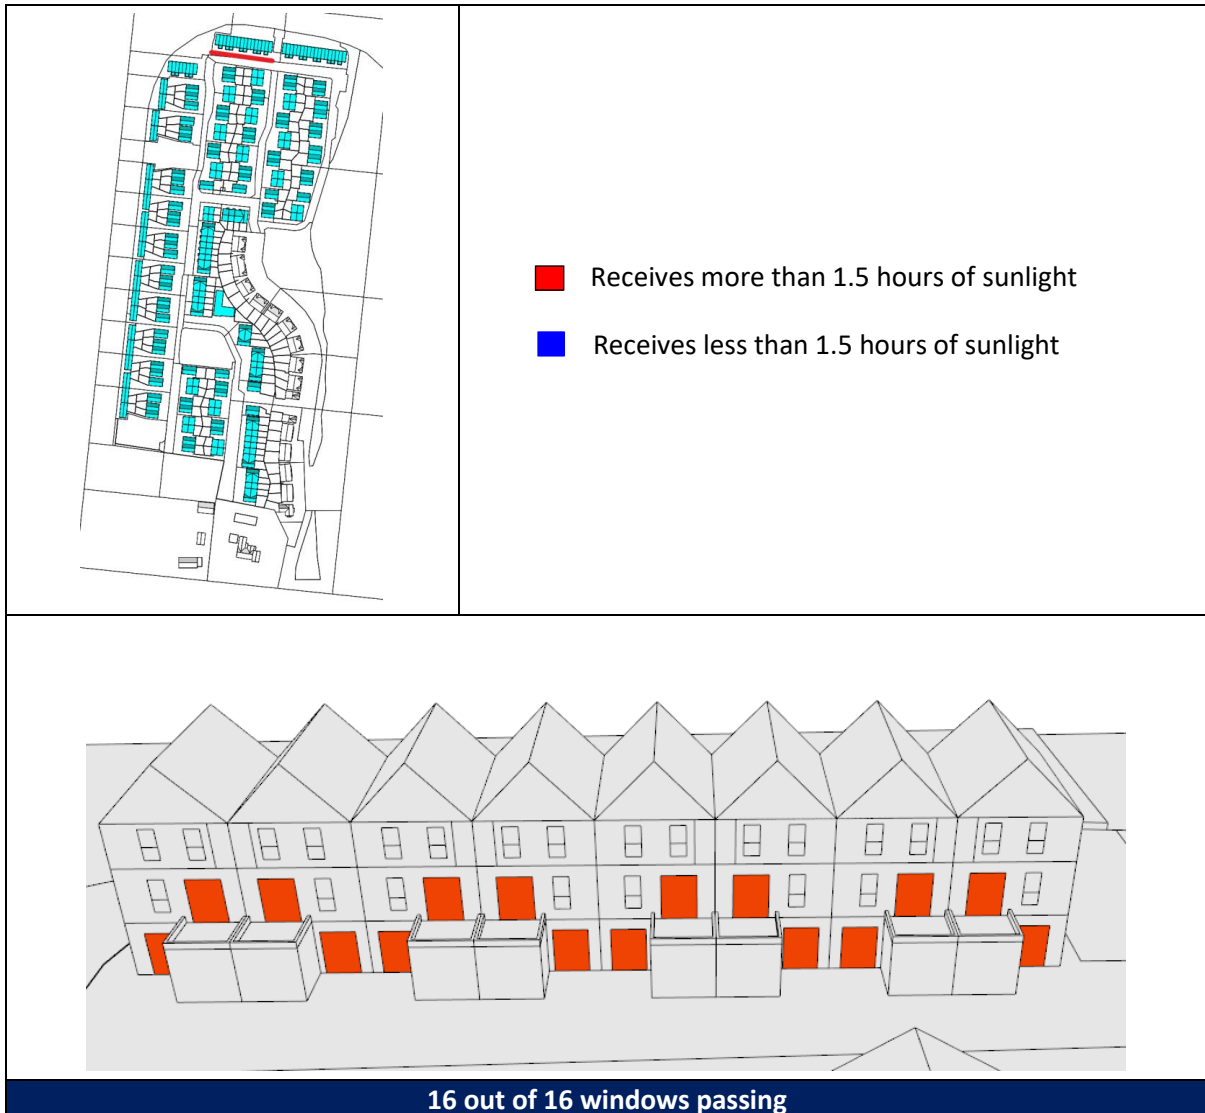


### 13.1.3 View 03

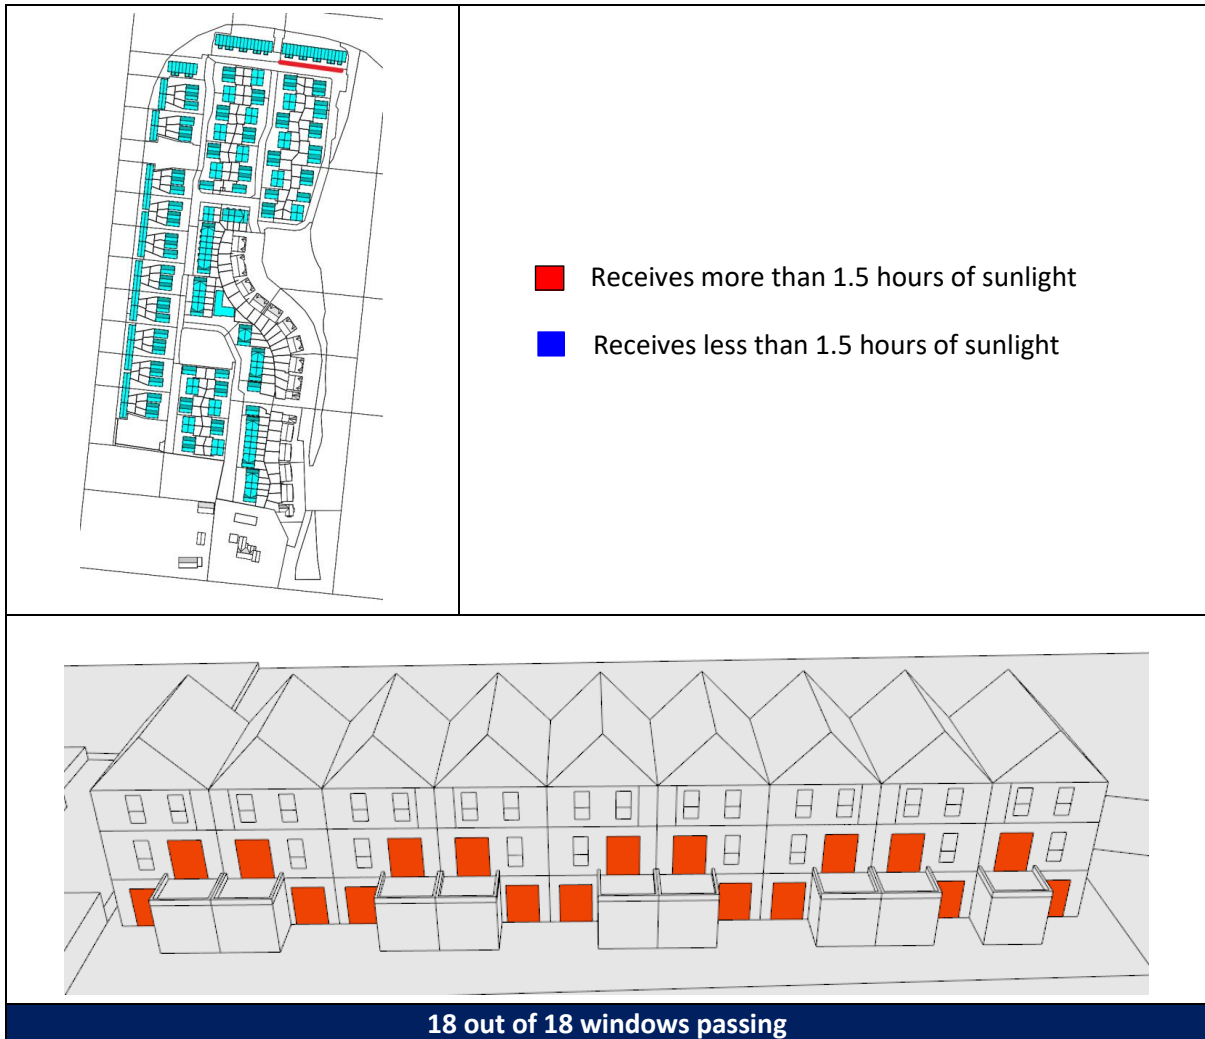

### 13.1.4 View 04



### 13.1.5 View 05

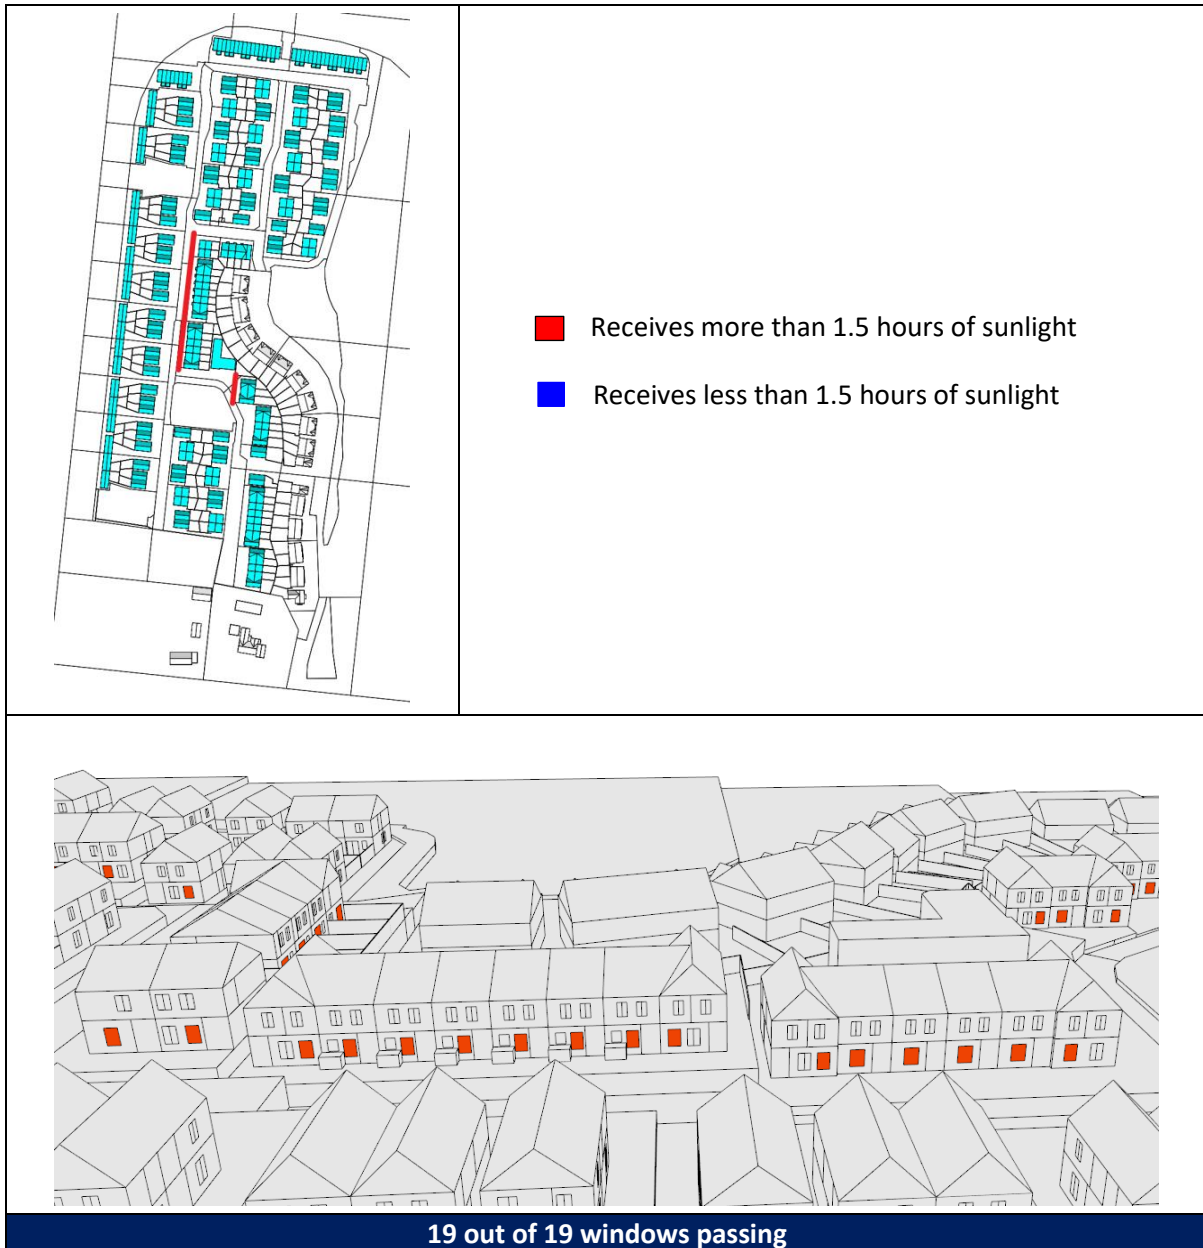

### 13.1.6 View 06






### 13.1.7 View 07



### 13.1.8 View 08

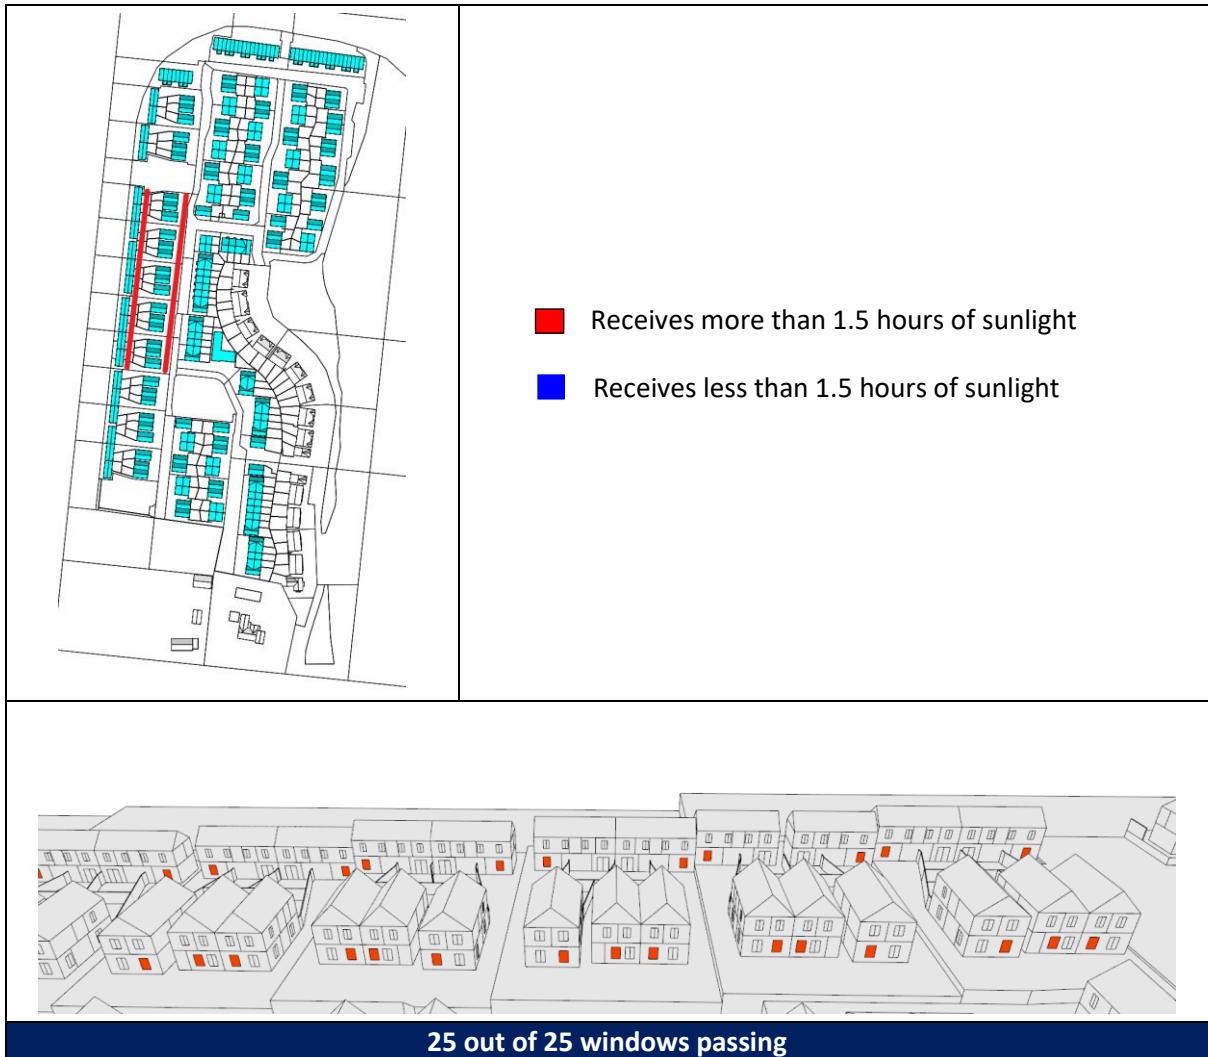

### 13.1.9 View 09



### 13.1.10 View 10



### 13.1.11 View 11

